




MSI 400 Hardware

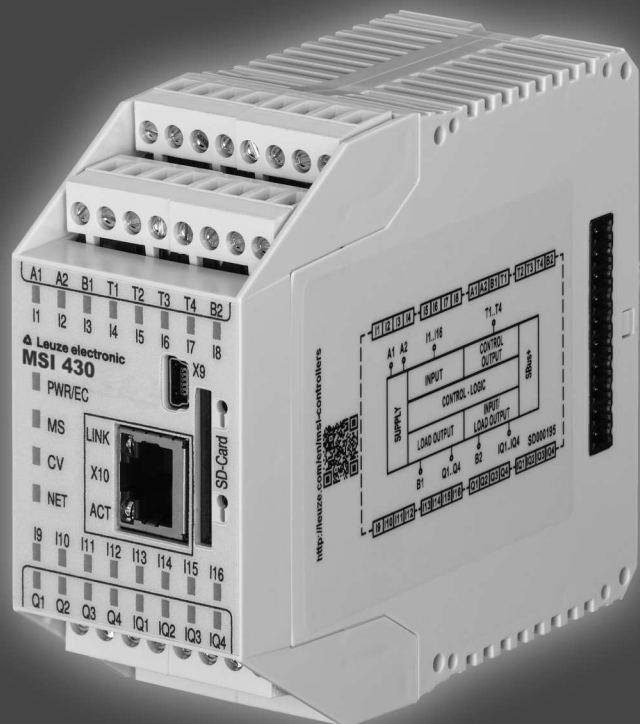

© 2021

Leuze electronic GmbH & Co. KG

In der Braike 1

D-73277 Owen / Germany

Phone: +49 7021 573-0

Fax: +49 7021 573-199

<http://www.leuze.com>

info@leuze.de

1	About this manual.....	6
1.1	Function of this document.....	6
1.2	Target group	6
1.3	Information depth	6
1.4	Scope of validity and applicable documents	7
1.5	Abbreviations used	7
1.6	Symbols/icons and writing style/spelling standard used	8
1.7	Copyright and right of modification	8
2	Safety	9
2.1	Proper use	9
2.2	Areas of application of the device	9
2.3	Qualified persons	10
2.4	Special obligations of the operator	11
3	Product description	12
3.1	Brief overview	12
3.2	System setup	13
3.3	Version, compatibility, and features	14
3.4	Controller module	15
3.4.1	Controller module MSI 410.....	15
3.4.2	Controller module MSI 420.....	19
3.4.3	Controller module MSI 430.....	23
3.5	MSI-SD-CARD removable storage	24
3.5.1	Description	24
3.5.2	Files on the removable storage	25
3.6	MSI-EM-IO84 input/output expansion module	27
3.6.1	Description	27
3.6.2	Display elements and terminal assignment.....	28
3.6.3	Internal circuits	29
3.6.4	Deactivating the test pulses at the outputs.....	30
3.6.5	Single-channel use of outputs	30
3.7	MSI-EM-I8 input expansion module.....	31
3.7.1	Description	31
3.7.2	Display elements and terminal assignment.....	32
3.7.3	Internal circuits	33
3.8	MSI-EM-IO84NP input/output expansion module	34
3.8.1	Description	34
3.8.2	Display elements and terminal assignment.....	35
3.8.3	Internal circuits	36
4	Connection of sensors and actuators	38
4.1	Safety command devices and electromechanical safety switches	40
4.1.1	Emergency stop button	40
4.1.2	Electromechanical safety switch without lock.....	40
4.1.3	Electromechanical safety switch with lock.....	41
4.1.4	Enable switch	42
4.1.5	Two-hand control.....	42
4.1.6	Safety mats and bumper	43
4.1.7	Connection of multiple safety mats/bumpers	45
4.1.8	Operation mode selection switch	45
4.1.9	Potential-free contacts.....	45

4.2	Contactless safety sensors	46
4.2.1	Magnetic safety switches	46
4.2.2	Inductive safety switches	47
4.2.3	Transponder switches	47
4.3	Testable single-beam safety light barriers	48
4.3.1	Testable type 2 single-beam safety light barriers	48
4.3.2	Testable type 4 single-beam safety light barriers	48
4.3.3	Customer-specific testable single-beam safety light barriers	49
4.3.4	Information on installing testable single-beam safety light barriers	49
4.4	BWS – Contactless Safety Devices	51
4.5	Safety outputs	51
5	Special functions	52
5.1	Muting	52
6	Installing/removing	53
6.1	Installation position and maximum expansion stage	53
6.2	Installing modules on DIN rails	54
6.3	Removing modules from the DIN rail	58
7	Electrical installation	60
7.1	Requirements for electrical installation	60
7.2	Safe installation in line with EMC provisions	62
7.3	Internal wiring of the supply voltage	63
8	Configuration	64
9	Commissioning	65
9.1	Total acceptance of the application	65
9.2	Tests before initial commissioning	65
10	Diagnostics	66
10.1	What to do in the event of an error	66
10.2	Error statuses	66
10.3	Error displays of the status LEDs	67
10.3.1	Device state and LED displays in the controller modules	68
10.3.2	Device state and LED displays in the safe input/output modules	70
10.3.3	Device state and LED displays in the standard input/output modules	71
10.4	Support	73
10.5	Expanded diagnostics	73
11	Maintenance	74
11.1	Regular testing of the safety equipment by qualified persons	74
11.2	Replacing devices	75
11.2.1	Safety measures when replacing devices	75
12	Technical data	76
12.1	Response times for basic safety functions	76
12.1.1	Minimum switch-off time	78
12.1.2	Response time of the state flag	78
12.2	Safety technology reference values	78
12.2.1	Controller modules without I/O expansion	78
12.2.2	Controller modules with safe digital I/O expansion	79
12.2.3	Controller modules with safe digital I/O expansion	80

12.3	Data sheet	81
12.3.1	Controller module	81
12.3.2	Safe input/output expansion module	84
12.3.3	Safe input expansion module	87
12.3.4	Standard input/output expansion module	89
12.4	Dimensional drawings	91
12.4.1	Controller module	91
12.4.2	Input/output expansion modules	92
13	Order data	93
13.1	Hardware modules and accessories	93
13.2	Modules for contact expansion	95
14	Appendix	96
14.1	Declaration of Conformity	97
14.2	Checklist for manufacturers	101
14.3	List of all error messages, causes and aids	101

1 About this manual

Please read this section and the *Safety [chapter 2]* section carefully before working with the documentation or with the modular MSI 400 safety controller and the corresponding MSI 400 modules.

1.1 Function of this document

There are three manuals for the MSI 400 system with clearly delineated areas of application as well as installation instructions and brief instructions for each module.

- **This hardware manual** describes in-detail all modules that can be used with a MSI 4xx controller module and their functions. Use the hardware manual mainly for designing MSI 400 safety controllers. This manual will guide **technical personnel of the machine manufacturer** and/or **machine operator** on safe installation, electric installation, commissioning, and maintenance of the modular MSI 400 safety controller. This manual does **not** provide instructions for operating the machine into which the safety controller is or will be integrated. Instructions on how to operate the machine are provided for this purpose.
- The **software manual** describes the software-supported configuration and parameterization of the MSI 400 safety controller. In addition, the software manual contains a description of the important diagnostic functions for operation and detailed information for identifying and eliminating errors. Use the software manual mainly when configuring, commissioning and operating MSI 400 safety controllers.
- The **gateway manual** describes in-detail the MSI 400 gateways and their functions.
- Each module contains the **installation instructions/brief instructions**. These instructions provide information on the fundamental technical specifications of the modules and contain simple installation instructions. Use the installation instructions/brief instructions when installing the MSI 400 safety controller.

This manual contains original operating instructions in accordance with the Machinery Directive.

1.2 Target group

This manual is intended for **designers, developers, and operators** of systems that are to be safeguarded by a modular MSI 400 safety controller.

It is also intended for persons integrating a MSI 400 safety controller into a machine, commissioning it for the first time, or maintaining such a system.

1.3 Information depth

This manual contains information on the modular MSI 400 safety controller with respect to the following topics:

- Mounting
- Electrical installation
- Hardware commissioning
- Maintenance
- Error diagnostics and error elimination
- Item numbers
- Conformity and approval

Furthermore, specialized technical knowledge that is not provided in this document is required when designing and using Leuze safety equipment.

Governmental and legal regulations must always be adhered to when operating the modular MSI 400 safety controller.

Downloads available from the Internet

Also consult our website on the Internet. At the following link www.leuze.com, you will find:

- the MSI.designer software
- The MSI 400 manuals available for display and printing in various languages:
 - This hardware manual (50134710)
 - The software manual (50134712)
 - The gateway manual (50134714)

1.4 Scope of validity and applicable documents

This manual is valid for all MSI 400 safety controller modules that are operated in connection with MSI 4xx and MSI.designer controller modules.



Tab. 1.1: Overview of the MSI 400 documentation

Document	Title	Article number
Software manual	MSI.designer software	50134712
Hardware manual	MSI 400 hardware	50134710
Gateway manual	MSI 400 gateways	50134714
Operating instructions	MSI 400	50134613
Operating instructions	MSI-EM-IO84-xx / MSI-EM-I8-xx	50134614
Operating instructions	MSI-EM-IO84NP-xx	50134615
Operating instructions	MSI-FB-CANOPEN	50134616
Operating instructions	MSI-FB-PROFIBUS	50134617
Operating instructions	MSI-FB-ETHERCAT	50134618

1.5 Abbreviations used

ESPE	Contactless protection unit, light curtain
Bypass	You can use a bypass input to set the release to 1, regardless of the system status. As a result, the calculation of the releases by the FB is overruled by the Bypass.
Logic cycle time	Processing time of the user program. Appears in the status line of MSI.designer and in the MSI.designer report
EDM	External Device Monitoring = Contact monitor
Muting	The muting input can be used to hold a current release on 1 for as long as the muting input is activated. Only the releases that were already previously set to 1 are muted.
OSSD	Output Signal Switching Device = Signal output that triggers the safety circuit
PFHd	Probability of Dangerous Failure per Hour
Process Safety Time	Predetermined total time during which the safe subsystem has to detect the need for a safe state and subsequently switch to this state.
PST	Process Safety Time
SIL	Safety Integrity Level (Safety Category)
PLC	Programmable logic controller
CPU cycle time	Internal system cycle time
Reset	User-controlled reset of an internal FB monitoring error via an FB input. A reset is only effective when the reason for the error was previously eliminated by the user. The request to press Reset is displayed in advance by the Reset required FB output.
Restart	The user can agree to a release via the Restart input. The request to press Restart is displayed in advance by the Restart required FB output. On starting the control, Restart is used to remove a startup lock.

1.6 Symbols/icons and writing style/spelling standard used

NOTICE	
	These are notes that provide you with information regarding particularities of a device or a software function.
WARNING	
	<p>Warning!</p> <p>A warning lets you know about specific or potential hazards. It is intended to protect you from accidents and help prevent damage to devices and systems.</p> <p>➔ Please read and follow the warnings carefully!</p> <p>Failure to do so may negatively impact the safety functions and cause a hazardous state to occur.</p>

Menus and commands

The names of software menus, submenus, options, and commands, selection fields, and windows are written in **bold font**. Example: Click on **Edit** in the **File** menu.

1.7 Copyright and right of modification

Copyright

This document is copyright-protected. The rights derived from this copyright are reserved for Leuze electronic. Reproduction of this document or parts of this document is only permissible within the limits of the statutory provision of the Copyright Act. Any modification or abridgment of the document is prohibited without the express written agreement of Leuze electronic.

Allen-Bradley, CompactBlock Guard I/O, CompactLogix, ControlFLASH, ControlLogix, DH+, FactoryTalk, FLEX, GuardLogix, Kinetix, Logix5000, MicroLogix, PanelBuilder, PanelView, PhaseManager, PLC-2, PLC-3, PLC-5, POINT I/O, POINT Guard I/O, Rockwell Automation, Rockwell Software, RSBizWare, RSFieldbus, RSLinx, RSLogix 5000, RSNetWorx, RSView, SLC, SoftLogix, Stratix, Stratix 2000, Stratix 5700, Stratix 6000, Stratix 8000, Stratix 8300, Studio 5000, Studio 5000 Logix Designer, SynchLink, and Ultra are registered trademarks of Rockwell Automation, Inc.

ControlNet, DeviceNet, and EtherNet/IP are registered trademarks of ODVA, Inc.

TwinCAT is a registered trademark of Beckhoff Automation GmbH.

EtherCAT is a registered trademark and a technology licensed by Beckhoff Automation GmbH.

Microsoft, Windows 98, Windows NT, Windows 2000, Windows XP, Windows 7, Windows 8, Windows 8.1, Windows 10 and .NET Framework are registered trademarks of the Microsoft Corporation.

Any other product or trade names listed in this manual are the trademarks or registered trademarks of the respective owners.

Subject to change.

Subject to technical changes for reasons of continued development.

2 Safety

This section is intended to support your safety and the safety of the system users.

↳ Please read this section carefully before you work with a MSI 400 system.

2.1 Proper use

The modular MSI 400 safety controller is an adjustable control for safety applications.

The control may only be operated by qualified personnel and may only be used on a machine on which it has been installed and commissioned for the first time by a qualified person in accordance with this manual.

Basic conditions for use

The modular MSI 400 safety controller may only be operated under the following conditions:

- You are operating the control within the specified areas of application.
Further information: *Areas of application of the device [chapter 2.2]*
- You are operating the control within the specified operating limits for voltage, temperature, etc.
See the following for further information: *Technical data [chapter 12]*
- You are observing personnel requirements.
Further information: *Qualified persons [chapter 2.3]*
- You are observing the special operator obligations.
Further information: *Special obligations of the operator [chapter 2.4]*

Improper use

Any other use or secondary use is deemed improper and is therefore not permitted. Any warranty claims for resulting damage made against Leuze electronic GmbH shall be deemed invalid. The risk shall be borne solely by the operator.

This also applies to any independent modifications made to the device.

2.2 Areas of application of the device

Supported standards

You can operate the MSI 400 modular safety controller in safety applications according to the following standards:

- EN 61508 up to SIL 3
- EN 61131-6 up to SIL 3
- EN 62061 up to SIL CL 3
- EN ISO 13849-1:2015 up to Performance Level e / Category 4
- EN 81-20 (only for module types MSI 4xx)
- EN 50156-1
 - The safety function must be tested at least once annually
 - A consistent redundant structure must be implemented
 - If relay expansion modules are used, the correct switching of the relays must be monitored using feedback contacts (EDM)
 - The requirements of EN 50156-1, Section 10.5.6, must be considered

The level of safety actually achieved depends on the external wiring, the implementation of the wiring, the parameterization, the selection of the command encoder, and their arrangement on the machine.

Opto-electronic and tactile safety sensors (e.g. light curtains, laser scanners, safety switches, sensors, emergency stop switches) are connected and logically linked to the modular safety controller. The corresponding actuators on the machine or systems can be securely switched off via the switch outputs of the safety controller.

Specifications for UL/CSA applications:

For UL/CSA applications, you can operate a MSI 400 safety controller under the following conditions:

- You use lines that are suitable for a temperature range of 60 to 75°C.
- You tighten the screw terminals with a torque of 5-7 lbs/in.
- You always operate the control in a Pollution Degree 2 environment.
- The modules must be supplied from an isolated, potential-free power source and a secondary power source of maximum 42.4 VDC, and safeguarded so that the maximum output of 100 VA is not exceeded. The fuse must either be UL listed or recognized according to UL 248. All power supply inputs must be connected to the same source.
- The maximum permissible total current for the MSI-EM-IO84 modules with outputs Q1 to Q4 is $I_{\text{total}} = 3.2 \text{ A}$.

NOTICE



The safety functions are not evaluated by UL. The approval corresponds to UL508, general applications.

Specifications for Ethernet connections



WARNING



Restrictions for Ethernet connections

- ↪ The Ethernet connection can only be linked to autonomous networks or demilitarized zones (DMZ).
- ↪ The device must never be connected directly to the Internet.
- ↪ Always use secure data tunnels (VPN) to exchange data via the Internet.

Specifications for domestic use

If you wish to use the MSI 400 system for domestic purposes, you need to take additional steps to prevent the emission of radio frequency interference in limit class B according to EN 55011. Here are some steps you might take:

- The use of interference suppressor filters in the supply circuit
- Installation in grounded switch cabinets or boxes

2.3 Qualified persons

The modular MSI 400 safety controller may only be installed, commissioned, and maintained by qualified persons.

Qualified persons are those who

- have suitable technical training **and**
- have been trained by the machine operator in the operation and applicable safety guidelines **and**
- have access to the operating instructions and have read and duly noted said instructions **and**
- have access to the operating instructions for the safety devices connected to the safety controller (e.g. safety light curtain) and have read them and duly noted them.

2.4 Special obligations of the operator

 WARNING	
	<p>Note the safety information and protective measures.</p> <p>Note the following points in order to ensure proper use of the MSI 400 safety controller.</p>

Duty to provide instruction

- This manual must be made available for the operator of the machine on which the MSI 400 safety controller is being used. The machine operator must be trained by qualified persons and is required to read this manual.

Compliance with standards and regulations

- Please follow the standards and guidelines valid in your country when installing and using the MSI 400 safety controller.
- The national/international legal regulations apply to the installation and use of the safety controller as well as for the commissioning and repeated technical testing, particularly the following
 - Machinery Directive 2006/42/EC
 - EMC Directive 2014/30/EU
 - Work Equipment Directive 2009/104/EC
 - Low Voltage Directive 2014/35/EU
 - Accident prevention regulations/safety rules
 - RoHS (Restriction of Hazardous Substances) Directive 2011/65/EU
- Manufacturers and operators of a machine on which a MSI 400 safety controller is being used are responsible for coordinating with the proper authorities with regard to applicable safety guidelines/rules and complying with these.

Requirements for electrical installation

- All notices, particularly the inspection notices, must be observed without fail.
Further information: *Requirements for electric installation [chapter 7.1]*
The tests must be conducted by qualified persons or by those who are personally authorized and commissioned to do so and must always be fully documented at all times by a third-party.
- The external power supply of the devices must be able to bridge a short-term power outage of 20 ms in accordance with EN 60204. Suitable PELV- and SELV-capable power packs can be obtained as accessories from Leuze electronic.
- The modules for the MSI 400 system correspond to class A, group 1, in accordance with EN 55011. Group 1 includes all ISM devices in which intentionally generated and/or wired HF power, which is required for the internal function of the device itself, occurs.

3 Product description

This section will provide you with information on the properties of the MSI 400 system and describes the setup and function.

3.1 Brief overview

MSI 400 is a modular safety controller for machine and system construction.

Basic features

- Modular structure with:
1 controller module and up to 12 input/output expansion modules, each of which has an overall width of 22.5 mm
- 16 to 116 inputs and 4 to 56 outputs
- Programmable using the MSI.designer software

Additional performance features

- Can use up to 300 standard and application-specific logical blocks
- Logic simulation
- Safe position and speed monitoring
- Connection to common industrial fieldbuses
- Online diagnostics

3.2 System setup

A MSI 400 system consists of the following modules and/or components:

- 1 Controller module
 - 1 Program removable storage
 - MSI.designer programming software
 - Up to 2 gateway modules
 - Up to 12 additional MSI-EM-IO84, MSI-EM-I8, MSI-EM-IO84NP input/output modules
 - In addition, MSI-XX expansion modules can be used. This may be, for example, the MSI-SR-SM420S standstill monitor or the relay output extensions. These modules are shown in the report from MSI.designer but cannot be logically connected to the modules of the MSI 400 system.
- Further information: Software manual, chapter ""

Examples

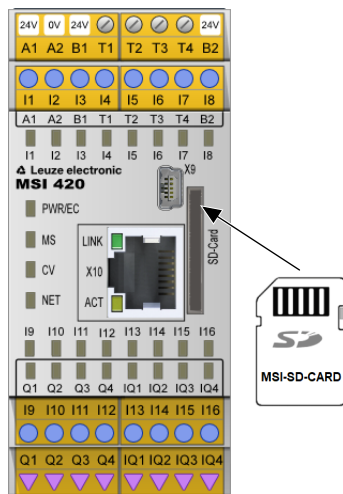


Fig. 3.1: Example of a minimum MSI 400 system setup with a MSI 420/430 controller module

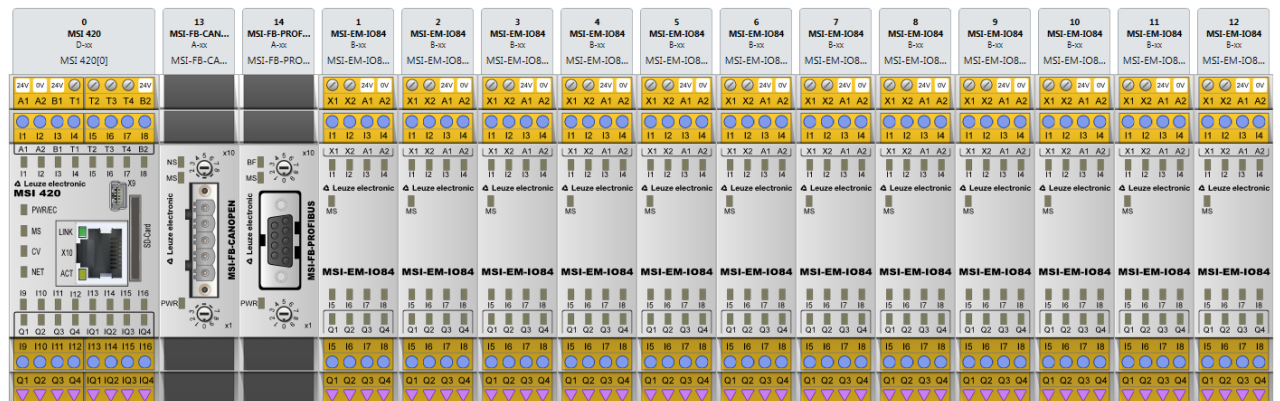


Fig. 3.2: Example 2 - Maximum expansion of a MSI 400 system

Tab. 3.1: Overview of modules (without program removable storage)

Type	Description	Inputs	Out-puts	Lo-gical blocks	Max. oc-currence
MSI 410	Controller module	20	4	300	1×
MSI 420	Controller module	16-20 ¹⁾	4-8 ¹⁾	300	1×
MSI 430	Controller module	16-20 ¹⁾	4-8 ¹⁾		
MSI-EM-IO84	Input/output expansion	8	4	—	12×
MSI-EM-I8	Input expansion	8	—	—	
MSI-EM-IO84NP	Standard input/output module	8 ¹⁾	8 ¹⁾	—	12×
MSI-FB-PROFIBUS	PROFIBUS DP gateway	—	—	—	2×
MSI-FB-CAN-OPEN	CANopen gateway	—	—	—	
MSI-FB-ETHER-CAT	EtherCAT Gateway	—	—	—	
¹⁾ Maximum of 16 safe relay outputs					

3.3 Version, compatibility, and features

There are different module versions of the controller modules that enable different station capabilities. A station capability could be the support of an extended module, a fieldbus protocol or a function library.

Tab. 3.2: Module and software versions required

Feature / functionality	Available with mod-ule version and higher	Available in module variants	MSI.designer
Secure I/O (MSI-EM-IO84 , MSI-EM-I8)	D-01.xx	All	V1.0
Non-secure I/O (MSI-EM-IO84NP)	D-01.xx	All	V1.0
EtherCAT (MSI-FB-ETHERCAT)	D-01.xx	All	V1.0
Modbus TCP	D-01.xx	MSI 430-x	V1.0
PROFINET IO	D-01.xx	MSI 430-x	V1.0
EtherNet/IP	D-01.xx	MSI 430-x	V1.0
Extended security functions	E-01.xx	All	V2.2
Press functions	G-02.xx	MSI 410-x MSI 420-x	V2.3

Info

- You can find the module version on the type plate of the modules.
- You will find the MSI.designer version in the main menu.
- The latest software version is available in the Internet at the following address www.leuze.com.
- Newer modules are backwards-compatible, which means that each module can be replaced with a module having a higher module version.
- You can find the date of manufacture for a device on the type plate in the **S/N** field in the format <Product no.>yywwnnnnn (yy = year, ww = calendar week).

3.4 Controller module

The MSI 410 controller module is a central processing unit for the entire system, in which all of the signals are monitored and logically processed according to the configuration stored in the MSI-SD-CARD (SD card) program removable storage. Please note that the application on a controller module can only start if MSI-SD-CARD is plugged in and contains a valid controller project.

Controller modules are distinguished by three categories:

- Communication: MSI 410, MSI 420, MSI 430
- Terminal type: Screw terminals spring-loaded terminals

In the following chapters, the controller modules are grouped by communication and functionality, which influence the resulting hardware.

3.4.1 Controller module MSI 410

3.4.1.1 Description

The controller modules starting with MSI 410 offer a mini-USB interface for programming, but no Ethernet.

3.4.1.2 Display elements, interfaces, and terminal description

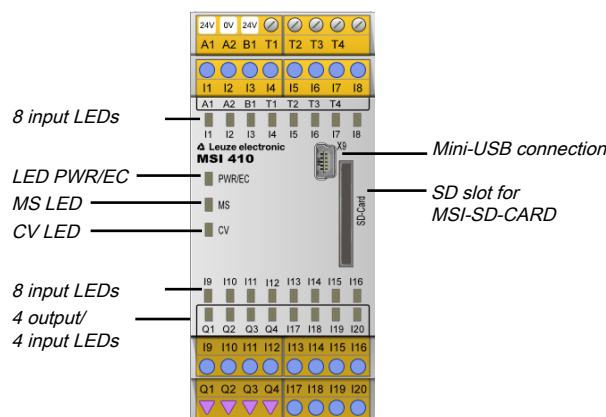


Fig. 3.3: MSI 410 display elements

Tab. 3.3: 4 LED displays

LED	Meaning
PWR/EC	Green: Display of the supply voltage state Red: Display of an error through various <i>Flashing codes</i> [chapter 10.3.1]
MS	Display of the <i>Module state</i> [chapter 10.3.1]
CV	Display of the verification state of the <i>Control project</i> [chapter 10.3.1]
I1 - I20	State display of the <i>Inputs</i> [chapter 10.3.1]
Q1 - Q4	State display of the <i>Outputs</i> [chapter 10.3.1]

Tab. 3.4: Terminal assignment MSI 410


Terminal	Assignment
A1	24 V supply voltage for all modules, except for supply of outputs
A2	GND of supply voltage
I1 - I20	Safe digital inputs
Q1 - Q4	Safe digital outputs
B1	24 V supply voltage of outputs Q1 - Q4
T1 - T4	Test signal outputs

USB interface

The controller module has a mini-USB interface with the following functions:

- Transfer of the configuration from MSI.designer to the program removable storage
- Reading of configuration from program removable storage in MSI.designer
- Diagnostics of the MSI 400 system with MSI.designer

Tab. 3.5: USB interface pin assignment

Connector/ bushing USB mini	Pin	Signal
	1	+5V
	2	- data
	3	+ data
	5	GND

NOTICE



- ↳ If the USB interface of the controller module is permanently connected, then the maximum permissible cable length is 3 m.
- ↳ Avoid using ground loops between the USB interface GND and the A2 connection of the controller module, e.g. by using USB insulators (galvanic separation). Please make sure that the PC/laptop for programming and the machine are either connected to the same power supply (same ground) or the PC/laptop is operating in battery mode.

3.4.1.3 Internal circuits

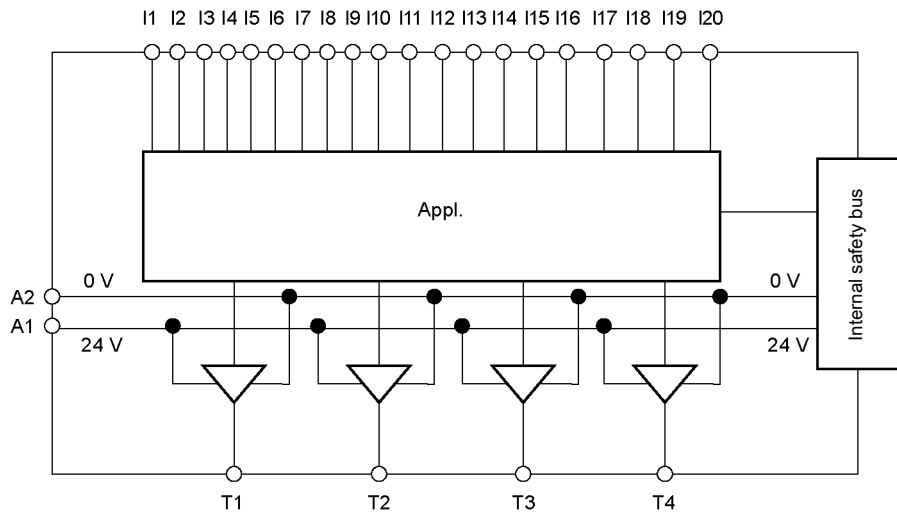


Fig. 3.4: Inputs and test outputs at an MSI 410 module

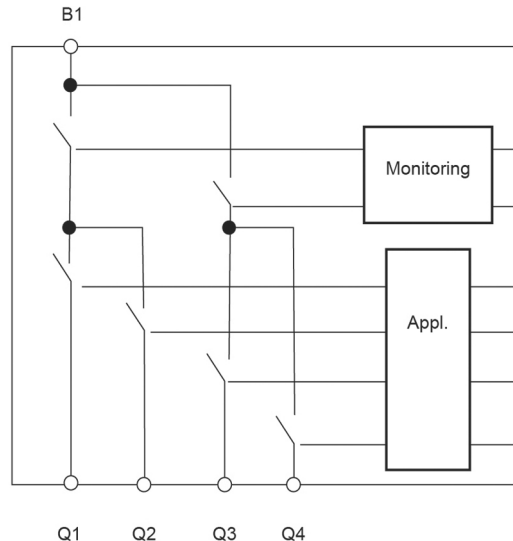






Fig. 3.5: Outputs at an MSI 410 module



3.4.1.4 Limited short-circuit detection in the input circuits



 WARNING	
	<ul style="list-style-type: none"> ↪ Short-circuits between the test signal outputs T1–T4 of a module MSI 4xx are detected as an error. ↪ Short-circuits between the test signal outputs of multiple MSI-EM-IO84NP, MSI-EM-I8 modules and MSI 4xx can only be detected when the test gaps of the test signal generators are < 4 ms and the test periods are ≥ 200 ms. Short-circuits to 24 V DC (after High) at inputs that are connected to test outputs are detected independently of the length of the test gaps. Take note of this during wiring, e.g. by using separate routing or protected lines! ↪ If the test signal outputs T1-T4 of a module MSI 4xx or X1-X8 of a MSI-EM-I8 or X1-X4 of one of several MSI-EM-IO84NP, are not wired as configured in the project, it is possible that this will not be detected as an error during normal operation. In this case, there may be cyclical switch-on and switch-off processes at the inputs. Keep this in mind during wiring and commissioning. During commissioning, use MSI.designer in the Diagnostics view to check whether the system generates error entries.

3.4.1.5 Deactivating the test pulses at the outputs

It is possible to deactivate the test pulses at one or more output pairs. The outputs of a MSI 410 module are combined into two output pairs. Q1/Q2 and Q3/Q4. The test pulses each act upon the two outputs of an output pair.

 WARNING	
	<p>Switching off the test pulses at one of the two outputs of an output switches off the test pulses of the entire output pair!</p> <p>Deactivating the test pulses at one or more safety outputs of a MSI 4xx module reduces the safety parameters of both safety outputs of the respective output pair of this module.</p> <ul style="list-style-type: none"> ↳ Take this into account in the risk analysis and risk avoidance strategy of your application. ↳ You can find more detailed information on the safety parameters here: <i>Safety technology reference values [chapter 12.2]</i>



 WARNING	
	<p>Be sure to use protected or separate cabling!</p> <ul style="list-style-type: none"> ↳ If you deactivate the test pulses at one or more safety outputs, short-circuits at other output circuits cannot be detected. This affects the safety function! ↳ In the event of a short-circuit after 24 V, it will no longer be possible to switch off the output. In addition, it will not be possible to prevent reverse current from going into a switched-off output, which will influence the capability of switching off the outputs.

 WARNING	
	<p>Carry out cyclic tests when the test pulses at one or more safety outputs are deactivated!</p> <p>If you deactivated the test pulses on one or more safety outputs, carry out the following tests once a year:</p> <ul style="list-style-type: none"> ↳ Switch off all the safety outputs without test pulses simultaneously for at least one second using the logic program of the controller module. <li style="text-align: center;">OR ↳ Restart the MSI 400 system by switching off the power supply and switching it on again.

You will thus deactivate the test pulses at an output of an MSI 410 module

- ↳ In MSI.designer, select an actuator and place it on a logic page.
- ↳ Using the right mouse button, click the actuator and select the **Properties** command in the context menu.
- ↳ Place a checkmark by **No test pulses**.
In the module overview, information about the switched off test pulses is displayed under the appropriate output (e.g. Q1: "Test pulses are deactivated!").

3.4.1.6 Single-channel use of outputs

 WARNING	
	<p>Be sure to consider a potential brief switch to high with single-channel safety outputs!</p> <p>In a single-channel configured output, an unwanted release can be switched for a maximum of 12ms in case of an error (internal error).</p> <ul style="list-style-type: none"> ↳ Consider this during your risk analysis and reduction strategy. Otherwise, there is a hazard for the operator of the machine.

3.4.2 Controller module MSI 420

3.4.2.1 Description

The controller modules starting with MSI 420 offer both a mini-USB interface and an Ethernet interface for programming, but no industrial protocols on board.

3.4.2.2 Display elements, interfaces, and terminal description

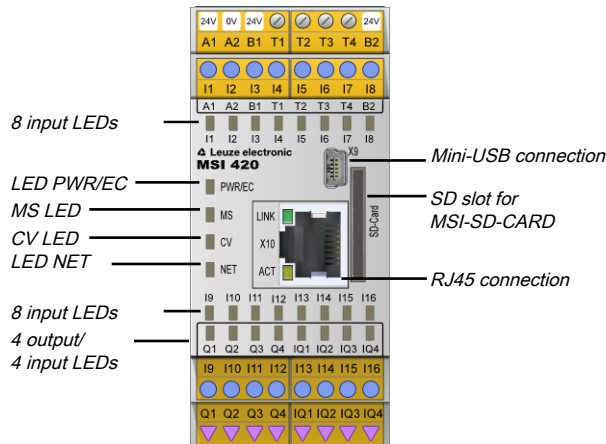


Fig. 3.6: Display elements of a MSI 420 module

Tab. 3.6: MSI 420/430 LED displays

LED	Meaning
PWR/EC	Display of the supply voltage state Display of an error through various <i>Flashing codes</i> [chapter 10.3.1]
MS	Display of the <i>Module state</i> [chapter 10.3.1]
CV	Display of the verification state of the <i>Control project</i> [chapter 10.3.1]
Input LED I1 to I16, IQ1 to IQ4	State display of the <i>Inputs</i> [chapter 10.3.1]
Output LED Q1 to Q4, IQ1 to IQ4	State display of the <i>Outputs</i> [chapter 10.3.1]

Tab. 3.7: MSI 420/430 pin assignment


Pin	assignment
A1	24 V supply voltage for all modules, except for supply of outputs
A2	GND of supply voltage
I1 - I16	Safe, digital inputs
Q1 - Q4	Safe, digital outputs
IQ1 - IQ4	Safe, digital inputs or outputs (configurable through MSI.designer)
B1	24 V supply voltage of outputs Q1 - Q4
B2	24 V supply voltage of configurable outputs IQ1 - IQ4
T1 - T4	Test signal outputs

USB interface

The controller module has a mini-USB interface with the following functions:

- Transfer of the configuration from MSI.designer to the program removable storage
- Reading of configuration from program removable storage in MSI.designer
- Diagnostics of the MSI 400 system with MSI.designer

Tab. 3.8: USB interface pin assignment

Connector/ bushing USB mini	Pin	Signal
	1	+5V
	2	- data
	3	+ data
	5	GND

NOTICE




- ↳ If the USB interface of the controller module is permanently connected, then the maximum permissible cable length is 3 m.
- ↳ Avoid using ground loops between the USB interface GND and the A2 connection of the controller module, e.g. by using USB insulators (galvanic separation). Please make sure that the PC/laptop for programming and the machine are either connected to the same power supply (same ground) or the PC/laptop is operating in battery mode.

Ethernet interface

The controller module has an Ethernet interface with the following functions:

- Transfer of the configuration from MSI.designer to the program removable storage
- Reading of configuration from program removable storage in MSI.designer
- Diagnostics of the MSI 400 system with MSI.designer
- Continuous diagnosis of the MSI 400 system via a connected PLC

Tab. 3.9: RJ 45 bushing pin assignment

Connector/bushing RJ45	Pin	Signal (Auto MDI-X)
	1	RD+ / TD+
	2	RD- / TD-
	3	TD+ / RD+
	6	TD- / RD-

The device automatically detects which cable type (patch cable or cross-link cable) is being used (Auto MDI-X), which is why the pin assignment does not matter with regard to the RD or TD signals.

3.4.2.3 Internal circuits

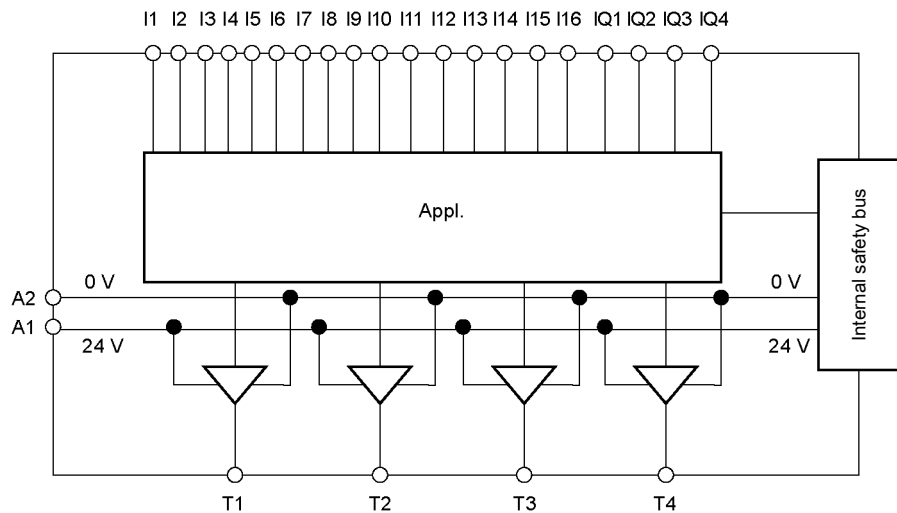


Fig. 3.7: Inputs and test pulses at an MSI 420 module

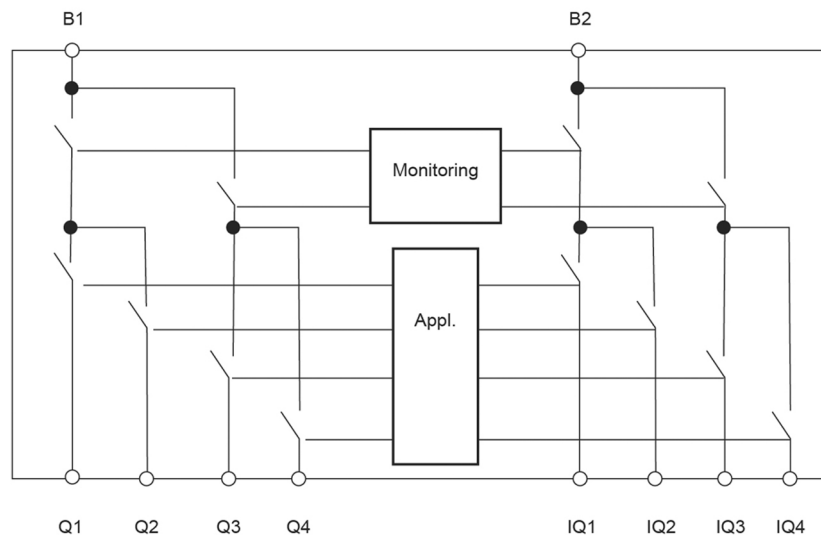








Fig. 3.8: Outputs at an MSI 420/430 module

3.4.2.4 Limited short-circuit detection in the input circuits

 WARNING	
	<ul style="list-style-type: none"> ↪ Short-circuits between the test signal outputs T1–T4 of a module MSI 4xx are detected as an error. ↪ Short-circuits between the test signal outputs of multiple MSI-EM-IO84NP, MSI-EM-I8 modules and MSI 4xx can only be detected when the test gaps of the test signal generators are < 4 ms and the test periods are ≥ 200 ms. Short-circuits to 24 V DC (after High) at inputs that are connected to test outputs are detected independently of the length of the test gaps. Take note of this during wiring, e.g. by using separate routing or protected lines! ↪ If the test signal outputs T1–T4 of a module MSI 4xx or X1–X8 of a MSI-EM-I8 or X1–X4 of one of several MSI-EM-IO84NP, are not wired as configured in the project, it is possible that this will not be detected as an error during normal operation. In this case, there may be cyclical switch-on and switch-off processes at the inputs. Keep this in mind during wiring and commissioning. During commissioning, use MSI.designer in the Diagnostics view to check whether the system generates error entries.

3.4.2.5 Deactivating the test pulses at the outputs



It is possible to deactivate the test pulses at one or more output pairs. The outputs are combined into four output pairs with the MSI 420/430: Q1/Q2, Q3/Q4, IQ1/IQ2, and IQ3/IQ4. The test pulses each act upon the two outputs of an output pair.

 WARNING	
	<p>Switching off the test pulses at one of the two outputs of an output switches off the test pulses of the entire output pair!</p> <p>Deactivating the test pulses at one or more safety outputs of a MSI 4xx module reduces the safety parameters of both safety outputs of the respective output pair of this module.</p> <ul style="list-style-type: none"> ✎ Take this into account in the risk analysis and risk avoidance strategy of your application. ✎ You can find more detailed information on the safety parameters here: <i>Safety technology reference values [chapter 12.2]</i>
	<p>Be sure to use protected or separate cabling!</p> <ul style="list-style-type: none"> ✎ If you deactivate the test pulses at one or more safety outputs, short-circuits at other output circuits cannot be detected. This affects the safety function! ✎ In the event of a short-circuit after 24 V, it will no longer be possible to switch off the output.
 WARNING	
	<p>Carry out cyclic tests when the test pulses at one or more safety outputs are deactivated!</p> <p>If you deactivated the test pulses on one or more safety outputs, carry out the following tests once a year:</p> <ul style="list-style-type: none"> ✎ Switch off all the safety outputs without test pulses simultaneously for at least one second using the logic program of the controller module. OR ✎ Restart the MSI 400 system by switching off the power supply and switching it on again.

How to deactivate the test pulses at an output of an MSI 420/430 module:

- ✎ Connect an output element to the MSI 4xx module.
- ✎ Using the right mouse button, click on the output element and select the **Edit...** command in the context menu.
- ✎ Deactivate the **Activation of test pulses of this output** option.
The test pulses of this output will be switched off. A corresponding note will be displayed in the hardware configuration area under the respective MSI 4xx module.

3.4.2.6 Single-channel use of outputs

 WARNING	
	<p>Be sure to consider a potential brief switch to high with single-channel safety outputs!</p> <p>In the event of an internal hardware error, single-channel safety outputs can switch to high once for 10 ms after the error has been detected.</p> <ul style="list-style-type: none"> ✎ Consider this during your risk analysis and reduction strategy. Otherwise, there is a hazard for the operator of the machine.

3.4.3 Controller module MSI 430

3.4.3.1 Description

Controller module MSI 430 has the same functionality and has the same connections and the same displays as the MSI 420 controller module.

Additionally, this controller module has the following industry protocols on board:

- Modbus/TCP interface
- PROFINET IO interface
- EtherNet/IP interface

3.4.3.2 Display elements, error codes, and terminal description

The displays of the MS and CV LEDs as well as the terminal assignment of the USB and Ethernet interface are identical to those of the MSI 420 controller module.

Further information: *Display elements, interfaces, and terminal description [chapter 3.4.2.2]*



3.5 MSI-SD-CARD removable storage

3.5.1 Description

The system configuration of the entire MSI 400 system is stored in the MSI-SD-CARD program removable storage. This has the advantage that the MSI 400 system does not have to be reconfigured when modules are replaced.

The MSI-SD-CARD removable storage is an SD card that is produced and formatted specially for use in the controller modules.

Important notes

NOTICE	
	↪ The data stored in the MSI-SD-CARD program removable storage will be retained even if the supply voltage is interrupted.
	↪ When replacing a module, make sure that the program removable storage is inserted into the appropriate controller module. Mark all of the connection lines and plug connectors on the MSI 400 clearly to prevent mix-ups.
	↪ Commonly available SD cards cannot be used/inserted in MSI 400 and controller modules.
	↪ The user must not delete or modify the data on the second partition of the SD card.
	↪ The replacement of a verified user project can be recognized by the entry of the diagnostic number 24230000.
WARNING	
	↪ After the user project is transferred to the SD card and the user project has been replaced by substituting the SD card, the correct function of the safety application must be checked.
	↪ Make sure that the SD card cannot be replaced by authorized personnel. You are welcome to inquire about the possibilities for "Enhanced security". For more information, refer to the software manual, chapter "Protect project from manipulation (extended security function)".

3.5.2 Files on the removable storage

The following table explains the significance of the files on the removable storage MSI-SD-CARD.

Tab. 3.10: Files on MSI-SD-CARD

File name	Function	Reading...	Writing...
config.yaml	Basic configuration of the communication (device name, TCP/IP configuration etc.)	... at device start. and ... in MSI.designer in the configuration dialog of the controller (Properties docking window) if you click Control configuration Send with the basic data before the initial delivery. and ... in MSI.designer in the configuration dialog of the controller (Properties docking window) if you click Control configuration Send . and ... when sending new data from a PLC via PROFINET IO or EtherNet/IP.
HISTORY.CSV	Non-volatile storage of diagnostics and error entries	... from MSI.designer for the Diagnostics view.	... for a new diagnostic or error event. and ... in the Diagnostics view of MSI.designer click on the Delete button ²⁾ .
PROJECT.XML	Project file, user program	... at device start. and ... when establishing a connection with MSI.designer. and ... before verifying a project.	... when sending a project e.g. from MSI.designer (independent of the selection in connection dialog) ³⁾ . and ... while verifying a project.
¹⁾ Details in software manual, "Diagnostic view" section ²⁾ Details in software manual, "Reference of commands and features" table ³⁾ Details in software manual, "Connect with the safety controller" chapter			

The contents of the **config.yaml** file is changed by MSI.designer, from a PLC via PROFINET IO or EtherNet/IP or directly by the user by the use of an SD card reader. In which the data format **yaml** (Yet Another Markup Language) is to be retained.

The following table describes the function of selected elements.

Tab. 3.11: Significance of the content of the config.yaml file

Section	Function	Value range
ident:name:	Device name, station name	Character string without the '#', ':' characters
ethernet:dhcp:	DHCP client activation	yes no
ethernet:ip:	IPv4 address of the device	0.0.0.1 to 223.255.255.254 and not 127.0.0.1
ethernet:mask:	IPv4 network mask	255.0.0.0 to 255.255.255.253
ethernet:gw:	IPv4 gateway	0.0.0.0 or 0.0.0.1 to 223.255.255.254 and not 127.0.0.1
ethernet:multicast:	IPv4 Multicast membership for the device search by MSI.designer	224.0.0.0 0.0.0.0
ethernet:tool:	Communication with MSI.designer is optionally deactivatable	yes no
usb:vcom:	USB interface activation	yes no

If the DHCP Client is activated, the device searches for a DHCP server for approx. 1 minute. If a DHCP server does not respond correctly, the IPv4 data in the config.yaml file for the device is activated.

The user must not delete or modify undocumented data elements in the config.yaml file.

3.6 MSI-EM-IO84 input/output expansion module

3.6.1 Description




The MSI-EM-IO84 module is an input/output expansion with eight safe inputs and four safe outputs, as well as two test outputs X1 and X2.

The MSI-EM-IO84 module offers the following functions:

- Monitoring of connected safety devices
For further information: *Connecting devices [chapter 4]*
- Forwarding of input information to the controller module
- Receipt of control signals from the controller module and corresponding actuation of outputs
- Fast shut-off: Direct switch-off of the actuators connected on the module. This considerably reduces the response time of the outputs if they are controlled by inputs of the same module. Only 8 ms are added to the response times of the actuators to switch off the outputs. The execution times on the internal safety bus and the logic do not play any role in this case.
Further information: *Response times for basic safety functions [chapter 12.1]*
- Activating or deactivating test pulses at the outputs (Q1–Q4) with build state B-xx (firmware version V2.00.0) and higher.

The MSI-EM-IO84 module cannot be operated alone; it always requires an MSI 4xx controller module (see "MSI.designer" programming software).

It is possible to use multiple MSI-EM-IO84 modules simultaneously (see *System setup [chapter 3.2]*). The voltage of the internal logic and the test outputs is supplied via the system connector and the internal safety bus. The voltage of the Q1–Q4 outputs of the MSI-EM-IO84 must be supplied directly via A1/A2 at the respective module.

 WARNING	
	<p>Limited short-circuit detection in the input circuits</p> <ul style="list-style-type: none"> ↪ One MSI-EM-IO84 module has two test signal generators, X1 and X2. ↪ Short-circuits between test signal generators of a MSI-EM-I8 or MSI-EM-IO84 module are detected. Between different modules the short circuit detection is then only ensured if the test gaps of the test signal generators are < 4 ms and the test periods ≥ 200 ms. Short-circuits to 24 V DC (after High) at inputs that are connected to test outputs are detected independently of the length of the test gaps. <p>Take note of this during wiring (e.g. by using separate routing or protected lines)!</p>
NOTICE	
	<ul style="list-style-type: none"> ↪ The LEDs of inputs I1 to I8 indicate the state of the inputs at an update interval of about 64 ms.

3.6.2 Display elements and terminal assignment

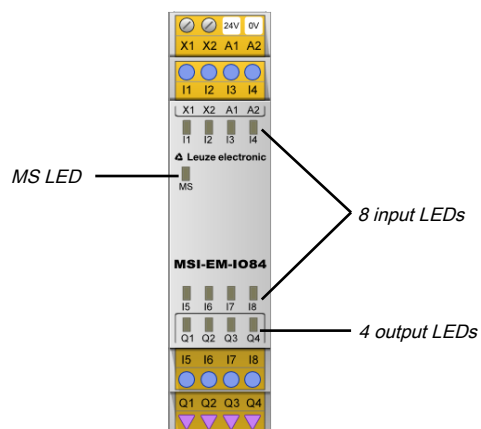


Fig. 3.9: Display elements of the MSI-EM-IO84 module

Flashing codes

Further information: *Device state and LED displays in the safe input/output modules [chapter 10.3.2]*

Terminal assignment

Tab. 3.12: MSI-EM-IO84 terminal assignment reference

Terminal	Assignment
X1/X2	Test output 1 / test output 2
I1–I4	Inputs 1 to 4
A1	24V
A2	GND
I5–I8	Inputs 5 to 8
Q1–Q4	Outputs 1 to 4

3.6.3 Internal circuits

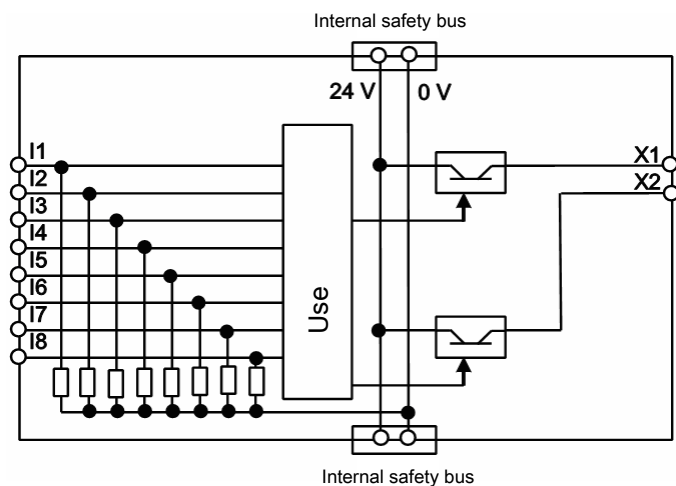


Fig. 3.10: Internal circuits of the MSI-EM-IO84 module: Safe inputs and test outputs

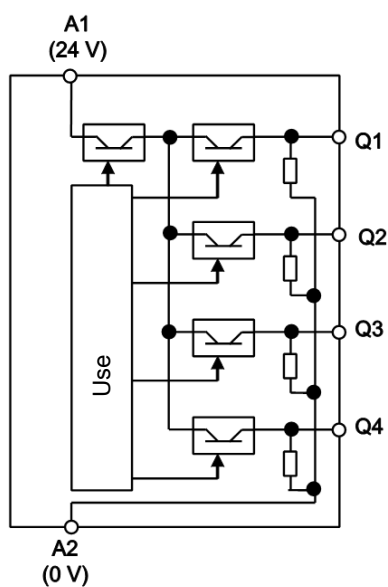








Fig. 3.11: Internal circuits of the MSI-EM-IO84 module: Safety outputs

3.6.4 Deactivating the test pulses at the outputs

With build state B-xx (firmware version V2.00.0) and higher, it is possible to deactivate the test pulses at one or more outputs of MSI-EM-IO84 modules.

 WARNING	
	<p>Deactivating the test pulses at any output reduces the safety parameters of all outputs!</p> <p>Deactivation of the test pulses on one or more safety outputs of a module MSI-EM-IO84 reduces the safety parameters of all safety outputs Q1...Q4 of this module.</p> <ul style="list-style-type: none"> ↳ Take this into account to ensure that your application corresponds to a reasonable risk analysis and avoidance strategy. ↳ You can find more detailed information on the safety parameters here: <i>Technical data [chapter 12]</i>



 WARNING	
	<p>Be sure to use protected or separate cabling!</p> <ul style="list-style-type: none"> ↳ If you deactivate the test pulses at one or more safety outputs, short-circuits at other output circuits cannot be detected. This affects the safety function! ↳ In the event of a short-circuit after 24 V, it will no longer be possible to switch off the output. Furthermore, it will not be possible to prevent reverse current from going into a switched-off output, which will influence the capability of switching off the outputs.

 WARNING	
	<p>Carry out cyclic tests when the test pulses at one or more safety outputs are deactivated!</p> <p>If you deactivated the test pulses on one or more safety outputs, carry out the following tests once a year:</p> <ul style="list-style-type: none"> ↳ Switch off all the safety outputs without test pulses simultaneously for at least one second using the logic program of the controller module. OR ↳ Restart the MSI 400 system by switching off the power supply and switching it on again.

You will thus deactivate the test pulses at an output of an MSI-EM-IO84 module:

- ↳ Connect an output element to the MSI-EM-IO84 module.
- ↳ Using the right mouse button, click on the output element and select the **Edit...** command in the context menu.
- ↳ Deactivate the **Activation of test pulses of this output** option.
The test pulses of this output will be switched off. A corresponding note will be displayed in the hardware configuration area under the respective MSI-EM-IO84 module.

3.6.5 Single-channel use of outputs

 WARNING	
	<p>Be sure to consider a potential brief switch to high with single-channel safety outputs!</p> <p>In the event of an internal hardware error, single-channel safety outputs (Q1 to Q4) can switch to high once for 10 ms after the error has been detected. Consider this during your risk analysis and reduction strategy. Otherwise, there is a hazard for the operator of the machine.</p>

3.7 MSI-EM-I8 input expansion module



3.7.1 Description

The MSI-EM-I8 module is an input expansion with eight safe inputs. It fulfills the following tasks:

- Monitoring of connected sensors
For further information: *Connecting devices [chapter 4]*
- Forwarding of input information to the controller module

The MSI-EM-I8 module cannot be operated alone and always requires an MSI 4xx controller module (see "MSI.designer" programming software).

It is possible to use multiple MSI-EM-I8 modules simultaneously (see *System setup [chapter 3.2]*). The voltage of the internal logic and the test outputs is supplied via the program removable storage device and the internal safety bus.

 WARNING	
	<p>Limited short-circuit detection in the input circuits</p> <ul style="list-style-type: none"> ↳ One MSI-EM-I8 module has two test signal generators. One test signal generator is responsible for the odd-numbered test outputs (X1, X3, X5, and X7), while the other is responsible for the even-numbered test outputs (X2, X4, X6, and X8). ↳ Short-circuits between test signal generators of a MSI-EM-I8 or MSI-EM-IO84 module are detected. Between different modules the short circuit detection is then only ensured if the test gaps of the test signal generators are < 4 ms and the test periods ≥ 200 ms. Short-circuits to 24 V DC (after High) at inputs that are connected to test outputs are detected independently of the length of the test gaps. ↳ Please ensure that the odd-numbered test outputs (X1, X3, X5, and X7) at the MSI-EM-I8 are connected to a common test signal generator and that the even-numbered test outputs (X2, X4, X6, and X8) are connected to another common test signal generator. Therefore, short-circuits between the odd-numbered test outputs (X1, X3, X5, and X7) cannot be detected. The same applies accordingly to the even-numbered test outputs X2, X4, X6, and X8. Make note of this during wiring (e.g. through separate routing or protected lines)!

3.7.2 Display elements and terminal assignment

NOTICE

i

↪ The LEDs of inputs I1 to I8 indicate the state of the inputs at an update rate of about 64 ms.

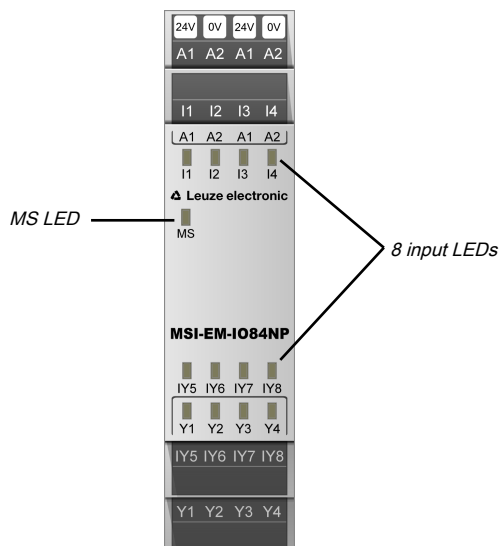


Fig. 3.12: Display elements on the MSI-EM-I8 module

Flashing codes

Further information: *Device state and LED displays in the safe input/output modules [chapter 10.3.2]*

Terminal assignment

Tab. 3.13: Terminal assignment reference of the MSI-EM-I8 module

Terminal	Assignment
X1/X3	Test signal 1
X2/X4	Test signal 2
I1 – I4	Inputs 1 to 4
I5 – I8	Inputs 5 to 8
X5/X7	Test signal 1
X6/X8	Test signal 2

3.7.3 Internal circuits

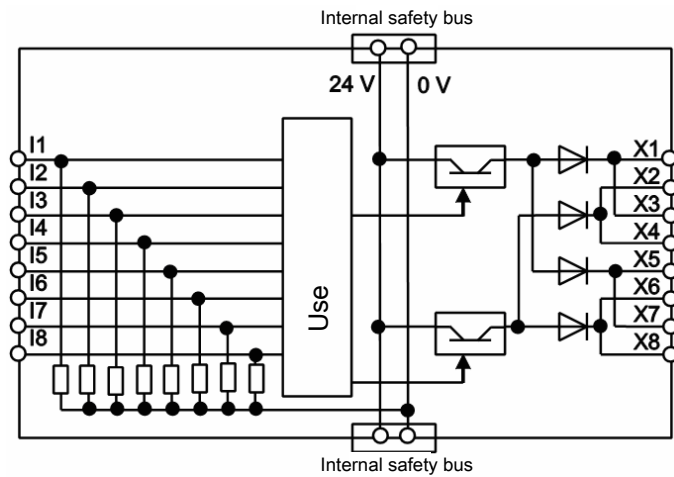


Fig. 3.13: Internal circuits of the MSI-EM-I8 module: Safety inputs and test outputs

3.8 MSI-EM-IO84NP input/output expansion module

3.8.1 Description

The MSI-EM-IO84NP module is an input/output expansion with 4 non-secure inputs, 4 non-secure outputs and 4 non-secure input/output combinations whose function is configured using the MSI.designer software.

The MSI-EM-IO84NP module offers the following functions:

- Monitoring of connected devices and sensors
For further information: *Connecting devices [chapter 4]*
- Forwarding of input information to the controller module
- Receipt of control signals from the controller module and corresponding switching of outputs

The MSI-EM-IO84NP module cannot be operated alone; it always requires an MSI 4xx controller module (see "MSI.designer" programming software).

It is possible to use multiple MSI-EM-IO84NP modules simultaneously (see *System setup [chapter 3.2]*). The voltage of the internal logic is supplied via the system connector and the internal safety bus. The voltage of the Y1–Y4 and IY5–IY8 outputs of the MSI-EM-IO84NP must be supplied directly via A1/A2 at the respective module.

Refresh rate

The LEDs of the I1–I4 inputs and the Y1–Y4 outputs or the inputs/outputs IY5–IY8 combination show the state with a refresh rate of approx. 4 ms.

Restricted selection of inputs

Only the single-channel inputs are available to be selected in the configuration for the MSI-EM-IO84NP expansion module, for example:

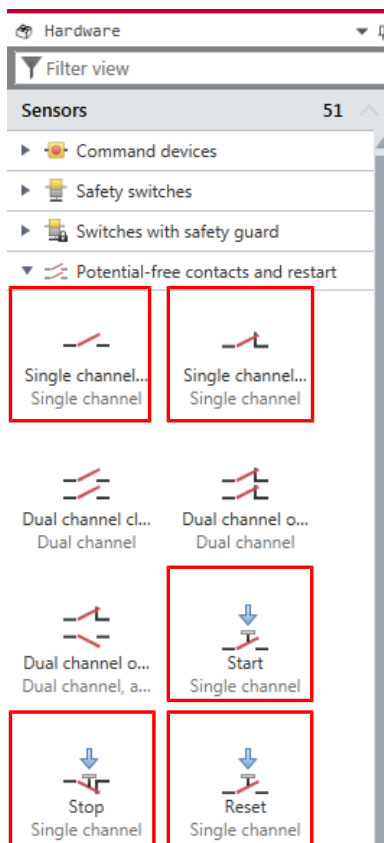


Fig. 3.14: single-channel inputs for the MSI-EM-IO84NP expansion module

3.8.2 Display elements and terminal assignment

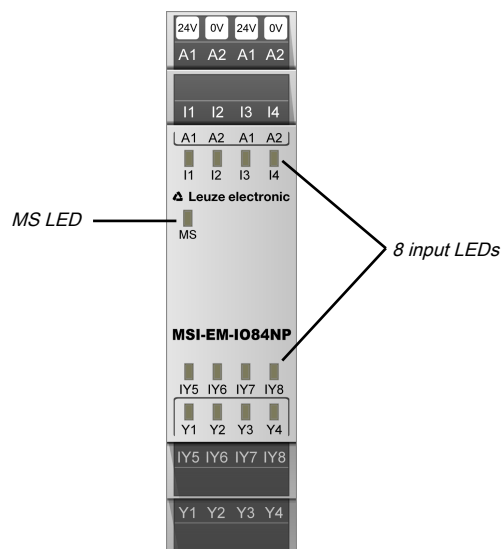


Fig. 3.15: Display elements of the MSI-EM-IO84NP module

Flashing codes

Further information: *Device state and LED displays in the standard input/output modules [chapter 10.3.3]*

Terminal assignment

Tab. 3.14: MSI-EM-IO84NP terminal assignment reference

Terminal	Assignment
A1	24V
A2	GND
I1–I4	non-secure inputs 1 to 4
IY5–IY8	non-secure inputs/outputs combination 5 to 8
Y1–Y4	non-secure outputs 1 to 4

3.8.3 Internal circuits

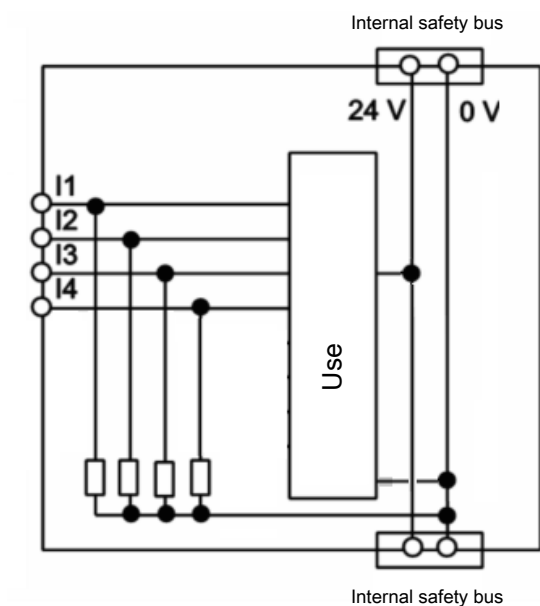


Fig. 3.16: Internal switching circuit of the MSI-EM-IO84NP module: non-secure inputs

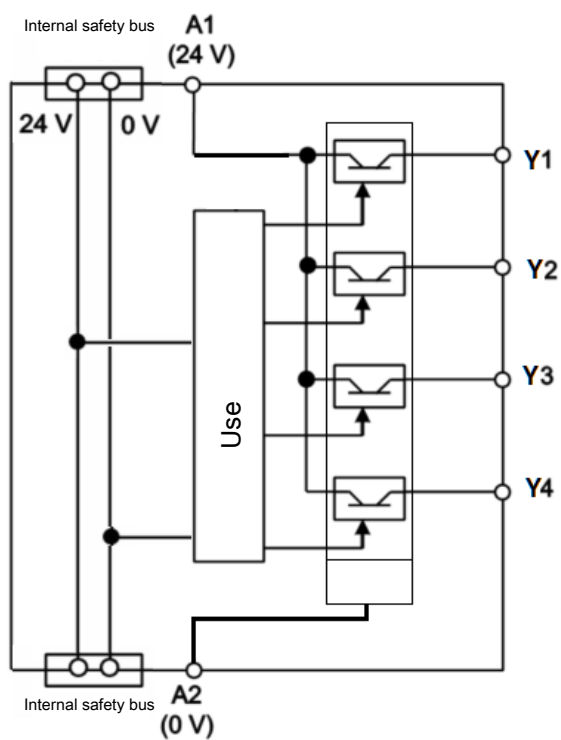


Fig. 3.17: Internal switching circuit of the MSI-EM-IO84NP module: non-secure outputs

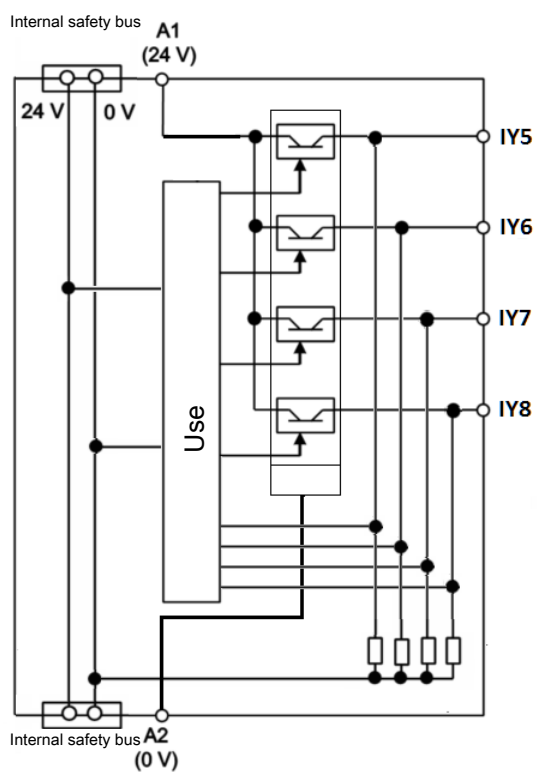


Fig. 3.18: Internal switching circuit of the MSI-EM-IO84NP module: non-secure inputs/outputs combination



WARNING



Use of the IY5–IY8 inputs/outputs

When using the combination connections as input, the signal input voltage to IY5–IY8 may never be greater than the supply voltage to A1/A2.

4 Connection of sensors and actuators







This section describes the connection of safety sensors and actuators to the MSI 400 system and provides setup information for selected functions.

The MSI 400 system supports applications up to Performance Level PL e (as per EN ISO 13849-1) and up to Safety Integrity Level SIL CL3 (as per EN 62061).

The level of safety actually achieved depends on the external wiring, the implementation of the wiring, the parameterization, the selection of the safety sensors, and their arrangement on the machine. To this end, consider all of the required boundary conditions and evaluate them, for example, in a Failure Modes and Effects Analysis (FMEA).

You can find additional information to be noted during the electrical installation here: *Electrical installation [chapter 7]*

Important notes

 WARNING	
	<p>Loss of safety function due to incorrect configuration!</p> <p>The configuration must be carefully planned and executed!</p> <p>The configuration of the safety application must be precisely adapted to the circumstances of the system or machine to be monitored.</p> <ul style="list-style-type: none"> ↪ Check to ensure that the configured safety application monitors the machine or system as you have planned and whether the safety of a configured application is being ensured at all times. This must be ensured in all operating modes and for all sub-applications. Document the results of this test! ↪ Be sure to note the instructions for commissioning and daily testing in the operating instructions for the safety equipment integrated into the safety application. ↪ Note the warning information and function descriptions for the safety equipment connected to the safety controller! When in doubt, contact the respective manufacturer of the safety equipment. ↪ Note that the minimum switch-off time of the connected sensors must be greater than the execution time of the logic (see software handbook, Time values and logic execution time). In this way, you will ensure that the MSI 400 system can detect the switching of sensors. The minimum switch-off time of sensors is typically listed in the technical data for the sensors.
	<p> WARNING</p>
	<p> Parallel connection of inputs</p> <p>The inputs must always be connected in parallel, except for inputs I13 to I16. These must not be connected in parallel, neither to one another nor to other inputs.</p>
	<p> WARNING</p>
	<p>Protect single-channel inputs against short-circuits and cross-connections!</p> <p>When a short-circuit to high occurs at a single-channel input with test pulses that were previously low, this signal can then look like a pulse for the logic. A short-circuit to high means that the signal is first to high and then is back to low after the error detection time. A pulse can be generated due to the error detection.</p> <p>Because of this, note the following specifications for single-channel signals with test pulses:</p>

- If the short-circuit to high occurs at a single-channel input with test pulses that was previously high, this signal for the logic then looks like a delayed falling edge (transition from high to low).









- This must be noted in particular for the following inputs:**



4.1 Safety command devices and electromechanical safety switches

4.1.1 Emergency stop button

Tab. 4.2: Connection of safety command devices

Electrical connection: Example from MSI.designer					
Single-channel, without testing	24V		I1		Contact between 24 V and I1
Single-channel, with testing	T2		I2		Contact between T2 and I2
Two-channel, without testing	24V		I3 I4		Channel 1: Contact between 24 V and I3 Channel 2: Contact between 24 V and I4
Two-channel, with test- ing	T1 T2		I5 I6		Channel 1: Contact between T1 and I5 Channel 2: Contact between T2 and I6

The pre-configured two-channel emergency stop buttons in MSI.designer have equivalent switching contacts. In order to implement two-channel complementary switching contacts, you can find corresponding elements in the element window under the group of potential-free contacts.

Tab. 4.3: Features

Function	Info
Testing	Possible
Series connection/ cascading	Max. number of emergency stop buttons switched in series: note max. line resistance of 100 Ω
Synchronous time	4 ms to 30 s or deactivated









NOTICE



You can find additional information in the operating instructions for the ESB200 emergency stop button.





4.1.2 Electromechanical safety switch without lock

Tab. 4.4: Electromechanical safety switch connection

Electrical connection: Example from MSI.designer					
Single-channel, without testing	24V		I1		Contact between 24 V and I1
Single-channel, with testing	T2		I2		Contact between T2 and I2
Two-channel, without testing	24V		I3 I4		Channel 1: Contact between 24 V and I3 Channel 2: Contact between 24 V and I4
Two-channel, with testing	T1 T2		I5 I6		Channel 1: Contact between T1 and I5 Channel 2: Contact between T2 and I6

4.1.3 Electromechanical safety switch with lock

Tab. 4.5: Connection of locks

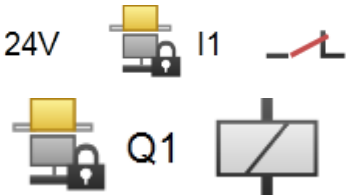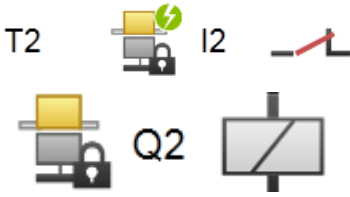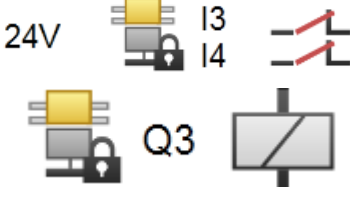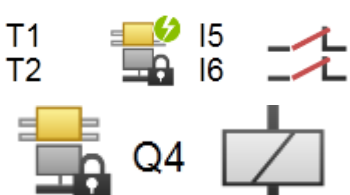Electrical connection: Example from MSI.designer		
Single-channel, without testing		<p>Contact between 24 V and I1</p> <p>Inductor at Q1</p>
Single-channel, with testing		<p>Contact between T2 and I2</p> <p>Inductor at Q2</p>
Two-channel, without testing		<p>Channel 1: Contact between 24 V and I3</p> <p>Channel 2: Contact between 24 V and I4</p> <p>Inductor at Q3</p>
Two-channel, with testing		<p>Channel 1: Contact between T1 and I5</p> <p>Channel 2: Contact between T2 and I6</p> <p>Inductor at Q4</p>

Tab. 4.6: Functions with electromechanical safety switches and locks

Function	Info
Testing	Possible
Series connection/cascading	The max. number of emergency stop buttons switched in series is determined by the max. line resistance of 100 Ω.
Synchronous time	4 ms to 30 s or deactivated







NOTICE



You can find additional information in the operating instructions for the electromechanical safety switches.

4.1.4 Enable switch

Tab. 4.7: Enable switch connection

Electrical connection: Example from MSI.designer				
2 positions, without testing	24V		I1 I2	NC 1: between 24 V and I1 NC 2: between 24 V and I2
2 positions, with testing	T1 T2		I3 I4	NC 1: between T1 and I3 NC 2: between T2 and I4
3 positions, without testing	24V		I1 I2	NC 1: between 24 V and I1 NC 2: between 24 V and I2
	24V		I3 I4	NO 1: between 24 V and I3 NO 2: between 24 V and I4
3 positions, with testing	24V		I5 I6	NC 1: between 24 V and I5 NC 2: between 24 V and I6
	T1 T2		I7 I8	NO 1: between T1 and I7 NO 2: between T2 and I8

Tab. 4.8: Features

Function	Info
Testing	Possible
Series connection	Not possible
Synchronous time	4 ms to 30 s or deactivated







NOTICE



You can find additional information in the operating instructions for the respective devices.

4.1.5 Two-hand control

Tab. 4.9: Two-hand control connection

Electrical connection: Example from MSI.designer				
Type IIIA, without testing	24V		I1	Channel 1: Contact between 24 V and I1
	24V		I2	Channel 2: Contact between 24 V and I2
Type IIIC, without testing	24V		I5	NC (normally closed contact) between 24 V and I5 (I7)
	24V		I6	NO (normally open contact) between 24 V and I6 (I8)
	24V		I7	
	24V		I8	

4.1.5.1 Type IIIA

With type IIIA, two equivalent inputs (make NC contacts for both two-hand buttons) are monitored.

A valid input signal is only generated when the ON state (H level) is present at both inputs within a time of 0.5 seconds (synchronous change, both two-hand buttons actuated) and both were previously in the OFF state (L level).

4.1.5.2 Type IIIC

With type IIIC, two pairs of equivalent inputs (NC (normally closed contact)/NO (normally open contact) contact pairs for both two-hand buttons) are monitored.

A valid input signal is only generated when the ON state (H/L level) is present at both inputs within a time of 0.5 seconds (synchronous change, both two-hand buttons actuated) and both were previously in the OFF state (L/H level).





NOTICE



You can find additional information in the operating instructions for two-hand control.

4.1.6 Safety mats and bumper

Tab. 4.10: Safety mat connection

Electrical connection: Example from MSI.designer					
Short-circuit-forming safety mat in 4-conductor technology, at test output	T1 T2		I1 I2		Channel 1: Contact between T1 and I1
					Channel 2: Contact between T2 and I2
Short-circuit-forming multi-safety mat in 4-conductor technology, at test output	T1 T2		I3 I4		Channel 1: Contact between T1 and I3
					Channel 2: Contact between T2 and I4

Tab. 4.11: Function of safety mats

Function	Info
Parallel connection	Possible
Series connection	Possible

Switch-off conditions



WARNING



Make sure that the switch-off condition is sufficient!


The actuation period for safety mats and bumper must be at least twice as high as the maximum value for the "test period" of both test outputs used in order to ensure that the switch-off condition will be detected and that a sequencing error will not occur.


NOTICE



You can find additional information in the operating instructions for the safety mats.

Test periods and response times

 **WARNING**



Changed reaction times!

From build state D-03.01 of the MSI 4xx modules and B-08 of the MSI-EM-IO84 modules, the longer response times given in the table below apply.

In particular, for existing projects with sensor elements for safety mats and bumpers, this extension of the response times must be adhered to (e.g. in the case of replacement of a MSI 4xx module).









Tab. 4.12: Test periods and response times

Test periods for both test outputs [ms] ¹		Resulting additional response time [ms]	
Test output 1	Test output 2	MSI-EM-IO84 (to B-07) MSI 4xx (to D-01.xx)	MSI-EM-IO84 (from B-08) MSI 4xx (from D-03.xx)
40	40	20	40
40	200–1000	40	80
200	200	100	200
200	400–1000	200	400
400	400	300	400
400	600 800–1000	400 400	600 800
600	600	500	600
600	800 1000	600	800 1000
800	800	700	800
800	1000	800	1000
1000	1000	900	1000
¹ Obtain the values from the report in MSI.designer.			


4.1.7 Connection of multiple safety mats/bumpers

When multiple safety mats/bumpers are used to improve diagnosis, it may be wise to decouple the test pulse outputs.

4.1.8 Operation mode selection switch

Electrical connection: Example from MSI.designer					
Operating mode selection switch (1 from 2) to 24 V	24V		I1		Channel 1: Contact between 24 V and I1
	24V		I2		Channel 2: Contact between 24 V and I2
Operating mode selection switch (1 from 2) to test output	T1		I3		Channel 1: Contact between T1 and I3
	T2		I4		Channel 2: Contact between T2 and I4

Function	Info
Testing	Possible

NOTICE	
	<ul style="list-style-type: none"> Operating mode selection switches without test pulses enable 2 to 8 operating modes; operating mode selection switches with test pulses enable 2 to 4 operating modes. When wiring the tested operating mode selection switches, note that when using an odd-numbered test output (e.g. T1, T3 ... or X1, X3 ...), odd-numbered inputs (e.g. I1, I3, I5 ...) must be used; when using an even-numbered test output (e.g. T2, T4 ... or X2, X4 ...), even-numbered inputs (e.g. I2, I4, I6 ...) must also be used. You can find additional information in the operating instructions for the operating mode selection switches.

4.1.9 Potential-free contacts

The MSI.designer software provides a series of potential-free contacts for "free" designing of contact elements. In this manner, you can implement different NO (normally open contact)/NC (normally closed contact) combinations with and without testing. In addition, there are elements for a start and stop button, reset button, and device monitoring (EDM).

Tab. 4.13: Function of potential-free contacts

Function	Info
Testing	Possible
Series connection	Possible
Discrepancy time	Further information: Software manual

4.2 Contactless safety sensors

4.2.1 Magnetic safety switches

4.2.1.1 Magnetic safety switches with equivalent inputs

Tab. 4.14: Connection of magnetic safety switches with equivalent inputs

Electrical connection: Example from MSI.designer		
With testing	<div> <div>T1 T2</div> <div>I3 I4</div> </div>	Channel 1: Contact between T1 and I3 Channel 2: Contact between T2 and I4

4.2.1.2 Magnetic safety switches with complementary inputs

Tab. 4.15: Connection of magnetic safety switches with antivalent inputs

Electrical connection: Example from MSI.designer		
With testing	<div> <div>T1 T2</div> <div>I1 I2</div> </div>	NO contact between T1 and I1 NC contact between T2 and I2

Tab. 4.16: Functions with magnetic safety switches

Function	Info
Testing	Possible
Series connection/ cascading	Possible, note max. line resistance of 100 Ω and correct setting of test pulse time
Synchronous time	Preset at 1500 ms





NOTICE



You can find additional information in the operating instructions for the magnetic safety switches.

4.2.2 Inductive safety switches

Tab. 4.17: Inductive safety switch connection

Electrical connection: Example from MSI.designer		
Inductive switch (serial)	T1  I5 	Test input TE at T1 Output A at I5
Inductive switch	24V  I7 I8 	OSSD1 on I7 OSSD2 on I8

Tab. 4.18: Functions with inductive safety switches

Function	Info
Testing	Necessary with serial inductive switches
Series connection/cascading	Inductive switches (serial): Up to six sensors per input. Maximum OFF-ON delay of the cascade is 10 ms (otherwise, the test gap will lead to switch-off). Note the maximum line resistance of 100 Ω and the correct setting of the test pulse time. Inductive switch: No cascading possible



NOTICE



You can find additional information in the operating instructions for the inductive safety switches.

4.2.3 Transponder switches

Tab. 4.19: Transponder connection

Electrical connection: Example from MSI.designer		
With OSSD	24V  I1 I2 	OSSD1 at I1 OSSD2 at I2

Tab. 4.20: Functions with transponders

Function	Info
Series connection/cascading	Possible, depending on type used

NOTICE





You can find additional information in the operating instructions for the respective transponder switch.

4.3 Testable single-beam safety light barriers

4.3.1 Testable type 2 single-beam safety light barriers


Tab. 4.21: Connecting testable type 2 single-beam safety light barriers

Electrical connection: Example from MSI.designer		
Testable type 2 single-beam light barriers		Test input TE (transmitter) at T1 Output Q (receiver) at I3


WARNING	
	Note the safety information and protective measures. Route the transmitter and receiver lines outside of the switchbox so that a short-circuit between these lines can be avoided, e.g. route them separately in separate sheathed cables or protected areas.


Tab. 4.22: Functions with testable type 2 single-beam safety light barriers

Function	Info
Testing	Possible
Series connection/ cascading	Possible, depending on the safety light barrier type used Note the correct setting of the test pulse time: Maximum OFF-ON delay of the cascade is 10 ms (otherwise, the test gap will lead to switch-off). Note the maximum line resistance of 100 Ω.

NOTICE	
	You can find additional information in the operating instructions for the type 2 single-beam safety light barriers.

4.3.2 Testable type 4 single-beam safety light barriers

Electrical connection: Example from MSI.designer		
Testable type 4 single-beam light barriers		Test input TE (transmitter) at T2 Output Q (receiver) at I4

WARNING	
	Route the transmitter and receiver lines outside of the switchbox so that a short-circuit between these lines can be avoided, e.g. route them separately in separate sheathed cables or protected areas.

Tab. 4.23: Functions with testable type 4 single-beam safety light barriers

Function	Info
Testing	Required
Series connection/ cascading	Maximum of seven pairs per inputs Note the maximum line resistance of 100 Ω .

NOTICE



You can find additional information in the operating instructions for the type 4 single-beam safety light barriers.

4.3.3 Customer-specific testable single-beam safety light barriers

You can find additional information on creating customer-specific elements in the software manual.

NOTICE



- ✎ Select the minimum value for the desired test gap in the settings of the customer-specific element dialog.
- ✎ Regardless of the test gap, the entire OFF-ON delay of the cascade must be less than the maximum OFF-ON delay of the respective test output (see *Response times for basic safety functions [chapter 12.1]*) - 2 ms. Otherwise, the test gap will cause a switch-off. For safe input/output modules, this value = 12 ms - 2 ms = 10 ms.
- ✎ Use a screened or separate cable for the connections from the test output of the module (X1 to X8) to the test input of the transmitter and from the output of the receiver to the safe input of the module (I1 to I8). Otherwise, a short-circuit between the signals may prevent error detection by this test.

4.3.4 Information on installing testable single-beam safety light barriers

NOTICE



Note the installation information in the operating instructions for the respective sensors and particularly the following points:

- ✎ Single-beam safety light barriers may only be used as access protection in accordance with EN ISO 13855. They may not be used as finger or hand protection.
- ✎ Maintain the minimum distance to reflective surfaces.
- ✎ The safety distance between the light beam and the danger point for the access protection must absolutely be adhered to.

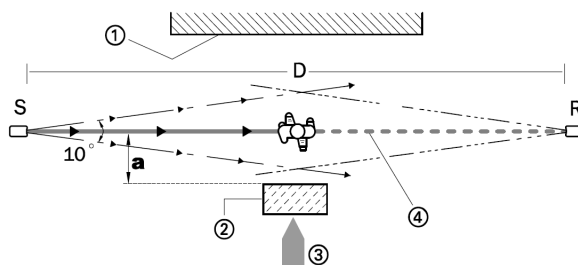


Fig. 4.1: Minimum distance "a" to reflective surfaces, correct installation, and alignment

S = transmitter

R = receiver

D = distance between transmitter and receiver

1 = border to the hazardous area

2 = reflective surface

3 = entry direction to the hazardous area

4 = optical axis

a = minimum distance to reflective surface

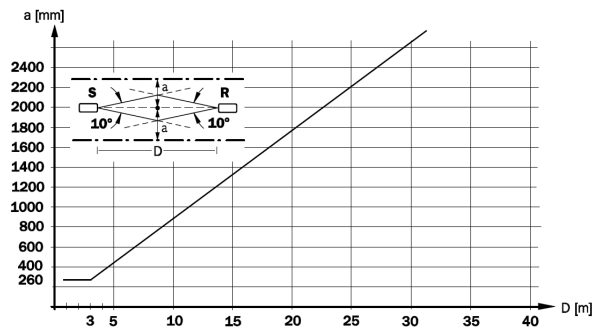


Fig. 4.2: Minimum distance "a" as a function of distance "D" for testable single-beam safety light barriers with 10° aperture angle

NOTICE



Diagrams of the safety light barriers can be found in the respective operating instructions.

NOTICE



Avoid interaction between single-beam safety light barriers and between cascades

- ↪ If multiple single-beam safety light barrier pairs are used, the aperture angle of the sensors must absolutely be noted in order to prevent interaction.
- ↪ If the transmitter is only installed on one side, the light beams must not overlap on the receiver side so that the light beam of the transmitter reaches two receivers.
- ↪ With reciprocal installation of the transmitter and receiver, ensure that the light beam of transmitter S1 cannot be received by receiver R3 and that the light beam of transmitter S3 cannot be received by receiver R1.

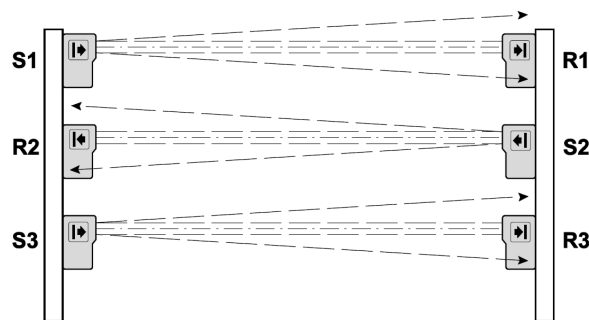





Fig. 4.3: Installation so as to prevent optical interaction

4.4 BWS – Contactless Safety Devices

Tab. 4.24: BWS connection

Electrical connection: Example from MSI.designer		
Light curtain, type 2		OSSD1 (receiver) at I1 OSSD2 (receiver) at I2
Multiple-beam light barrier, type 2, Multiple-beam light barrier, type 4		OSSD1 (receiver) at I3 OSSD2 (receiver) at I4
Laser scanner BWS type 3		OSSD1 (receiver) at I5 OSSD2 (receiver) at I6

NOTICE



You can find additional information in the operating instructions for the respective BWS.

4.5 Safety outputs



WARNING



Safety-based devices must be suitable for safety-relevant signals!

An interruption in the function of safety outputs will lead to a loss of safety functions, which means that there will be a risk of severe injury.

- ⚡ Do not connect any loads that exceed the rated values of the safety outputs.
- ⚡ Wire the MSI 400 system such that no 24 V DC signals can unintentionally make contact with the safety outputs.
- ⚡ Connect the GND lines of the power supply to ground so that the devices do not switch on when the safety output line is at ground potential.
- ⚡ Use suitable components or devices that fulfill the applicable guidelines and standards.
- ⚡ Actuators can be wired at the output as single-channel. To ensure compliance with the appropriate safety integrity levels, the cables must be routed in such a way that cross-connections to other signals are excluded, e.g. by routing them within protected areas, e.g. control cabinets, or with separate, screened cables.

5 Special functions

5.1 Muting

Muting is the automatic temporary bypassing of all safety-based functions of the control system or of the safety equipment. Muting is used when certain objects, e.g. pallets with material, may be moved into the hazardous area. During this transport, the muting function suppresses monitoring by the contactless safety device (BWS), e.g. a safety light curtain.

For further information, observe the information in the software manual in the following chapter:
Function blocks for 4-sensor muting (time-controlled), 4-sensor muting (sequential) and 2-sensor muting (time-controlled, with/without direction detection)

6 Installing/removing

This section describes the installation of modules for the MSI 400 safety controller.

6.1 Installation position and maximum expansion stage

The following combination was defined and examined as the maximum expansion stage of the MSI 400 system. All inputs are wired with test pulses and the outputs are loaded with the corresponding currents after derating.


In order to guarantee fault-free operation, use of a 24 V supply voltage is preferred under extreme conditions.



The system has not exhibited any restrictive behavior when operated in the normal installation position (DIN rail mounted horizontally on the wall).

If the system is operated in a different installation position, an ambient temperature of 55 °C should not be exceeded in order to guarantee continuous operation.

The following installation positions are permitted:

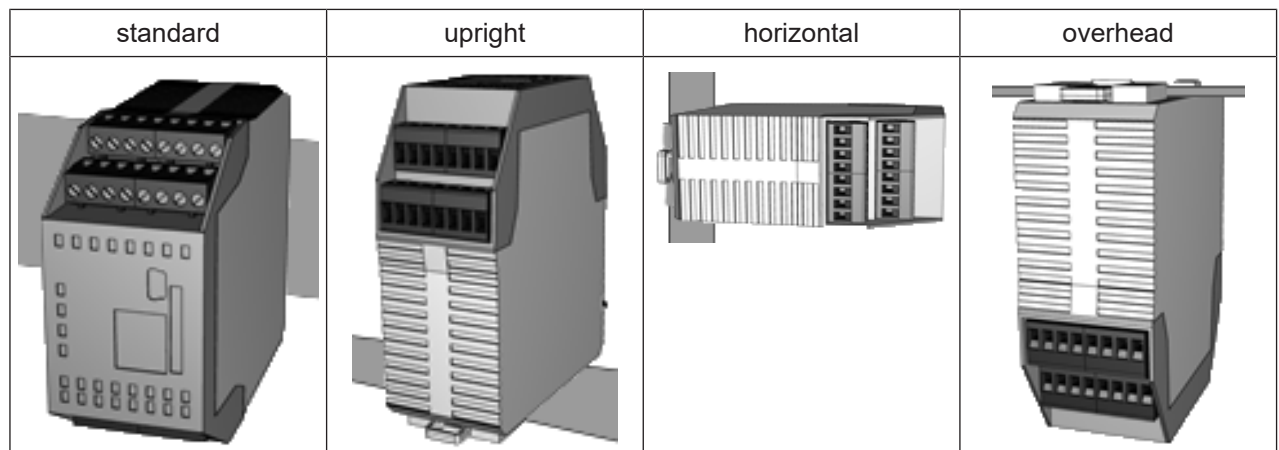

6.2 Installing modules on DIN rails


 WARNING	
	<p>Only for control cabinets with protection class IP 54 or higher!</p> <p>The MSI 400 system is only suitable for installations in a switchbox having at least protection class IP 54.</p>

Info

- **Basic safety:**
Gateways and extended modules may not be removed or added when the operating voltage is switched on.
- **Grounding:**
The DIN rail must be conductively connected to the protective earth conductor (PE).
- **ESD protection measures:**
Observe suitable ESD protection measures during installation.
Failure to do so could result in damage to the internal safety bus.
- **Protect connector openings:**
Undertake suitable measures so that no foreign bodies can penetrate connector openings, particularly those for the program removable storage.
- **Module width:**
The modules are placed in a mounting box that is 22.5 mm or 45 mm wide depending on type.
- **Quality of DIN rail:**
The mounting boxes are suitable for 35 mm DIN rails as per EN 60715.
- **Sequence of modules:**
The MSI 400 system has the controller module on the far left. The two optional gateways follow directly to the right next to the controller module. The expansion modules only follow thereafter.
- **Save space for subsequent model replacement:**
The modules are connected via the plug connection integrated into the housing. Note that the MSI 400 modules must be pulled about 10 mm apart before a module replacement so that the corresponding module can be removed from the DIN rail.
- **Standards to be taken into consideration:**
Installation according to EN 50274

Step 1: Installing a controller module


- ↳ Use a screwdriver to pull the mounting foot outward.

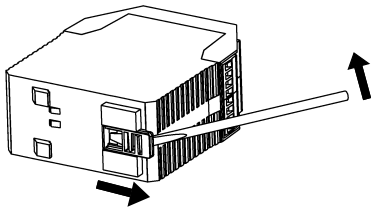


- ↳ Hang the module on the DIN rail.

Important! Make sure that the screening spring fits correctly.


The screening spring of the module must be placed onto the DIN Rail so that it is secure and has good electrical contact.

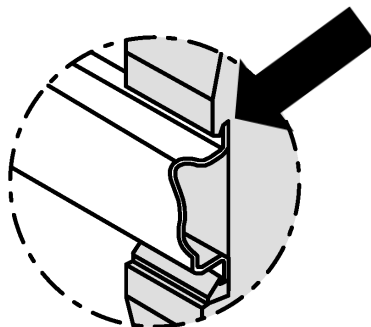

- ↳ Fold the module onto the DIN rail.



- ↳ Use a screwdriver to move the mounting foot against the DIN rail until the mounting foot latches into position with an audible click.

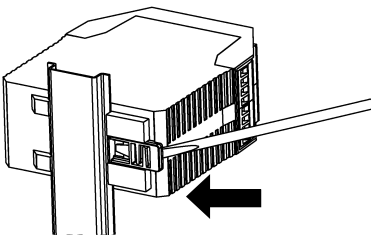


- ↳ Make sure that the module is securely seated on the DIN rail.

Attempt to pull the module from the DIN rail using slight pressure. If the module stays connected to the DIN rail during this test, then the installation is correct.

Step 2: Installation of gateways or expansion modules


- ↪ Use a screwdriver to pull the mounting foot outward.

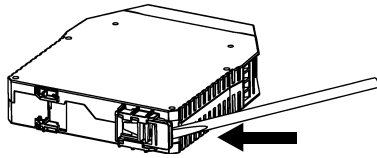


- ↪ Hang the module on the DIN rail.

Important! Make sure that the screening spring fits correctly.


The screening spring of the module must be placed onto the DIN Rail so that it is secure and has good electrical contact.

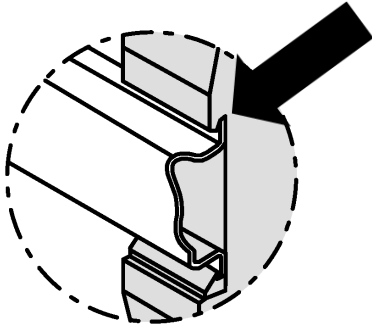


- ↪ Fold the module onto the DIN rail.

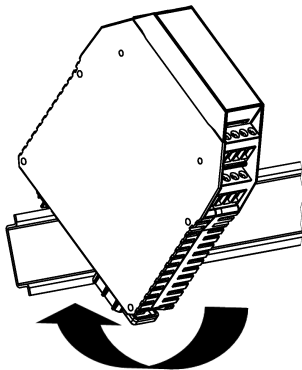

- ↪ Use a screwdriver to move the mounting foot against the DIN rail until the mounting foot latches into position with an audible click.

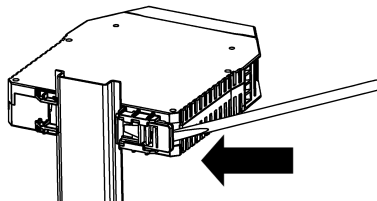

- ↪ Make sure that the module is securely seated on the DIN rail.
Attempt to pull the module from the DIN rail using slight pressure. If the module stays connected to the DIN rail during this test, then the installation is correct.
- ↪ If you are installing multiple modules:
Push the individual modules together in the direction of the arrow until the lateral plug connection between the modules audibly latches into position.

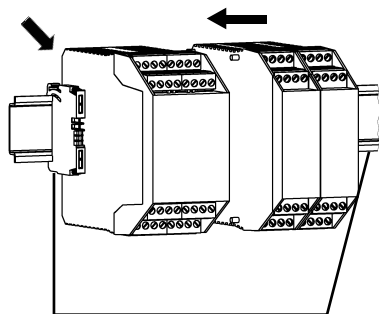

- ➡ Install an end terminal into the module furthest to the left and another end terminal into the module furthest to the right.

After installation


Once you have installed the modules, the following steps are required:

- *Connect the modules electrically. [chapter 4]*
- *Configure modules (see: software manual).*
- *Check the installation before first commissioning. [chapter 9.2]*


6.3 Removing modules from the DIN rail

Step 1: Removing a controller module


- ↳ De-energize the MSI 400 system.
- ↳ Remove plug-in terminals with wiring and remove the end terminal.

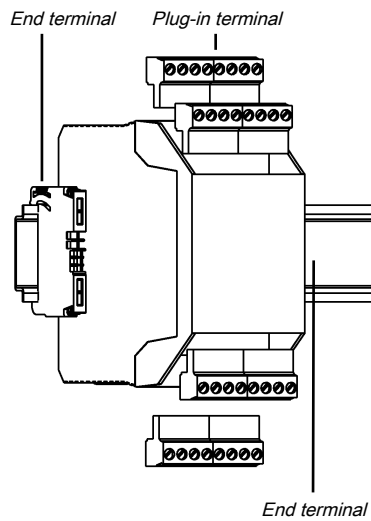


- ↳ If expansion modules or gateways are used:
Slide the controller module in the direction of the arrow until the lateral plug connection is disconnected.

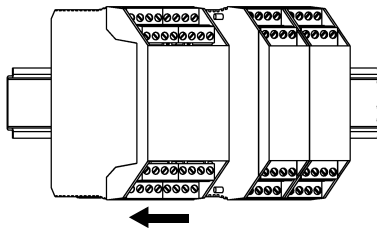

- ↳ Unlock the module.
To do this, pull the mounting foot of the module outward using a screwdriver.

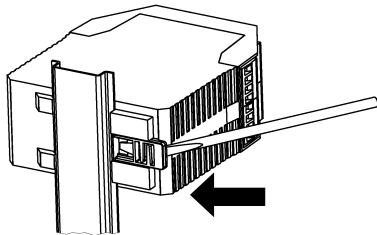


- ↳ Fold the module away from the DIN rail and remove from the rail.

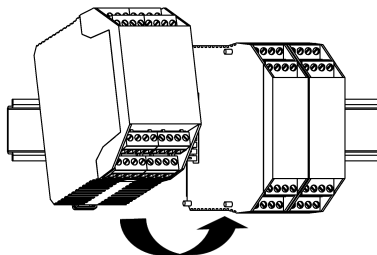


Step 2: Removing gateways and expansion modules

↳ De-energize the MSI 400 system.

↳ Remove any plug-in terminals with wiring and remove the end terminals.

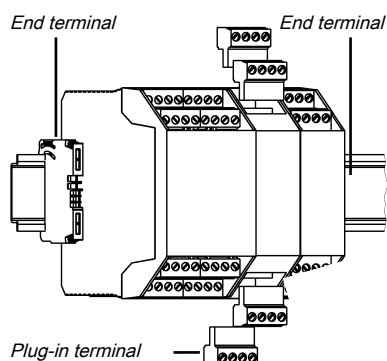


↳ Pull the modules apart from one another individually in the direction of the arrow until the lateral plug connection is disconnected.

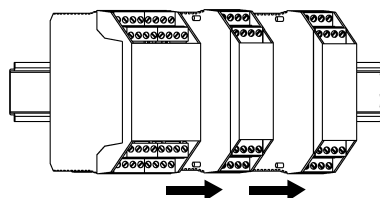


↳ Unlock the module.

To do this, pull the mounting foot of the module outward using a screwdriver.

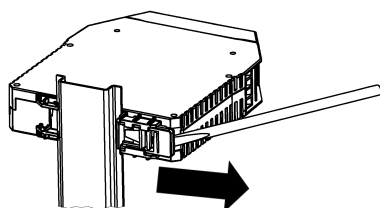

↳ Fold the module away from the DIN rail and remove from the rail.

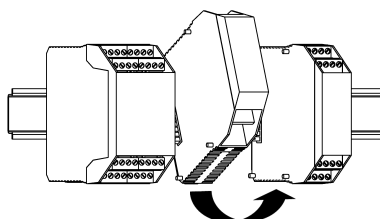









7 Electrical installation

7.1 Requirements for electrical installation

This section describes the electrical installation of the MSI 400 system in the switchbox. You can find additional information on the electrical connection of other devices to the MSI 400 system in the section on the respective device (see Product description).

Safety information

	WARNING
	<p>Switch off power to the entire system/machine!</p> <p>It is possible for the system to start unintentionally while you are connecting the devices.</p>
	WARNING
	<p>Note the corresponding safety standards!</p> <p>All of the safety-related parts of the system (wiring, connected sensors and command encoders, configuration, device monitoring) must meet the respective standards (e.g. EN 62061 or EN ISO 13 849-1). This can mean that the safety-related signals must be designed redundantly or that single-channel signals must be routed in a protected manner, or that short-circuit detection will be required through the use of test outputs and/or regular function tests.</p> <ul style="list-style-type: none"> ↳ Note that short-circuit between test outputs and the corresponding input cannot be detected. ↳ Consider whether a screened cable or separate line routing will be required for these signals. ↳ In the event of a short-circuit to 24 V at an output, it will no longer be possible to switch off the output. ↳ Reverse current to a switched-off output of an MSI-EM-IO84 cannot be prevented and will influence the ability to switch off the outputs.
	WARNING
	<p>Limited short-circuit detection in the input circuits</p> <ul style="list-style-type: none"> ↳ One MSI 4xx module has four test signal generators T1 – T4. ↳ One MSI-EM-I8 module has two test signal generators. One test signal generator is responsible for the odd-numbered test outputs (X1, X3, X5, and X7), while the other is responsible for the even-numbered test outputs (X2, X4, X6, and X8). ↳ Short-circuits between test signal generators of a MSI-EM-I8 or MSI-EM-IO84 module are detected. Between different modules, the short circuit detection is then only ensured if the test gaps of the test signal generators are < 4 ms, the test periods ≥ 200 ms and no more than 9 modules (MSI-EM-I8 / MSI-EM-IO84) have been plugged in. Short-circuits after 24 V DC (after High) at inputs that are connected to test outputs are detected independently of the length of the test gaps. ↳ Please ensure that the odd-numbered test outputs (X1, X3, X5, and X7) at an MSI-EM-I8 are connected to a common test signal generator and that the even-numbered test outputs (X2, X4, X6, and X8) are connected to another common test signal generator. Therefore, short-circuits between the odd-numbered test outputs (X1, X3, X5, and X7) cannot be detected. The same applies accordingly to the even-numbered test outputs X2, X4, X6, and X8. <p>Make note of this during wiring (e.g. through separate routing or protected lines)!</p>

 WARNING	
	<p>Reverse current at inputs of MSI 4xx, MSI-EM-IO84 or MSI-EM-I8 with breakdown of ground!</p> <p>In the event of an internal or external ground breakdown, reverse current can flow from the supply voltage of the COMPACT module (terminal A2) to the safe inputs of the MSI 4xx, MSI-EM-IO84 or MSI-EM-I8 modules. Make note of this if other inputs are connected in parallel to these inputs so that this reverse current does not lead to an unintentional high at the inputs connected in parallel.</p>

Additional information

- The MSI 400 safety controller fulfills the EMC provisions in accordance with basic technical standard EN 61000-6-2 for the industrial sector.
- Industrial safety devices from Leuze electronic are only suitable for local direct-current applications. If the device is to be used in supply voltage networks, e.g. in accordance with IEC 61326-3-1, then additional safety measures must be implemented.
- Machines on which safety devices will be used must be installed and configured in accordance with the Lightning Protection Zone (LPZ) as per EN 62305-1. The required resistance level can be achieved by using external safety devices. The Surge Protection Devices (SPD) used must fulfill requirements in accordance with EN 61643-11.
- The system must prevent "Common Mode" malfunctions in a frequency range of 0 Hz to 150 kHz in accordance with IEC 61000-4-16.
- In order to ensure complete EMC safety, the DIN rail must be connected to functional earth (FE).
- The MSI 400 system must be installed in a switchbox with at least protection class IP 54.
- Carry out the electrical installation in accordance with EN 60204-1.
- The power supply of the devices must be able to bridge a short-term power outage of 20 ms in accordance with EN 60204-1.
- The power supply must meet the regulations for low-voltage with safe disconnection (SELV, PELV) in accordance with EN 60664 and EN 50178 (equipping high-voltage systems with electronic equipment).
- You must connect all modules in the MSI 400 system, the connected safety equipment and the voltage supplies to the same 0-V DC connection (GND).
- Avoid using ground loops between the USB interface GND and the A2 connection of the controller module, e.g. by using optocouplers.
- Depending on external loads, particularly with inductive loads, additional external protective measures such as varistors or RC elements are necessary in order to protect the safety inputs and outputs. There are limits for the operation (see *Technical data [chapter 12]*). Note that the response times may be delayed depending on the type of protective circuit.
- If a module is replaced, the correct plug-in block terminal arrangement must be ensured, e.g. through labeling or corresponding cable routing.
- If it is possible for someone to access the protective equipment from the rear (e.g. a safety light curtain), then install the reset button such that it cannot be activated by a someone who is in the hazardous area. In addition, the operator must have a complete overview of the hazardous area when operating the reset button.

7.2 Safe installation in line with EMC provisions



The MSI 400 safety controller fulfills the EMC provisions in accordance with basic technical standard EN 61000-6-2 for the industrial sector.

In order to guarantee that the installation complies with EMC provisions, observe the following notes as well as the information provided by the manufacturers of the components used, e.g. sensors.

- The DIN rail for mounting the MSI 400 modules must be connected to the functional earth (FE)!
- All the modules of the MSI 400 system, the connected safety equipment and power supply/supplies should be connected with the same 0 V DC connection (GND).
- Avoid loops between the GND potential, e.g. between the USB interface and the A2 connection on the controller module, by using interfaces with optocouplers, for example.
- Ensure that the cables between the controller modules and sensors are screened and connect only one side of the screen to GND or earth.
- Inductive loads must be equipped with appropriate protective measures, such as varistors and RC elements.
- Make sure that control and load circuits are separated when installing in the control cabinet and when laying cables.
- Use screened cables in areas that are loaded with high-frequency signals (e.g. frequency converters).

Further information on electrical installation

- Industrial safety devices from Leuze electronic are only suitable for local direct-current applications. If the device is to be used in supply voltage networks, e.g. in accordance with IEC 61326-3-1, implement additional safety measures.
- Install all components of the MSI 400 system in one control cabinet with a minimum protection class of IP 54.
- Configure electrical installation according to EN 60204-1.
- The power supply of the devices must be able to bridge a short-term power outage of 20 ms in accordance with EN 60204-1. Provide appropriate power packs.
- The power supply must meet the regulations for low-voltage with safe disconnection (SELV, PELV) in accordance with EN 60664 and EN 50178 (equipping high-voltage systems with electronic equipment).
- Always ensure MSI 400 components and sensors are disconnected from the power supply before installing and connecting them.

 WARNING	
	<p>Observe the screen specifications</p> <ul style="list-style-type: none"> ↳ Use screened lines to connect the sensors, if possible. ↳ Earth the screen on the module or in the control cabinet. ↳ We recommend the WST.../T35 screen grounding terminal for grounding the screen on MSI 400. ↳ Position the screen grounding terminal as close to the module as possible and keep the stripped ends for connection to the module as short as possible.

7.3 Internal wiring of the supply voltage

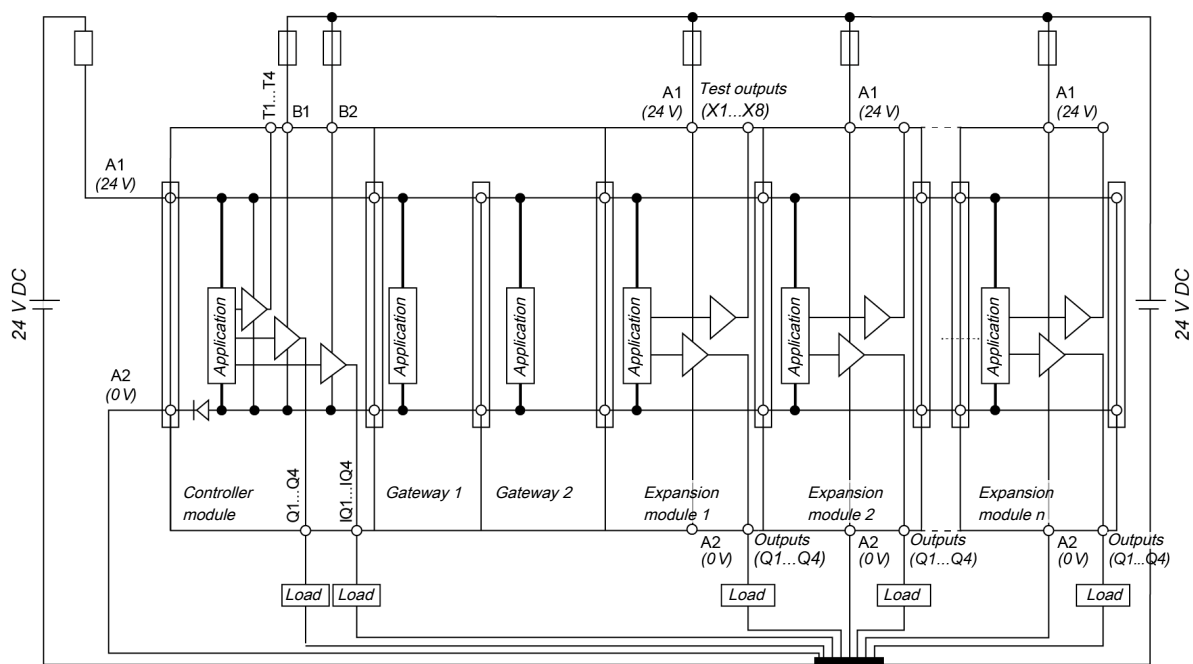


Fig. 7.1: Internal wiring of the MSI 400 supply voltage

8 Configuration



WARNING

**Check the protective function before commissioning and after any change!**

If you change the configuration, you must check the effectiveness of the protective function. To this end, note the test instructions in the operating instructions for the connected safety equipment.





Additional information

For configuring the MSI 400 system, you will require the MSI.designer software and the MSI-SD-CARD program removable storage.

Devices that are connected to the safety controller are not generally configured and verified by the MSI.designer software. These devices have their own mechanisms for configuration and verification.

- The system configuration of the entire MSI 400 system is stored in the program removable storage. This has the advantage that the system does not have to be reconfigured when modules and/or gateways are replaced.
- The data stored in the program removable storage will be retained even if the supply voltage is interrupted.
- It is possible to transfer configuration information via the USB or Ethernet interface.

9 Commissioning

 WARNING	
	Commissioning cannot take place without testing being conducted by a qualified person!
	<p>✎ Before operating the system in which you are using a MSI 400 safety controller for the first time, it must be tested and documented for release by a qualified person.</p>
 WARNING	
	Monitor the hazardous area!
	<p>✎ Before commissioning, make sure that no one is inside the hazardous area.</p> <p>✎ Check the hazardous area and secure it against access by unauthorized people (e.g. place warning notices, set up blocks, etc.). Note the corresponding laws and local regulations.</p>

9.1 Total acceptance of the application

You may only place the system into operation if the total acceptance inspection was passed successfully. The total acceptance inspection may only be done by appropriately trained personnel.

The total acceptance comprises the following test points:

Procedure

- ✎ Check whether all of the safety-related parts of the system (wiring, connected sensors and command encoders, configuration) meet the respective standards (e.g. EN 62061 or EN ISO 13 13849-1).
- ✎ Test the devices connected to the safety controller in accordance with the test information in the corresponding operating instructions.
- ✎ Mark all of the connections (connection lines and plug connectors) on the safety controller clearly and uniquely to prevent mix-ups. Because the MSI 400 system has multiple connections with the same shape, make sure that connection lines or connectors that are disconnected are not unintentionally connected back to the wrong connection.
- ✎ Check the signal paths and the correct integration into higher-level controls.
- ✎ Check the correct data transmission from and to the MSI 400 safety controller.
- ✎ Check the logic program of the safety controller.
- ✎ Carry out a complete validation of the safety functions of the system in each operating mode and an error simulation. Note in particular the response times of the individual applications.
- ✎ Fully document the configuration of the system, the individual devices, and the results of the safety check.

9.2 Tests before initial commissioning







The tests before initial commissioning are used to confirm the safety requirements required in the national/international guidelines, particularly the Machinery or Work Equipment Directive (EC conformity).

Procedure

- ✎ Test the effectiveness of the safety equipment on the machine in all operating modes and functions that can be set on the machine.
- ✎ Make sure that operating personnel who will be working with the machine protected by the safety controller are trained by qualified personnel from the machine operator before starting work. The machine operator is responsible for the training.

10 Diagnostics

10.1 What to do in the event of an error

 WARNING	
	Do not operate the system in the event of an unclear error!  Place the machine out of operation if you cannot clearly assign an error or eliminate it safely.
 WARNING	
	Carry out a complete function test after eliminating the error.  Carry out a complete function test when you have eliminated an error.

10.2 Error statuses

In the event of certain malfunctions or a faulty configuration, the MSI 400 safety controller will switch to a safe state. The LEDs of the individual modules of the safety controller indicate the relevant error type.

There are various error levels depending on the type of error:

Configuration error

- The system is in the *Configuration required* state and the MS LED flashes red with 1 Hz.
- Applications in all modules are in the Stop operating state.
- All safety outputs of the system are switched off.
- All safe process data are set at zero. Typically, the non-safety-related process data are also set at zero.



Repairable errors

- The applications in all the modules remain in the Run operating state. The MS LED of the affected modules flashes alternately in red/green with 1 Hz. The MS LED of the unaffected modules turns green.
- If safety outputs are affected, then these safety outputs of the system will be switched off at a minimum.
- If safe inputs are affected, then the process data of these safe inputs at a minimum will be set at zero.


Critical error

- The system is in the *Critical error* state and the MS LED of the module that has detected the critical error flashes red with 2 Hz. The MS LED of the modules at which the error cause is unknown will be lit in red.
- Applications in all modules are in the Stop operating state.
- All safety outputs of the system are switched off.
- All safe process data are set at zero. Typically, the non-safety-related process data are also set at zero.

How to place the device back in operation:

-  Eliminate the cause of the error in accordance with the displays of the MS and PWR/EC LEDs.
-  With critical errors, after troubleshooting, switch off the power supply of the MSI 400 system for at least 3 seconds and then switch it on again.

Reset conditions for input errors at bit inputs

-  Bring the inputs into a safe state (e.g. emergency stop) after removing the cause of the error at the affected input, or in case of 2-channel control of the affected inputs.

The error is cleared in this state.

With antivalent input processing, it may be necessary to change the signal generator to the active and again to the inactive state before the error state of the input pair is corrected.

The input or inputs are ready for operation again.

Reset conditions for errors at outputs

- ↳ Eliminate the cause of the error.
- ↳ Switch suitable input signals so that both outputs of the affected output group (Q1/Q2, Q3/Q4, IQ1/IQ2 or IQ3/IQ4) are simultaneously switched inactive by the logic.

The error is cleared in this state. Both outputs are ready for operation again

Even when using the outputs as single-channel outputs, both outputs of a group (see above) must become inactive simultaneously before the outputs are ready for operation again.

- ↳ With critical errors, after the error has been resolved, switch off the voltage supply of the MSI 400 system for at least 3 seconds and then switch it on again.

10.3 Error displays of the status LEDs

This section explains the meanings of the status LEDs.

A more detailed error diagnosis is possible via the error messages can be seen in the **Diagnostics** of MSI.designer.




NOTICE

- ↳ You can find information on how to carry out diagnostics in the software manual, "Diagnostics" view
- ↳ You can find a list of all the error messages in this document under List of all error messages, causes and aids
This section lists the most important error codes, possible causes and troubleshooting measures.

10.3.1 Device state and LED displays in the controller modules








Flash code meaning



Tab. 10.1: Key


Symbol	Meaning
	LED off
	LED flashing
	LED lights up





Reference




Tab. 10.2: Device state and LED displays in the controller modules

PWR/EC LED	Meaning	Additional info
 Red flashing	<p>An error has occurred in the control. All 24 V outputs have been switched off. The control must be restarted with a power ON reset after the cause of the error has been eliminated.</p> <p>The number of flash pulses indicates the error class to which the occurring error belongs.</p>	<p>Number of flashing pulses = error class</p> <p>2: Configuration data</p> <p>3: Application</p> <p>4: Self-test</p> <p>5: Voltage/current monitoring</p> <p>6: I/O modules</p> <p>7: Cross-communication</p> <p>8: Internal</p>
 Green flashing (1 Hz)	<p>The supply voltage at A1, B1, or B2 is outside of the range of 16.8 V to 30 V.</p>	
 Green	<p>The supply voltage at A1, B1, and B2 is within the range of 16.8 V to 30 V.</p>	
MS LED module state	State	Additional info
 Red flashing (1 Hz)	<p>There is no project at the control or the project data is faulty (because, e.g., the number of inserted I/O modules does not match the project).</p>	<p>No or incorrect module configuration</p>
 Green flashing (1 Hz)	<p>Project data was adopted from control and I/O modules, control waiting for start command</p>	
 Green	<p>Control has started.</p>	
 Red/green flashing	<p>One or more inputs have a cable break or short-circuit to 24 V.</p> <p>Or there is a sequence/synchronization time error at a dual channel input.</p> <p>Or an output has a test error (e.g. short-circuit).</p>	


Code-verified CV LED	Control behavior
 Yellow flashing (1 Hz)	The project at the control has not been verified. The control will not start automatically after power ON reset.
 Yellow	The project at the control has been verified. The control will start automatically after power ON reset.

NET	Meaning
 Flashing green (for 3 s)	Connection setup with control







Input LED	Meaning	Additional info
 Green flashing (1 Hz)	A single-channel input has a test error (cable break or short-circuit at 24 V) or the input was not configured in the project and 24 V is pending.	Applies to I1 to I16 and IQ1 to IQ4 if single-channel has been configured. Flashes synchronously with MS LED in red.
 Green flashing, alternating (1 Hz)	Dual channel input has synchronization time error or a sequence error or at least one of the two inputs has a test error (cable break or short-circuit at 24 V)	Applies to I1 to I16 and IQ1 to IQ4 if dual channel has been configured. Input pair flashing on and off.
 Off	Signal level at the input terminal is 0 V.	
 Green	Signal level at the input terminal is 24 V.	

Output LED	Meaning	Additional info
 Green flashing (1 Hz)	Output has a test error.	Applies to Q1..Q4 and IQ1..IQ4
 Off	Output is switched off.	
 Green	Output is switched off.	





10.3.2 Device state and LED displays in the safe input/output modules

NOTICE	
	<p>The displays of the MS LED and the input LEDs I1 to I8 are identical to those for the MSI-EM-IO84 and MSI-EM-I8 expansion modules.</p>




Tab. 10.3: Displays of the MS LED

MS LED	Meaning	Info
○	Supply voltage outside of operating range	Check supply voltage at terminals A1 and A2.
 Red/green flashing (1 Hz)	Repairable external error	Check cable of flashing inputs and outputs. If all output LEDs are flashing, check the supply voltage of terminal A1 and A2 for this module.
 Green flashing (1 Hz)	System is in the stop state or the voltage supply to A1 is outside the range of 16.8 V to 30 V.	Start the application in MSI.designer. Check voltage supply to A1.
 Green	System in the run state and the voltage supply to A1 is within the range of 16.8V to 30V.	
 Red flashing (1 Hz)	Invalid configuration	
 Red flashing (2 Hz)	Critical error in the system; suspected in this module. Application has been stopped. All outputs are switched off.	Switch supply voltage off and back on. If the error has not been eliminated after this has been done multiple times, then replace module. In order to identify the module affected, use the diagnostics display in MSI.designer.
 Red	Critical error in the system; suspected in a different module. Application has been stopped. All outputs are switched off.	Switch supply voltage off and back on. If the error has not been eliminated after this has been done multiple times, then replace module in which the red LED is flashing (2 Hz). In order to identify the module affected, use the diagnostics display in MSI.designer.

Tab. 10.4: Displays of input LEDs







Input LEDs (I1–I8)	Meaning
	Signal level at the input terminal is 0 V. Safety mat: Both inputs actuated.
 Green	Signal level at the input terminal is 24 V.
 Green (1 Hz) Synchronous with the red MS LED	Signal level at the input terminal is 0V and a repairable error at a dual channel input is pending.
 Green (1 Hz) Alternating with the red MS LED	Signal level at the input is 24V and a repairable error is pending.



Tab. 10.5: Displays of output LEDs

Output LEDs (Q1–Q4)	Meaning
 Green (1 Hz) Synchronous with the red MS LED	Output has a test error.
	Output is switched off.
 Green (1 Hz)	Output is switched off.



10.3.3 Device state and LED displays in the standard input/output modules

Tab. 10.6: Displays of the MS LED




MS LED	Meaning	Info
	Supply voltage outside of operating range	Check supply voltage at terminals A1 and A2.
 /  Red flashing (1 Hz)	Repairable external error	Check cable of flashing inputs and outputs. If all output LEDs are flashing, check the supply voltage of terminal A1 and A2 for this module.
 Green flashing (1 Hz)	System in the stop state and waits for start command or the voltage supply to A1 / A2 is outside the range of 16.8V to 30V.	Start the application in MSI.designer. Check voltage supply to A1.
 Green	System in the run state and the voltage supply to A1 is within the range of 16.8V to 30V.	
 Red flashing (1 Hz)	Invalid configuration	

MS LED	Meaning	Info
 Red flashing (2 Hz)	Critical error (type 3) in the system; suspected in this module. Application has been stopped.	Switch supply voltage off and back on. If the error has not been eliminated after this has been done multiple times, then replace module. In order to identify the module affected, use the diagnostics display in MSI.de-signer.
 Red	Critical error in the system; suspected in a different module. Application has been stopped.	Switch supply voltage off and back on. If the error has not been eliminated after this has been done multiple times, then replace module in which the red LED is flashing (2 Hz). In order to identify the module affected, use the diagnostics display in MSI.de-signer.

Tab. 10.7: Displays of input LEDs

Input LEDs (I1–I4 and IY5–IY8)	Meaning
	Signal level at the input terminal is 0 V. Inputs actuated.
 Green	Signal level at the input terminal is 24 V. Input is not actuated.

Tab. 10.8: Displays of output LEDs

Output LEDs (Y1–Y4 and IY5–IY8)	Meaning
	Output is switched off.
 Green	Output is switched off.
 Green (1 Hz) synchronous with the red MS LED	Output has an error. (e.g. output driver overloaded)

10.4 Support

If you cannot eliminate an error with the help information contained in this section, then please contact the Leuze branch responsible for your area.

NOTICE



If you send in an SD card for repair or analysis, you will receive it back in delivery condition (factory settings). Therefore, be sure to store the configuration(s) of your devices in the MSI.designer.

10.5 Expanded diagnostics

MSI.designer contains expanded diagnostics options. The software enables you to further contain the problem if you have an unclear picture of the situation or availability issues.

Please see the following for more detailed information:

- Software manual
- A complete list of all error messages is contained in the Appendix.

11 Maintenance

The following section provides information on regular tests and the replacement of MSI 400 modules.

Do not attempt to remove, repair, or modify the MSI 400 modules. This may lead to loss of safety functions. Furthermore, this will void any warranty claim you may have against Leuze electronic GmbH.

11.1 Regular testing of the safety equipment by qualified persons

- ↳ Test the system according to national valid regulations within the required time frames. This is necessary in order to discover any changes in the machine or manipulations to the safety equipment after initial commissioning.
- ↳ Every security application must be tested within a time interval specified by you. The effectiveness of the safety equipment must be tested by trained and qualified persons.
- ↳ If changes are performed on the machine or safety equipment or the safety controller is refitted or repaired, check the system again according to the checklist in the Appendix.
- ↳ Carry out regular or daily inspections in order to keep the MSI 400 modules in optimum operating condition.
- ↳ Check whether the implementation of the MSI 400 modules contains all of the technical data for the device.
- ↳ Check the installation conditions and whether the wiring of the MSI 400 modules has been completed correctly.
- ↳ Conduct regular verifications to ensure that the safety functions fulfill the requirements of the application and all regulations and standards (e.g. regular testing) in order to ensure the reliability of the safety functions.

11.2 Replacing devices

A critical error in one of the MSI 400 modules will affect the entire network. Therefore, devices that have critical errors must be quickly repaired or replaced. We recommend keeping a stock of replacement MSI 400 module devices so that you can re-establish network operation as quickly as possible.

11.2.1 Safety measures when replacing devices

Follow the following safety measures when replacing MSI 400 modules:

- Do not attempt to dismantle or repair the MSI 400 modules. This not only will void warranty claims against Leuze electronic, but it is also dangerous, because in this case it is not possible to test the original safety functions.
- Place the device back into a condition in which the safety will be ensured.
- Only carry out replacement when the power supply is switched off in order to prevent electric shock or unexpected behavior from the device.
- In order to enable further use of the system configuration, check the following:
 - Is the new module of the same type (same material number) and is the new module error-free after replacement?
 - Was the new module inserted into the same position at which the replaced module was?
 - Were all plug connections connected back at the correct location?
- If not, you will need to completely reconfigure the new system and commission it including all of the necessary tests (see *Commissioning [chapter 9]*).

NOTICE



- ↳ After replacement, make sure that no errors are occurring with the new MSI 400 modules.
- ↳ Be sure to carry out a function test before commissioning a replacement module.
- ↳ When you send in MSI 400 modules for repair, generate a report of your project in MSI.designer and carry out diagnostics; enclose a detailed description of the problem with the device, and send the MSI 400 modules along with all available information to Leuze electronic.

12 Technical data

12.1 Response times for basic safety functions

The response time is the time that is required to activate the safety function.

Example: The time from which the safety light barrier is crossed until the machine stops.

In order to determine the response time of the MSI 400system, use the standard time plus the filter and test times.

Factor 1: Standard time

Maximum ON-OFF time from input to output without filter and test times:

Tab. 12.1: Calculating the time values

	Input MSI 4xx	Input MSI-EM-IO84 / MSI-EM-I8
Output MSI 4xx	2 × cycle time + 3.6 ms	2 × cycle time + 7.2 ms
Fast-Shut-Off (FSO) MSI 4xx	11.8 ms	–
Output MSI-EM-IO84	2 × cycle time + 6.9 ms	2 × cycle time + 10.6 ms
Fast-Shut-Off (FSO) MSI-EM-IO84	–	8.6 ms

- The cycle time must be obtained from MSI.designer (lower right).
- FSO = Fast Shut-Off: This function can be used to achieve quicker switch-off times from input to output inside the module. FSO is a functional component in the MSI.designer.

Factor 2: Filter time

When the ON-OFF filter is activated, the switch-off signal is delayed by the filter time set. This filter can be activated for each input in the MSI.designer and acts upon the response time with + 8 ms.

Factor 3: Test times

If the input tests are carried out in single-channel input circuits with the assistance of tests outputs T1 to T4 or X1 to X8, this results in the response time for test times > 1 ms from the test time plus response time (wait time until the test pulse occurs).

Tab. 12.2: Response times



MSI 4xx	MSI-EM-I8 / MSI-EM-IO84
12 ms	With the test pulse time set to $4\text{ms} \leq t_p \leq 12\text{ms}$: 8 ms
	With the test pulse time set to $t_p > 12\text{ms}$: 12 ms

When using user-defined elements (software manual) the response time can also be extended in two-channel input circuits if the selected test time is greater than $0.5 \cdot \text{test period} - 12\text{ms}$. The resulting additional response time should be calculated as follows:

additional response time = test time + 12ms - $0.5 \cdot \text{test period}$

(Only a positive result is evaluated, negative values are equal to zero)

For applications with a safety mat, the test period of the test generators connected must be applied to the response time. The following table provides the reaction times for the correspondingly set test periods.

 WARNING	
	<p>Changed reaction times!</p> <p>From build state D-03.01 of the MSI 4xx modules and B-08 of the MSI-EM-IO84 modules, the longer response times given in the table below apply.</p> <p>In particular, for existing projects with sensor elements for safety mats and bumpers, this extension of the response times must be adhered to (e.g. in the case of replacement of a MSI 4xx module).</p>

Tab. 12.3: Test periods and response times

Test periods for both test outputs [ms] ¹		Resulting additional response time [ms]	
Test output 1	Test output 2	MSI-EM-IO84 (to B-07) MSI 4xx (to D-01.xx)	MSI-EM-IO84 (from B-08) MSI 4xx (from D-03.xx)
40	40	20	40
40	200–1000	40	80
200	200	100	200
200	400–1000	200	400
400	400	300	400
400	600	400	600
	800–1000	400	800
600	600	500	600
600	800	600	800
	1000		1000
800	800	700	800
800	1000	800	1000
1000	1000	900	1000

¹ Obtain the values from the report in MSI.designer.

Example

The following examples shows the determination of the response time of a safety function (sensor – logical function – actuator).

Tab. 12.4: Response time of a safety function

Sub-function	Time	Remarks
Response time of the sensor	+ 18.0 ms	Manufacturer information
Test time for testable sensors, e.g. Type 2 contactless safety devices With testable sensors, the response time increases by the active test gap + 12 ms. Thus, with a test gap of 4 ms, there is an additional response time of 4 ms + 12 ms = 16 ms	+ 16.0 ms	Test generators T1 to T4 or X1 to X8
Filter time When the ON-OFF filter is active, + 8 ms	0.0 ms	MSI.designer
Standard time Controller module input to controller module output With a cycle time of 4 ms.	+ 11.6 ms	See table: "Standard time"
Logics for switch-off delay times If function blocks with switch-off delay are used in the logic plan, then these times have to be added to the response time.	0.0 ms	MSI.designer
Actuator response time	+ 35.0 ms	Manufacturer information
Total time	80.6 ms	

12.1.1 Minimum switch-off time


The minimum switch-off time (e.g. of connected sensors) is the minimum time during which a switch-off condition must be present in order to be detected so that error-free switching is possible. The minimum switch-off time must be

- greater than the logic execution time and
- greater than the test gap + the maximum OFF/ON delay when the input is connected at test output X1–X8 and the test gap is > 1 ms, and
- greater than the test period + the maximum OFF/ON delay when safety mats or safety edges are being used.

12.1.2 Response time of the state flag

If an error is detected, the status data will be available in the **Logic** view of MSI.designer in the next logic cycle. The time to detection of a status error depends, among other things, on the duration of the test period and can be up to 1 s.

12.2 Safety technology reference values

NOTICE	
	<p>The manufacturer or designer is responsible for the risk analysis and assessment as well as for designing the technical safety parts of the control correctly. This also includes calculating the Performance Level or SIL values for the selected safety functions.</p> <p>Of course, you can always contact Leuze electronic to benefit from professional risk analysis and risk assessment services.</p>

12.2.1 Controller modules without I/O expansion

Tab. 12.5: Safety technology parameters for MSI 400 (without I/O expansion)

Configuration of safety outputs Output groups: Q1/Q2, Q3/Q4, IQ1/IQ2, IQ3/IQ4			Characteristic values				
			Safety Integrity Level (IEC 61508) ¹	Category (EN ISO 13849-1)	Performance level (EN ISO 13849-1) ¹	PFHd ²	MTTFd ³ (EN ISO 13849-1)
Single-channel or dual-channel input	Dual channel outputs (with or without test pulses)		SIL3	4	PL e	$1.3 \cdot 10^{-9}$	354 years
	Single-channel output Q _n for an output group	Test pulses at all outputs of an output group activated	SIL3	4	PL e	$1.4 \cdot 10^{-9}$	354 years
		Test pulses at one output of the output group activated and test pulses at the other output of the output group deactivated. The value indicated refers to the output with activated test pulses.	SIL3	3	PL e	$1.4 \cdot 10^{-9}$	354 years
		Output test pulses deactivated	SIL2	3	PL d	$9.8 \cdot 10^{-9}$	354 years

¹ For detailed information regarding the safety configuration of your machine/system, please contact the Leuze electronic branch in charge of your area.

² Average probability of a dangerous failure per hour

³ Average time interval between dangerous errors

⁴ Digital inputs

12.2.2 Controller modules with safe digital I/O expansion

Tab. 12.6: Safety technology parameters for MSI 400 (with I/O expansion)

			Characteristic values				
Configuration of safety outputs Output groups: MSI 4xx: Q1/Q2, Q3/Q4, IQ1/IQ2, IQ3/IQ4 MSI-EM-IO84: Q1/Q2/Q3/Q4			Safety Integrity Level (IEC 61508) ¹	Category (EN ISO 13849-1)	Performance Level (EN ISO 13849-1) ¹	PFHd ²	MTTFd ³ (EN ISO 13849-1)
Single-channel or dual-channel input	Dual channel outputs (with or without test pulses)		SIL3	4	PL e	$4.3 \cdot 10^{-9}$	227 years
	Single-channel output Q _n for an output group	Test pulses at all outputs of an output group activated	SIL3	4	PL e	$4.3 \cdot 10^{-9}$	227 years
		Test pulses at one output of the output group activated and test pulses at the other output of the output group deactivated. The value indicated refers to the output with activated test pulses.	SIL3	3	PL e	$4.3 \cdot 10^{-9}$	227 years
		Output test pulses deactivated	SIL2	3	PL d	$1.7 \cdot 10^{-8}$	227 years

¹ For detailed information regarding the safety configuration of your machine/system, please contact the Leuze electronic branch in charge of your area.

² Average probability of a dangerous failure per hour

³ Average time interval between dangerous errors

⁴ Digital inputs

12.2.3 Controller modules with safe digital I/O expansion

Tab. 12.7: Safety technology parameters for MSI 400 (with I/O expansion)

			Characteristic values				
Configuration of safety outputs Output groups: MSI 4xx: Q1/Q2, Q3/Q4, IQ1/IQ2, IQ3/IQ4 MSI-EM-IO84: Q1/Q2/Q3/Q4			Safety Integrity Level (IEC 61508) ¹	Category (EN ISO 13849-1)	Performance Level (EN ISO 13849-1) ¹	PFHd ²	MTTFd ³ (EN ISO 13849-1)
Single-channel or dual-channel input	Dual channel outputs (with or without test pulses)		SIL3	4	PL e	$4.3 \cdot 10^{-9}$	227 years
	Single-channel output Q _n for an output group	Test pulses at all outputs of an output group activated	SIL3	4	PL e	$4.3 \cdot 10^{-9}$	227 years
		Test pulses at one output of the output group activated and test pulses at the other output of the output group deactivated. The value indicated refers to the output with activated test pulses.	SIL3	3	PL e	$4.3 \cdot 10^{-9}$	227 years
		Output test pulses deactivated	SIL2	3	PL d	$1.7 \cdot 10^{-8}$	227 years

¹ For detailed information regarding the safety configuration of your machine/system, please contact the Leuze electronic branch in charge of your area.

² Average probability of a dangerous failure per hour

³ Average time interval between dangerous errors

⁴ Digital inputs

12.3 Data sheet

12.3.1 Controller module

MSI 410 and MSI 420/430

Tab. 12.8: MSI 410 and MSI 420/430 data sheet

	MSI 410 / MSI 420/430	
Security Integrity Level	SIL3 (IEC 61508)	
SIL claim limit ¹	SILCL3 (EN 62061)	
Category	Category 4 (EN ISO 13849-1)	
Performance level ¹	PL e (EN ISO 13849-1)	
PFHd (average probability of a hazard-causing failure per hour)	1.1E-09 1/h	
T _M (usage time)	20 years (EN ISO 13849)	
Protection class	III (EN 61140)	
Protection type	IP 20 (EN 60529)	
Ambient temperature during operation	-25 to +65°C	
Storage temperature	-25 to +70°C	
Humidity	10 to 95%, non-condensing	
Fatigue strength	5 ... 150 Hz (EN 60068-2-6)	
Shock resistance		
• Continuous shock	10 g, 16 ms (EN 60068-2-29)	
• Single shock	30 g, 11 ms (EN 60068-2-27)	
Operating elevation	No more than 2,000 m above sea level (80 kPa)	
Electromagnetic compatibility	Class A (EN 61000-6-2, EN 55011)	
Data interface	Internal safety bus	
Configuration interface 1	USB mini	
Configuration interface 2	RJ 45	
Plug-in terminal blocks and connection data	Screw terminal	Spring-loaded terminal
Single-wire or fine-strand	1 x 0.2 ... 2.5 mm ² or 2 x 0.2 ... 1.0 mm ²	2 x 0.2 ... 1.5 mm ²
Fine-strand with ferrules	1 x 0.25 ... 2.5 mm ² or 2 x 0.25 ... 1.0 mm ²	2 x 0.25 ... 1.5 mm ²
Conductor size AWG (use copper cables only)	26...14	24 ... 16
Maximum tightening torque	0.5 ... 0.6 Nm (5 ... 7 lbf-in)	—
Stripping length	7 mm	
Dimensions (W × H × L)	45 × 96.6 × 121 mm	45 × 107 × 121 mm
Weight	290 g (± 5%)	290 g (± 5%)
Power supply for the system (A1, A2)		
Supply voltage	24 V DC (16.8 ... 30 V DC) (general) 24 V DC (19.2 ... 29 V DC) (for EN 298)	

MSI 410 / MSI 420/430	
Type of power supply	<p>PELV or SELV</p> <p>The current for the powerpack must be limited to a maximum of 4 A – either by the powerpack itself or by a fuse</p> <p>UL 508: Use a galvanically isolated power supply with limited output voltage and power (42.4 VDC, 100 VA). The output voltage must be safeguarded by a fuse that meets the standards according to UL 248. Connect all supply connections of the system to a common source and ensure a common ground connection when using several sources.</p>
Power consumption Caution: The power consumption increases with each module that is connected to the system.	Max. 3.3 W
Short-circuit protection	4 A gG (with tripping characteristic B or C)
Power supply for output groups B1 and B2 (B2: only MSI 420/430)	
Supply voltage	24 V DC (16.8 to 30 V DC)
Type of supply voltage	<p>PELV or SELV</p> <p>The current for the powerpack must be limited externally to a maximum of 8 A per output group (B1 and B2) – either by the powerpack itself or by a fuse.</p>
Power consumption	2 × 0.3 W
Switch-on time	Max. 18 s
Short-circuit protection	8 A gG (with tripping characteristic B or C)
Safety inputs	
MSI 410: I1 ... I20 / MSI 420/430: I1 to I16, IQ1 to IQ4	
Input voltage HIGH	13 to 30 V DC
Input voltage LOW	-5 to +5 V DC
Input current HIGH	Type 2.3 mA / Max. 6 mA
Input current LOW	< 2 mA
Input capacity	10 nF
Input reverse current with ground breakdown 2	< 0.1 mA
Maximum input frequency	<p>Condition: t_{on} and t_{off} must be $> t_{CycleTime}$</p> <p>$f_{max} < 0.5 \cdot 1 / t_{CycleTime}$</p> <p>e.g.: < 125 Hz at duty cycle 50%, logic cycle time 4 ms</p>
Test outputs (T1 - T4)	
Number of outputs	4 (with 4 test signal generators)
Type of output	Semiconductor, push-pull, short-circuit-proof
Output voltage HIGH	$U_{A1} - 1.2 \text{ V}$
Output current LOW	-10 mA (limited)
Output current HIGH	<p>Single output: max. 120 mA</p> <p>Total of all test outputs: max. 120 mA</p>
Test pulse rate (test period)	1 to 25 Hz, configurable
Test pulse duration (test gap)	1 to 100 ms, configurable

	MSI 410 / MSI 420/430
Load capacity	1 μ F for test gap \geq 4 ms 0.22 μ F for test gap 1 ms
Line resistance	< 100 Ω
Safety outputs MSI 410: Q1 ... Q4 / MSI 420/430: Q1 to Q4, IQ1 - IQ4	
Number of outputs • MSI 410: • MSI 420/430	4 8 (4 fixed and 4 selectable outputs)
Type of output	High-side MOSFET, short-circuit-proof and current-monitored
Output voltage HIGH	$U_{Bx} \geq U_{Qn} \geq U_{Bx} - 0.6 \text{ V}$
Output current HIGH	$\leq 4.0 \text{ A}$
Max. overload current/duration	$\leq 12 \text{ A} / 8 \text{ ms}$
Total current I_{tot} $T_U \leq 45^\circ\text{C}$ $T_U \leq 55^\circ\text{C}$ $T_U \leq 65^\circ\text{C}$	Per output pair (Q1/2, Q3/4, IQ1/2, IQ3/4) $\leq 4.0 \text{ A}$ $\leq 2.5 \text{ A}$ $\leq 1.6 \text{ A}$
Output test, can be deactivated ^{3,4,5} Test pulse width Test pulse rate	$\leq 450 \mu\text{s}$ 10 Hz
Leakage current LOW ⁶	< 0.1 mA
Load capacity	0.5 μ F
Line resistance ⁷	< 200 Ω
Maximum permissible coil energy without external protection elements ⁸	< 0.125 J
Response time	Depends on logic setup (Details: <i>Response times for basic safety functions [chapter 12.1]</i>)

MSI 430.F50

¹ For detailed information regarding the safety configuration of your machine/system, please contact the Leuze electronic branch in charge of your area.

² Do not connect any other safe inputs in parallel when the reverse current could lead to a HIGH state at the other input.

³ When activated; in which case, the outputs are tested regularly (brief LOW switching). When selecting the downstream control elements, make sure that the test pulses will not cause switch-off with the previously listed parameters or deactivate the test pulses at the outputs.

⁴ When safety outputs are being used without test pulses, then either all of the safety outputs without test pulses must be switched off at least once a year simultaneously for at least one second or the MSI 400 system must be restarted by switching off the supply voltage.

⁵ If safety outputs are being used without test pulses:
Use screened or separate cabling for safety outputs without output tests because short-circuits to 24 V will not be immediately detected.

⁶ In the event of a fault (interruption in the 0 V line), the maximum of the leakage current will flow in the OSSD line. The downstream control element must determine this state as being LOW. An FPLC (Failsafe Programmable Logic Controller) must be able to detect this state.

⁷ Limit the line resistance of the individual lines to the downstream control element to this value in order to ensure that a short-circuit will be reliably detected between the outputs. (Also see EN 60204, Safety of machinery - Electrical equipment of machines - Part 1: General requirements.)

⁸ Examples of the resulting maximum coil inductance:
1000 mH @ 0.5 A, 250 mH @ 1 A, 62.5 mH @ 2 A

12.3.2 Safe input/output expansion module

Tab. 12.9: MSI-EM-IO84 data sheet

	MSI-EM-IO84	
Security Integrity Level	SIL3 (IEC 61508)	
SIL claim limit ¹	SILCL3 (EN 62061)	
Category	Category 4 (EN ISO 13849-1)	
Performance level ¹	PL e (EN ISO 13849-1)	
PFHd (average probability of a hazard-causing failure per hour)	3.8E-10 1/h	
T _M (usage time)	20 years (EN ISO 13849) ¹	
Protection class	III (EN 61140)	
Protection type	Terminals: IP 20 (EN 60529) Housing: IP 40 (EN 60529)	
Ambient temperature during operation	-25 ... +65°C	
Storage temperature	-25 ... +70°C	
Humidity	10 to 95%, non-condensing	
Fatigue strength	5 ... 150 Hz (EN 60068-2-6)	
Shock resistance	<ul style="list-style-type: none"> Continuous shock Single shock 	
	10 g, 16 ms (EN 60068-2-29) 30 g, 11 ms (EN 60068-2-27)	
Operating elevation	No more than 2,000 m above sea level (80 kPa)	
Electromagnetic compatibility	Class A (EN 61000-6-2, EN 55011)	
Power consumption via internal safety bus without currents at X1, X2	max. 1.1 W	
Data interface	Internal safety bus	
Plug-in terminal blocks and connection data	Screw terminal	Spring-loaded terminal
Single-wire or fine-strand	1 x 0.2 ... 2.5 mm ² or 2 x 0.2 ... 1.0 mm ²	2 x 0.2 ... 1.5 mm ²
Fine-strand with ferrules as per EN 46228	1 x 0.25 ... 2.5 mm ² or 2 x 0.25 ... 1.0 mm ²	2 x 0.25 ... 1.5 mm ²
Conductor size AWG (use copper cables only)	26 ... 14	24 ... 16
Maximum tightening torque	0.5 ... 0.6 Nm (5 ... 7 lbf-in)	—
Stripping length	7 mm	
Dimensions (W × H × L)	22.5 × 96.5 × 121 mm	22.5 × 107 × 121 mm
Weight	164 g (± 5%)	164 g (± 5%)
Output supply (A1, A2)		
Supply voltage	24 V DC (16.8 to 30 V DC)	
Type of supply voltage	PELV or SELV The current for the powerpack must be limited to a maximum of 4 A – either by the powerpack itself or by a fuse.	
Power consumption	1W	

	MSI-EM-IO84
Switch-on time	Max. 18 s
Short-circuit protective device	4 A gG (with tripping characteristic B or C)
Input circuit (I1–I8)	
Input voltage HIGH	13 to 30 V DC
Input voltage LOW	-5 to +5 V DC
Input current HIGH	2.4 to 3.8 mA
Input current LOW	-2.5 to 2.1 mA
Input reverse current with ground break-down ²	Max. 20 mA 1.5 k Ω effective reverse resistance for supply current
Input capacity	10 nF
Synchronous time	4 ms to 30 ms, configurable
Number of inputs	8
Test outputs (X1, X2)	
Number of outputs	2 (with 2 test signal generators)
Type of output	PNP semi-conductor, short-circuit-proof, short-circuit-monitored (configurable)
Output voltage HIGH	15 to 30 V DC (max. 1.8 V drop to terminal A1 on the controller module)
Output resistance LOW	22 Ω \pm 10%, voltage limited at about 10 mA
Output current	Max. 120 mA at a test output (X1 or X2) Thus, a maximum of eight testable sensor cascades are possible per module with a maximum of 30 mA each. The total current of the MSI 400 system is limited to a maximum of 1.28 A. This corresponds, for example, to a maximum of 32 testable sensor cascades with 30 mA each plus 64 tactile sensors at the inputs of expansion modules with 5 mA each.
Test pulse rate (test period)	1 to 25 Hz, configurable
Test pulse duration (test gap)	1 to 100 ms, configurable
Load capacity	1 μ F for test gap \geq 4 ms 0.5 μ F for test gap 1 ms
Line resistance	< 100 Ω
Safety outputs (Q1 to Q4)	
Number of outputs	4
Type of output	High-side MOSFET, short-circuit-proof
Output voltage HIGH	16 to 30 V DC (max. 0.8 V drop to terminal A1 on this module)
Leakage current LOW ³	Max. 0.1 mA
Output current	Max. 4.0 A
Total current I_{tot}	
TU \leq 45°C	Max. 4.0 A
TU \leq 55°C	Max. 3.2 A
TU \leq 65°C	Max. 2.5 A
UL/CSA applications	Max. 3.2 A
Test pulse width ⁴	< 650 μ s or deactivated ^{5,6}

	MSI-EM-IO84
Test pulse rate	Max. 5 Hz
Load capacity	0.5 μ F
Line resistance ⁷	Max. 5 Ω (e.g. 100 m \times 1.5 mm ² = 1.2 Ω)
Maximum permissible coil energy without external protection elements ⁸	
Hardware version V1.00	0.22 J
Hardware version V1.01	0.37 J
Response time	Depends on logic setup (Details: <i>Response times for basic safety functions [chapter 12.1]</i>)
Data interface	Internal safety bus

¹ For detailed information regarding the safety configuration of your machine/system, please contact the Leuze electronic branch in charge of your area.

² Do not connect any other safe inputs in parallel if the reverse current could lead to a HIGH state at the other input.

³ In the event of a fault (interruption in the 0 V line), the maximum of the leakage current will flow in the OSSD line. The downstream control element must determine this state as being LOW. An FPLC (Failsafe Programmable Logic Controller) must be able to detect this state.

⁴ When activated; in which case, the outputs are tested regularly (brief LOW switching). When selecting the downstream control elements, make sure that the test pulses will not cause switch-off with the previously listed parameters or deactivate the test pulses at the outputs.

⁵ If safety outputs are being used without test pulses, either all of the safety outputs without test pulses must be switched off at least once a year simultaneously for at least one second or the MSI 400 system must be restarted by switching off the supply voltage.

⁶ If safety outputs are being used without test pulses:
Use screened or separate cabling for the safety outputs for which the test pulses must have been deactivated, because a short-circuit to 24 V cannot be immediately detected if the output is HIGH. If an internal hardware error is detected, this could affect the ability to switch off the other outputs through reverse current.

⁷ Limit the line resistance of the individual lines to the downstream control element to this value in order to ensure that a short-circuit will be reliably detected between the outputs. (Also see EN 60204, Safety of machinery - Electrical equipment of machines - Part 1: General requirements.)

⁸ Examples of the resulting maximum coil induction:
HW V1.00: 1760 mH @ 0.5 A, 440 mH @ 1 A, 110 mH @ 2 A
HW V1.01: 2960 mH @ 0.5 A, 740 mH @ 1 A, 185 mH @ 2 A

12.3.3 Safe input expansion module

Tab. 12.10: MSI-EM-I8 data sheet

	MSI-EM-I8	
Safety Integrity Level ¹	SIL3 (IEC 61508)	
Category	Category 4 (EN ISO 13849-1)	
Performance level ¹	PL e (EN ISO 13849-1)	
PFHd (average probability of a hazard-causing failure per hour)	4.5E-10 1/h	
T _M (usage time)	20 years (EN ISO 13849)	
Protection class	III (EN 61140)	
Protection type	Terminals: IP 20 (EN 60529) Housing: IP 40 (EN 60529)	
Ambient temperature during operation	-25 to +55°C	
Storage temperature	-25 to +70°C	
Humidity	10 to 95%, non-condensing	
Climatic conditions	55°C, 95% relative humidity (EN 61131-2)	
Fatigue strength	5 ... 150 Hz (EN 60068-2-6)	
Shock resistance	<ul style="list-style-type: none"> • Continuous shock • Single shock 	
	10 g, 16 ms (EN 60068-2-29) 30 g, 11 ms (EN 60068-2-27)	
Operating elevation	No more than 2,000 m above sea level (80 kPa)	
Electromagnetic compatibility	Class A (EN 61000-6-2, EN 55011)	
Power consumption via internal safety bus without currents at X1 ... X8	Max. 1.4 W	
Data interface	Internal safety bus	
Plug-in terminal blocks and connection data	Screw terminal	Spring-loaded terminal
Single-wire or fine-strand	1 x 0.2–2.5 mm ² 2 x 0.2–1.0 mm ²	2 x 0.2–1.5 mm ²
Fine-strand with ferrules	1 x 0.25–2.5 mm ² 2 x 0.25–1.0 mm ²	2 x 0.25–1.5 mm ²
Conductor size AWG (use copper cables only)	26-14	24-16
Maximum tightening torque	0.5–0.6 Nm (5–7 lbf-in)	—
Stripping length	7 mm	
Dimensions (W × H × L)	22.5 × 96.5 × 121 mm	22.5 × 107 × 121 mm
Weight	139 g (± 5%)	139 g (± 5%)
Input circuit (I1 to I8)		
Input voltage HIGH	13 to 30 V DC	
Input voltage LOW	-5 to +5 V DC	
Input current HIGH	2.4 to 3.8 mA	
Input current LOW	-2.5 to 2.1 mA	
Input reverse current with ground break-down ²	Max. 20 mA 1.5 kΩ effective reverse resistance for supply current	

	MSI-EM-I8
Input capacity	Max. 10 nF
Synchronous time	4 ms to 30 ms, configurable
Number of inputs	8
Test outputs (X1 to X8)	
Number of outputs	8 (with two test signal generators)
Type of output	PNP semi-conductor, short-circuit-proof, cross-connection-monitored
Output voltage	16 to 30 V DC
Output current	<p>Max. 120 mA at both of the two test signal generators (X1/X3/X5/X7 or X2/X4/X6/X8)</p> <p>Thus, a maximum of eight testable sensor cascades are possible per module with a maximum of 30 mA each.</p> <p>The total current of the MSI 400 system is limited to a maximum of 1.28 A. This corresponds, for example, to 32 inputs of testable sensors with 30 mA and 64 inputs of MSI-EM-IO84 or MSI-EM-I8 modules.</p>
Test pulse rate (test period)	1 to 25 Hz, configurable
Test pulse duration (test gap)	1 to 100 ms, configurable
Load capacity	<p>1 μF for test gap \geq 4 ms</p> <p>0.5 μF for test gap 1 ms</p>
Line resistance	< 100 Ω

¹ For detailed information regarding the safety configuration of your machine/system, please contact the Leuze electronic branch in charge of your area.

² Do not connect any other safe inputs in parallel when the reverse current could lead to a HIGH state at the other input.

12.3.4 Standard input/output expansion module

Tab. 12.11: MSI-EM-IO84NP data sheet


	MSI-EM-IO84NP	
Protection class	III (EN 61140)	
Protection type	Terminals: IP 20 (EN 60529) Housing: IP 40 (EN 60529)	
Ambient temperature during operation	-25 ... +55°C	
Storage temperature	-40 ... +70°C	
Humidity	10 ... 95%, non-condensing	
Fatigue strength	5 ... 150 Hz (EN 60068-2-6)	
Shock resistance <ul style="list-style-type: none">• Continuous shock• Single shock	10 g, 16 ms (EN 60068-2-29) 30 g, 11 ms (EN 60068-2-27)	
Operating elevation	No more than 2,000 m above sea level (80 kPa)	
Electromagnetic compatibility	EN 61000 6 2, Class A (EN 55011) Emission EN 61000-6-4 Emission	
Power consumption via the internal safety bus	max. 0.5 W	
Data interface	Internal safety bus	
Plug-in terminal blocks and connection data	Screw terminal	Spring-loaded terminal
Single-wire or fine-strand	1 x 0.2–2.5 mm ² 2 x 0.2–1.0 mm ²	2 x 0.2–1.5 mm ²
Fine-strand with ferrules	1 x 0.25–2.5 mm ² 2 x 0.25–1.0 mm ²	2 x 0.25–1.5 mm ²
Conductor size AWG (use copper cables only)	26-14	24-16
Maximum tightening torque	0.5–0.6 Nm (5–7 lbf-in)	—
Stripping length	7 mm	
Dimensions (W x H x L)	22.5 x 96.5 x 121 mm	22.5 x 107 x 121 mm
Weight	150 g (± 5%)	150 g (± 5%)
Power supply (A1, A2)		
Supply voltage	24 V DC (16.8 to 30 V DC)	
Type of supply voltage	PELV or SELV	
Power consumption	max. 120 W (depending on load)	
Switch-on time	max. 18 s	
Short-circuit protective device	4 A gG (tripping characteristic B or C)	
Input circuit (I1–I4 & IY5-IY8)		
Number of inputs	4 to max. 8 (depending on configuration)	
Input voltage HIGH	13 V DC... 30 V DC	
Input voltage LOW	–3 V DC ... +5 V DC	
Input current HIGH	2 mA ... 3.5 mA	
Input current LOW	0 mA... 1.0 mA	

MSI-EM-IO84NP	
Outputs (Y1-Y4 & IY5-IY8)	
Number of outputs	4 to max. 8 (depending on configuration)
Type of output	High-side MOSFET, short-circuit-proof
Output voltage	24 V DC (16.8 V DC ... 30 V DC)
Output sum current I_{sum} max.	4 A
Output current per output max.	0.5 A
Derating sum current I_{sum} TU $\leq 45^{\circ}\text{C}$ TU $\leq 55^{\circ}\text{C}$ TU $\leq 65^{\circ}\text{C}$	Max. 4.0 A Max. 3.2 A Max. 2.5 A
Response time	Depending on logic setup (Details: <i>Response times for basic safety functions [chapter 12.1]</i>)
Data interface	Internal safety bus


12.4 Dimensional drawings

12.4.1 Controller module

Screw terminal

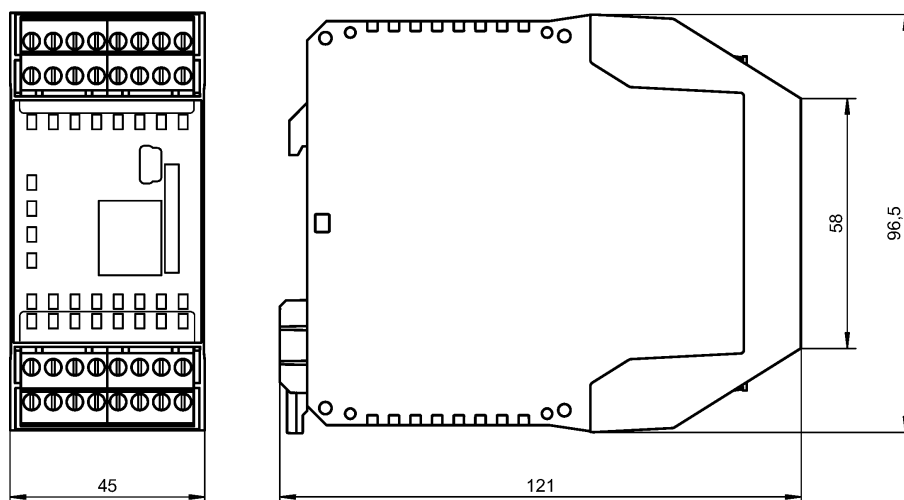


Spring-loaded terminal

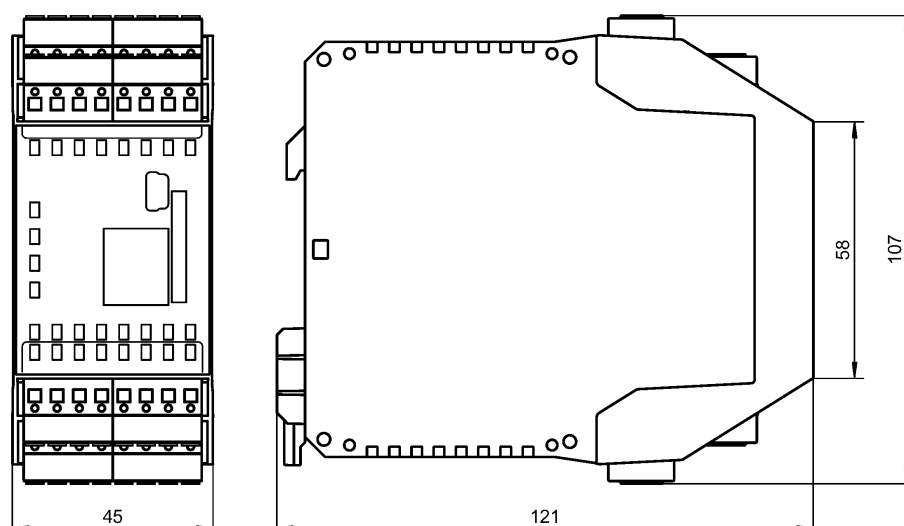


12.4.2 Input/output expansion modules

Screw terminal

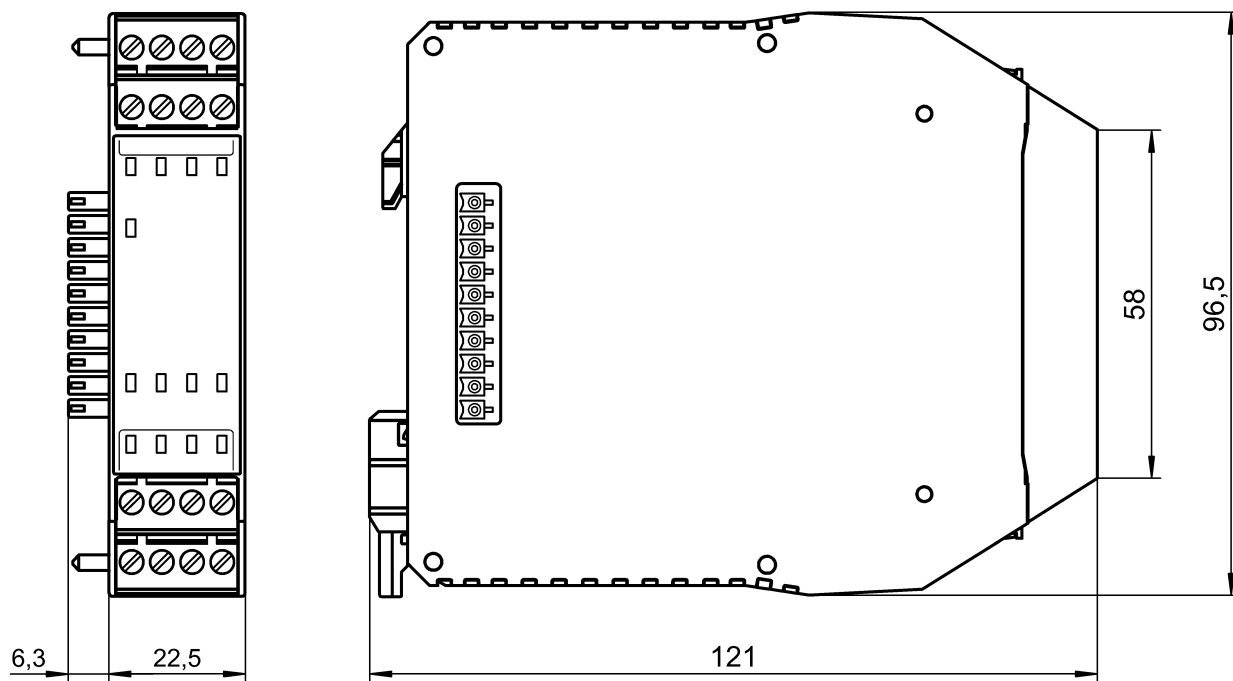

Spring-loaded terminal

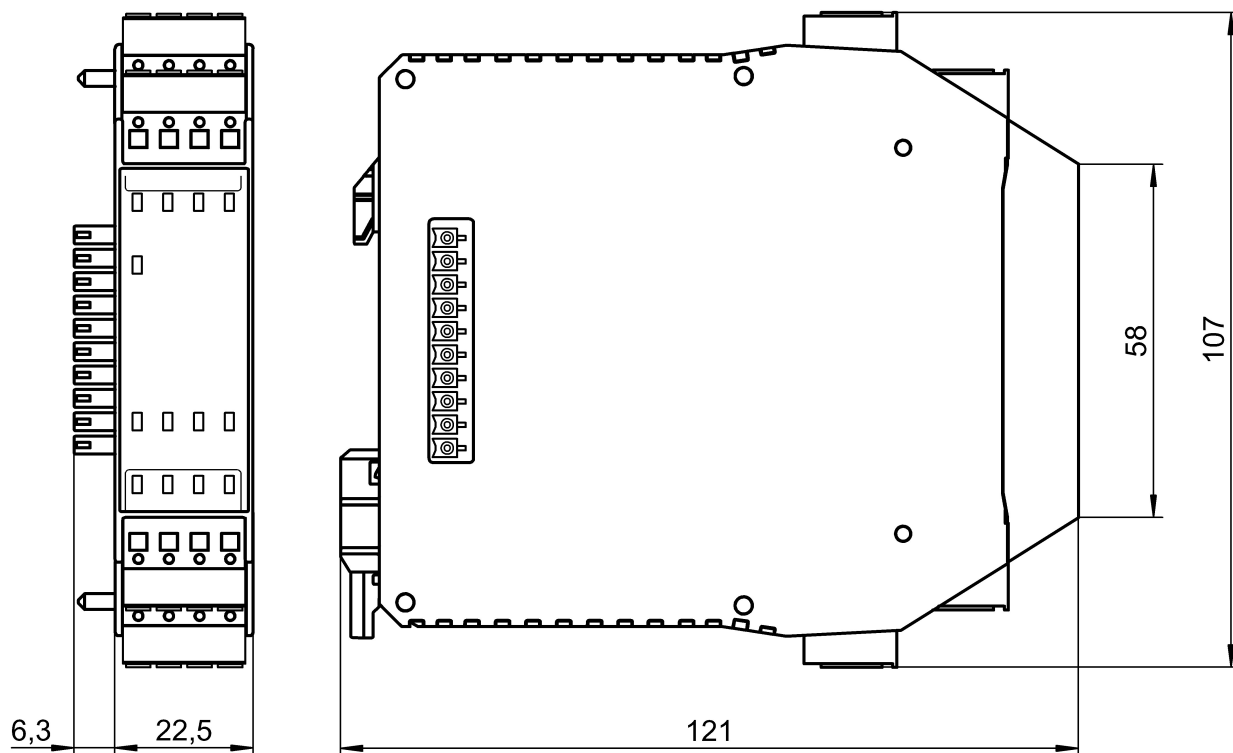

13 Order data

13.1 Hardware modules and accessories

Tab. 13.1: Order numbers for the MSI 400 modules

Type	Description	Part number
MSI 410-01	Controller module, USB connection, 20 inputs / 4 outputs Screw terminals, pluggable	50132984
MSI 410-03	Controller module, USB connection, 20 inputs / 4 outputs Spring-loaded terminals, pluggable	50132985
MSI 420-01	Controller module, USB and Ethernet connection, 16 inputs / 4 outputs and 4 configurable inputs or out- puts Screw terminals, pluggable	50132986
MSI 420-03	Controller module, USB and Ethernet connection, 16 inputs / 4 outputs and 4 configurable inputs or out- puts Spring-loaded terminals, pluggable	50132987
MSI 430-01	Controller module, USB and industrial Ethernet con- nection, 16 inputs / 4 outputs and 4 configurable inputs or out- puts Screw terminals, pluggable	50132988
MSI 430-03	Controller module, USB and industrial Ethernet con- nection, 16 inputs / 4 outputs and 4 configurable inputs or out- puts Spring-loaded terminals, pluggable	50132989
MSI-SD-CARD	Program removable storage	50132996
KB USB A – USB miniB	1.8 m USB configuration capable	50117011
MSI-FB-CANOPEN	CANopen gateway	50132994
MSI-FB-PROFIBUS	PROFIBUS-DP gateway	50132995
MSI-EM-IO84-01	Safe input/output expansion with output test pulses 8 inputs/4 outputs Screw terminals, pluggable	50132990
MSI-EM-IO84-03	Safe input/output expansion with output test pulses 8 inputs/4 outputs Spring-loaded terminals, pluggable	50132991
MSI-EM-I8-01	Safe input expansion 8 inputs Screw terminals, pluggable	50132992
MSI-EM-I8-03	Safe input expansion 8 inputs Spring-loaded terminals, pluggable	50132993

Type	Description	Part number
MSI-EM-IO84NP-01	Standard input/output expansion 4 inputs / 4 outputs and 4 configurable inputs or outputs Screw terminals, pluggable	50132997
MSI-EM-IO84NP-03	Standard input/output expansion 4 inputs / 4 outputs and 4 configurable inputs or outputs Screw-loaded terminals, pluggable	50132998
MSI-FB-ETHERCAT	EtherCAT Gateway	50132999

13.2 Modules for contact expansion

Type	Description	Part number
MSI-SR-CM43-01	Contact expansion, 24 V DC, 4 NC contacts, 3 NO contacts, Screw terminals, pluggable	50133026
MSI-SR-CM43-03	Contact expansion, 24 V DC, 4 NC contacts, 3 NO contacts, Spring-loaded terminals, pluggable	50133027
MSI-SR-CM42R-01	Contact expansion with 2 relay groups, 24 V DC, 2 x 2 NC (normally closed contact), 2 x 1 NO (nor- mally open contact), Screw terminals, pluggable	50133014
MSI-SR-CM42R-03	Contact expansion with 2 relay groups, 24 V DC, 2 x 2 NC (normally closed contact), 2 x 1 NO (nor- mally open contact), Spring-loaded terminals, pluggable	50133015

14 Appendix

14.1 Declaration of Conformity

MSI-4xx



the **sensor** people

EU-/EG-KONFORMITÄTS-ERKLÄRUNG

EU/EC DECLARATION OF CONFORMITY

DECLARATION UE/CE DE CONFORMITE

Hersteller:

Manufacturer:

Constructeur:

Leuze electronic GmbH + Co. KG
In der Braike 1, PO Box 1111
73277 Owen, Germany

Produktbeschreibung:

Sicherheitssteuerung
MSI 410(.F50), MSI 420(.F50),
MSI 430(.F50)

Die alleinige Verantwortung für die Ausstellung dieser Konformitätserklärung trägt der Hersteller.

Der oben beschriebene Gegenstand der Erklärung erfüllt die einschlägigen Harmonisierungsrechtsvorschriften der Union:

Angewandte EU-/EG-Richtlinie(n):
2006/42/EG (*1)
2014/30/EU
2011/65/EU

Description of product:

Safety controller
MSI 410(.F50), MSI 420(.F50),
MSI 430(.F50)

This declaration of conformity is issued under the sole responsibility of the manufacturer.

The object of the declaration described above is in conformity with the relevant Union harmonisation legislation:

Applied EU/EC Directive(s):
2006/42/EC (*1)
2014/30/EU
2011/65/EU

Description de produit:

Commande de sécurité
MSI 410(.F50), MSI 420(.F50),
MSI 430(.F50)

La présente déclaration de conformité est établie sous la seule responsabilité du fabricant.

L'objet de la déclaration décrit ci-dessus est conforme à la législation d'harmonisation de l'Union applicable:

Directive(s) UE/CE appliquées:
2006/42/CE (*1)
2014/30/UE
2011/65/UE

Angewandte harmonisierte Normen / Applied harmonized standards / Normes harmonisées appliquées:

EN ISO 13849-1:2015 (*1)
EN 692:2005+A1:2009 (*1)
EN 13736:2003+A1:2009 (*1)

IEC 62061:2015 (*1)
EN 693:2001+A2:2011 (*1)
EN 61496-1:2013 (in extracts) (*1)

IEC 60204-1:2009 (in extracts) (*1)
EN 12622:2009+A1:2013 (*1)
EN 574:1996+A1:2008 (in extracts) (*1)

Angewandte technische Spezifikationen / Applied technical specifications / Spécifications techniques appliquées:

IEC 61508 Part 1-7:2010 (*1)
IEC 61511-1:2016 (*1)

EN 50156-1:2015 (*1)
EN 61131-2: 2012

EN 50178:1997 (*1)
EN 61131-6:2012 (*1)

Notified Body

(*1) TÜV Rheinland Industrie Service GmbH, Am Grauen Stein, 51105 Koeln, 01/205/5534.00/16, NB 0035

Dokumentationsbevollmächtigter ist der genannte Hersteller, Kontakt: quality@leuze.de.

Authorized for documentation is the stated manufacturer, contact: quality@leuze.de.

Autorisé pour documentation est le constructeur déclaré, contact: quality@leuze.de

2014/30/EU veröffentlicht: 29.03.2014, EU-Amtsblatt Nr. L 96/79-106; 2014/30/EU published: 29.03.2014, EU-Journal No. L 96/79-106; 2014/30/UE publié: Journal EU n° L 96/79-106


Datum / Date / Date
Ulrich Balbach,
Geschäftsführer / Managing Director / Gérant


i.A. Fabien Zelenda
Quality Management Central Functions

Leuze electronic GmbH + Co. KG
In der Braike 1
D-73277 Owen
Telefon +49 (0) 7021 573-0
Telefax +49 (0) 7021 573-199
info@leuze.de
www.leuze.com

LEO-ZQM-148-07-FO

Leuze electronic GmbH + Co. KG, Sitz Owen, Registergericht Stuttgart, HRA 230712
Persönlich haftende Gesellschafterin Leuze electronic Geschäftsführungs-GmbH,
Sitz Owen, Registergericht Stuttgart, HRB 230550
Geschäftsführer: Ulrich Balbach
USt-IdNr. DE 145912521 | Zollnummer 2554232
Es gelten ausschließlich unsere aktuellen Verkaufs- und Lieferbedingungen
Only our current Terms and Conditions of Sale and Delivery shall apply



MSI-EM-IO84



the **sensor** people

EU-/EG-KONFORMITÄTS-ERKLÄRUNG

EU/EC DECLARATION OF CONFORMITY

DECLARATION UE/CE DE CONFORMITE

Hersteller:

Manufacturer:

Constructeur:

Leuze electronic GmbH + Co. KG
In der Braike 1, PO Box 1111
73277 Owen, Germany

Produktbeschreibung:

Description of product:

Description de produit:

**Sicheres I/O-Modul
MSI-EM-IO84**

**Safety I/O-Module
MSI-EM-IO84**

**Module d'Entrées / Sorties de
sécurité
MSI-EM-IO84**

Die alleinige Verantwortung für die Ausstellung dieser Konformitätserklärung trägt der Hersteller.

This declaration of conformity is issued under the sole responsibility of the manufacturer.

La présente déclaration de conformité est établie sous la seule responsabilité du fabricant.

Der oben beschriebene Gegenstand der Erklärung erfüllt die einschlägigen Harmonisierungsrechtsvorschriften der Union:

The object of the declaration described above is in conformity with the relevant Union harmonisation legislation:

L'objet de la déclaration décrit ci-dessus est conforme à la législation d'harmonisation de l'Union applicable:

Angewandte EU-/EG-Richtlinie(n):

Applied EU/EC Directive(s):

Directive(s) UE/CE appliquées:

2006/42/EG (*1)
2014/30/EU
2011/65/EU

2006/42/EC (*1)
2014/30/EU
2011/65/EU

2006/42/CE (*1)
2014/30/UE
2011/65/UE

Angewandte harmonisierte Normen / Applied harmonized standards / Normes harmonisées appliquées:

EN ISO 13849-1:2015 (*1)
EN 692:2005+A1:2009 (*1)
EN 13736:2003+A1:2009 (*1)

IEC 62061:2015 (*1)
EN 693:2001+A2:2011 (*1)
EN 61496-1:2013 (in extracts) (*1)

IEC 60204-1:2009 (in extracts) (*1)
EN 12622:2009+A1:2013 (*1)
EN 574:1996+A1:2008 (in extracts) (*1)

Angewandte technische Spezifikationen / Applied technical specifications / Spécifications techniques appliquées:

IEC 61508 Part 1-7:2010 (*1)
IEC 61511-1:2016 (*1)

EN 50156-1:2015 (*1)
EN 61131-2: 2012

EN 50178:1997 (*1)
EN 61131-6:2012 (*1)

Notified Body

(*1) TÜV Rheinland Industrie Service GmbH, Am Grauen Stein, 51105 Koeln, 01/205/5534.00/16, NB 0035
Dokumentationsbevollmächtigter ist der genannte Hersteller, Kontakt: quality@leuze.de.
Authorized for documentation is the stated manufacturer, contact: quality@leuze.de.
Autorisé pour documentation est le constructeur déclaré, contact: quality@leuze.de

2014/30/EU veröffentlicht: 29.03.2014, EU-Amtsblatt Nr. L 96/79-106; 2014/30/EU published: 29.03.2014, EU-Journal No. L 96/79-106; 2014/30/UE publié: Journal EU n° L 96/79-106

Datum / Date / Date

Ulrich Balbach,
Geschäftsführer / Managing Director / Gérant

i.A. Fabien Zelenda
Quality Management Central Functions

Leuze electronic GmbH + Co. KG
In der Braike 1
D-73277 Owen
Telefon +49 (0) 7021 573-0
Telefax +49 (0) 7021 573-199
info@leuze.de
www.leuze.com

LEO-ZQM-148-07-FO

Leuze electronic GmbH + Co. KG, Sitz Owen, Registergericht Stuttgart, HRA 230712
Persönlich haftende Gesellschafterin Leuze electronic Geschäftsführungs-GmbH,
Sitz Owen, Registergericht Stuttgart, HRB 230550

Geschäftsführer: Ulrich Balbach
USt-IdNr. DE 145912521 | Zollnummer 2554232

Es gelten ausschließlich unsere aktuellen Verkaufs- und Lieferbedingungen
Only our current Terms and Conditions of Sale and Delivery shall apply



MSI-EM-18



the **sensor** people

EU-/EG-KONFORMITÄTS-ERKLÄRUNG

EU/EC DECLARATION OF CONFORMITY

DECLARATION UE/CE DE CONFORMITE

Hersteller:

Manufacturer:

Constructeur:

Leuze electronic GmbH + Co. KG
In der Braike 1, PO Box 1111
73277 Owen, Germany

Produktbeschreibung:

Description of product:

Description de produit:

**Sicheres Eingangsmodul
MSI-EM-18**

**Safety IN-Module
MSI-EM-18**

**Module d'Entrées de sécurité
MSI-EM-18**

Die alleinige Verantwortung für die Ausstellung dieser Konformitätserklärung trägt der Hersteller.

This declaration of conformity is issued under the sole responsibility of the manufacturer.

La présente déclaration de conformité est établie sous la seule responsabilité du fabricant.

Der oben beschriebene Gegenstand der Erklärung erfüllt die einschlägigen Harmonisierungsrechtsvorschriften der Union:

The object of the declaration described above is in conformity with the relevant Union harmonisation legislation:

L'objet de la déclaration décrit ci-dessus est conforme à la législation d'harmonisation de l'Union applicable:

Angewandte EU-/EG-Richtlinie(n):

Applied EU/EC Directive(s):

Directive(s) UE/CE appliquées:

2006/42/EG (*1)
2014/30/EU
2011/65/EU

2006/42/EC (*1)
2014/30/EU
2011/65/EU

2006/42/CE (*1)
2014/30/UE
2011/65/UE

Angewandte harmonisierte Normen / Applied harmonized standards / Normes harmonisées appliquées:

EN ISO 13849-1:2015 (*1)
EN 692:2005+A1:2009 (*1)
EN 13736:2003+A1:2009 (*1)

IEC 62061:2015 (*1)
EN 693:2001+A2:2011 (*1)
EN 61496-1:2013 (in extracts) (*1)

IEC 60204-1:2009 (in extracts) (*1)
EN 12622:2009+A1:2013 (*1)
EN 574:1996+A1:2008 (in extracts) (*1)

Angewandte technische Spezifikationen / Applied technical specifications / Spécifications techniques appliquées:

IEC 61508 Part 1-7:2010 (*1)
IEC 61511-1:2016 (*1)

EN 50156-1:2015 (*1)
EN 61131-2: 2012

EN 50178:1997 (*1)
EN 61131-6:2012 (*1)

Notified Body

(*1) TÜV Rheinland Industrie Service GmbH, Am Grauen Stein, 51105 Koeln, 01/205/5534.00/16, NB 0035

Dokumentationsbevollmächtigter ist der genannte Hersteller, Kontakt: quality@leuze.de.

Authorized for documentation is the stated manufacturer, contact: quality@leuze.de.

Autorisé pour documentation est le constructeur déclaré, contact: quality@leuze.de.

2014/30/EU veröffentlicht: 29.03.2014, EU-Amtsblatt Nr. L 96/79-106; 2014/30/EU published: 29.03.2014, EU-Journal No. L 96/79-106; 2014/30/UE publié: Journal EU n° L 96/79-106

16.3.2017
Datum / Date / Date

Ulrich Balbach,
Geschäftsführer / Managing Director / Gérant

i.A. Fabien Zelenda

i.A. Fabien Zelenda
Quality Management Central Functions

Leuze electronic GmbH + Co. KG
In der Braike 1
D-73277 Owen
Telefon +49 (0) 7021 573-0
Telefax +49 (0) 7021 573-199
info@leuze.de
www.leuze.com

Leuze electronic GmbH + Co. KG, Sitz Owen, Registergericht Stuttgart, HRA 230712
Persönlich haftende Gesellschafterin Leuze electronic Geschäftsführungs-GmbH,
Sitz Owen, Registergericht Stuttgart, HRB 230550
Geschäftsführer: Ulrich Balbach
USt-IdNr. DE 145912521 | Zollnummer 2554232
Es gelten ausschließlich unsere aktuellen Verkaufs- und Lieferbedingungen
Only our current Terms and Conditions of Sale and Delivery shall apply

LEO-ZQM-148-07-FO



MSI-EM-IO84NP



the **sensor** people

EU-/EG-KONFORMITÄTS-ERKLÄRUNG

EU/EC DECLARATION OF CONFORMITY

DECLARATION UE/CE DE CONFORMITE

Hersteller:

Manufacturer:

Constructeur:

Leuze electronic GmbH + Co. KG
In der Braike 1, PO Box 1111
73277 Owen, Germany

Produktbeschreibung:

Description of product:

Description de produit:

**Nicht-sicheres I/O-Modul
MSI-EM-IO84NP**

**Non-Safety I/O-Module
MSI-EM-IO84NP**

**Module d'Entrées / Sorties
MSI-EM-IO84NP**

Die alleinige Verantwortung für die Ausstellung dieser Konformitätserklärung trägt der Hersteller.

This declaration of conformity is issued under the sole responsibility of the manufacturer.

La présente déclaration de conformité est établie sous la seule responsabilité du fabricant.

Der oben beschriebene Gegenstand der Erklärung erfüllt die einschlägigen Harmonisierungsrechtsvorschriften der Union:

The object of the declaration described above is in conformity with the relevant Union harmonisation legislation:

L'objet de la déclaration décrit ci-dessus est conforme à la législation d'harmonisation de l'Union applicable:

Angewandte EU-/EG-Richtlinie(n):

Applied EU/EC Directive(s):

Directive(s) UE/CE appliquées:

2006/42/EG (*1)
2014/30/EU
2011/65/EU

2006/42/EC (*1)
2014/30/EU
2011/65/EU

2006/42/CE (*1)
2014/30/UE
2011/65/UE

Angewandte harmonisierte Normen / Applied harmonized standards / Normes harmonisées appliquées:

EN ISO 13849-1:2015 (*1)
EN 692:2005+A1:2009 (*1)
EN 13736:2003+A1:2009 (*1)

IEC 62061:2015 (*1)
EN 693:2001+A2:2011 (*1)
EN 61496-1:2013 (in extracts) (*1)

IEC 60204-1:2009 (in extracts) (*1)
EN 12622:2009+A1:2013 (*1)
EN 574:1996+A1:2008 (in extracts) (*1)

Angewandte technische Spezifikationen / Applied technical specifications / Spécifications techniques appliquées:

IEC 61508 Part 1-7:2010 (*1)
IEC 61511-1:2016 (*1)

EN 50156-1:2015 (*1)
EN 61131-2: 2012

EN 50178:1997 (*1)
EN 61131-6:2012 (*1)

Notified Body

(*1) TÜV Rheinland Industrie Service GmbH, Am Grauen Stein, 51105 Köln, 01/205/5534.00/16, NB 0035

Dokumentationsbevollmächtigter ist der genannte Hersteller, Kontakt: quality@leuze.de.

Authorized for documentation is the stated manufacturer, contact: quality@leuze.de.

Autorisé pour documentation est le constructeur déclaré, contact: quality@leuze.de

2014/30/EU veröffentlicht: 29.03.2014, EU-Amtsblatt Nr. L 96/79-106; 2014/30/EU published: 29.03.2014, EU-Journal No. L 96/79-106; 2014/30/UE publié: Journal EU n° L 96/79-106

16.3.2017
Datum / Date / Date

Ulrich Balbach,
Geschäftsführer / Managing Director / Gérant

i.A. Fabien Zelenda

i.A. Fabien Zelenda
Quality Management Central Functions

Leuze electronic GmbH + Co. KG
In der Braike 1
D-73277 Owen
Telefon +49 (0) 7021 573-0
Telefax +49 (0) 7021 573-199
info@leuze.de
www.leuze.de

Leuze electronic GmbH + Co. KG, Sitz Owen, Registergericht Stuttgart, HRA 230712
Persönlich haftende Gesellschafterin Leuze electronic Geschäftsführungs-GmbH,
Sitz Owen, Registergericht Stuttgart, HRB 230659

Geschäftsführer: Ulrich Balbach
USt-IdNr. DE 145912621 | Zollnummer 2554232

Es gelten ausschließlich unsere aktuellen Verkaufs- und Lieferbedingungen
Only our current Terms and Conditions of Sale and Delivery shall apply


LEO-ZQM-148-07-FO



14.2 Checklist for manufacturers

The information in the following points must be available at least during first-time commissioning. It may vary depending on the application and the requirements from the manufacturer/supplier must be checked.

This checklist should be retained or stored with the machine documents so that it can be used as a reference during recurring tests.

NOTICE	
	This checklist is not a replacement for the first-time commissioning or the regular testing done by a qualified person.

Tab. 14.1: Checklist for first-time commissioning

Question	Yes		No	
Were the safety guidelines according to the directives/standards valid for the machine used as a basis?	Yes	<input type="radio"/>	No	<input type="radio"/>
Are the directives and standards used listed in the Declaration of Conformity?	Yes	<input type="radio"/>	No	<input type="radio"/>
Does the safety equipment correspond to the required category?	Yes	<input type="radio"/>	No	<input type="radio"/>
Are the required protective measures against electric shock effective (protection class)?	Yes	<input type="radio"/>	No	<input type="radio"/>
Has the protective function been checked in accordance with the testing information in this documentation? In particular: <ul style="list-style-type: none"> Functional check of the command devices, sensors, and actuators connected to the safety controller Test of all switch-off paths 	Yes	<input type="radio"/>	No	<input type="radio"/>
Have you ensured that a complete test of the safety functions has been carried out after every configuration change to the safety controller?	Yes	<input type="radio"/>	No	<input type="radio"/>

14.3 List of all error messages, causes and aids

Tab. 14.2: Controller module error messages

Error No.	Error type	Logbook message	System behavior	Remedy
00000001	Info	Log generator info function block	System continues to run	-
00000002	Warning	Log generator warning function block	System continues to run	-
00000003	Error	Log generator error function block	System continues to run	-
10100001	Error	An unknown error occurred.	Disconnection	Support request
10100002	Error	An internal error occurred.	Disconnection	Support request
10100003	Error	Time exceeded when preparing a message for the control.	No connection	Check connection
10100004	Error	The value cannot be forced, because force mode is inactive.	Remains connected	Activate force mode
10100005	Error	The controller does not support the message type.	Disconnection	Support request
10100006	Error	The hash value of a read file is not valid.	Disconnection	Support request
10100007	Error	The header size in the message from the control is not plausible.	Disconnection	Support request

Error No.	Error type	Logbook message	System behavior	Remedy
10100008	Error	The user data size in the message from the control is not plausible.	Disconnection	Support request
10100009	Error	The total data size does not match the number of received data.	Disconnection	Repeat Support request
1010000 A	Error	A data flow error in a segmented read message occurred.	No connection	Repeat Support request
1010000B	Error	The checksum in a message from the control is not valid.	Disconnection	Support request
1010000C	Error	Timeout when sending a message to the controller. Possible causes: There is already a communication link to the controller; The Ethernet or USB connection was interrupted.	Disconnection	Check connection support request
1010000D	Error	Timeout when receiving a message from the controller. Possible causes: There is already a communication link to the controller; The Ethernet or USB connection was interrupted.	Disconnection	Check connection support request
1010000E	Error	Unexpected message received.	Disconnection	Support request
1010000F	Error	The message from the control is corrupt.	Disconnection	Support request
10100010	Error	The message from the control is corrupt.	Disconnection	Support request
10100011	Error	The message to the control could not be processed.	Disconnection	Repeat Support request
10100012	Error	The control could not positively respond to the request.	Remains connected	Repeat Repair SD card Support request
10100013	Error	The number of request retries has been exceeded.	Disconnection	Repeat Support request
10100015	Error	Communication to the control could not be established.	No connection	Check connection support request
10100016	Error	The password is not valid for the user to be logged on.	Remains connected	Check password
10100017	Error	The control could not accept the desired state.	Remains connected	Repeat Support request
10100018	Error	The memory card of the station is not plugged in.	Disconnection	Insert valid SD card
10200002	Error	The project on the control is invalid.	No connection	Transfer a new valid project
10200003	Error	The verification status of project and control is not the same.	No connection	Reverify the project
10200004	Error	The PC project and project on the control could not be synched.	No connection	Disconnect and re-connect support request

Error No.	Error type	Logbook message	System behavior	Remedy
10200005	Error	The current user does not have authorization to communicate with the controller. Connection was disconnected.	No connection	Redefine the user rights
10200006	Warning	The project on the target does not match the module configuration.	Remains connected	Adjust hardware or project
10200007	Error	An error is reported by the control.	-	Support request
10200008	Error	The controller reports a different CRC of the project file.	-	Repeat of Support request work step
10200009	Error	The waiting time permitted for the project has been exceeded.	-	Repeat Support request
1020000 A	Info	The verification has been interrupted.	-	Repeat Support request
1020000B	Warning	The faulty project file is still in the station and must be replaced by the updated project file. Please reconnect and load the updated project on the station.	-	Update the device with the repaired project
10300001	Error	The logic analyzer data could not be saved.	-	Check Windows user privileges
10300002	Error	The logic analyzer data could not be loaded.	-	Repeat Support request
10300003	Error	Input/output was not found.	-	Support request
10400001	Error	The log messages could not be saved.	-	Check Windows user privileges
10400002	Error	The file contains more than 64 log messages. Only the first 64 were imported.	-	Reduce the number of log messages
10400003	Error	The log messages could not be imported.	-	Support request
10500001	Error	Login to control failed.	-	Repeat Support request
10600001	Error	This user already exists. Please select a different name.	-	Use another name
10600002	Error	Could not import user list.	-	Repeat Support request
10600003	Warning	The following users were not imported, since they already exist.	-	-
10700001	Error	Project file could not be loaded. File format is not correct.	-	Search for a new program version: Main menu > via > Update, or support request
10700002	Error	Creating project from module configuration failed!	-	Search for a new program version: Main menu > via > Update, or support request
10700003	Error	Project file could not be saved!	-	Check Windows user privileges

Error No.	Error type	Logbook message	System behavior	Remedy
10700004	Error	Project file could not be loaded. File format is not correct.	-	Search for a new program version: Main menu > via > Update, or support request
10700005	Error	Library file could not be loaded. File format is not correct.	-	Search for a new program version: Main menu > via > Update, or support request
10700006	Error	Faulty project structure.	-	Search for a new program version: Main menu > via > Update, or support request
10700008	Error	Setting data could not be loaded. Faulty file.	-	Search for a new program version: Main menu > via > Update, or support request
10700009	Error	Failed to import library, since corresponding elements already exist.	-	-
1070000A	Error	File cannot be loaded, incorrect signature.	-	Search for a new program version: Main menu > via > Update, or support request
1070000B	Error	The gateway configuration could not be opened. The configuration is for a different gateway type.	-	-
1070000C	Error	The version of the project file is not supported by this program version.	-	Search for a new program version: Main menu > via > Update, or support request
1070000D	Error	The configuration data for a module could not be correctly loaded.	-	Search for a new program version: Main menu > via > Update, or support request
10800001	Warning	Forcing more than 10 values is not permitted.	-	-
11000000	Error	HTML help could not be found. Please check whether it was installed correctly.	-	Reinstall or repair the program, Support request
12000000	Error	The version information was incorrect. Please contact support.	-	Support request
12000001	Error	No connection to the update server. Please check the Internet connection.	-	Check Internet connection
13000000	Error	The test gaps exceed half the maximum period.	-	Check the test parameters
13000001	Error	The test period exceeds the input's maximum test period.	-	Check the test parameters

Error No.	Error type	Logbook message	System behavior	Remedy
13000002	Error	A test period with these minimum and maximum values cannot be configured.	-	Check the test parameters
13000003	Error	The test gaps exceed half the period.	-	Check the test parameters
13000004	Error	The required test parameters are not possible for at least one element on the module.	-	Check the test parameters
14000000	Error	Error in the logic configuration	-	Support request
14000001	Error	No enough space to insert elements on logic page.	-	Insert new logic page and reorganize function blocks
14000002	Warning	Elements could not be grouped.	-	-
14000003	Error	An element is only allowed for groupings.	-	-
14000004	Error	Maximum number of function blocks have already been created.	-	Simplify logic
14000005	Error	Failed to create residual memory.	-	Support request
14000006	Error	An element is not allowed for grouping.	-	-
14000007	Error	Function blocks are not compatible with the selected controller module.	-	If you use this controller module, the corresponding function blocks will be deleted.
14000008	Error	Selection cannot be grouped because there are more than 8 connections to inputs.	-	-
14000009	Error	Selection cannot be grouped because there are more than 8 connections to outputs.	-	-
1400000 A	Error	No functional blocks have been selected to group.	-	-
15000001	Error	CRC calculation failed	-	Repeat Support request
15000002	Error	Report generation failed	-	Repeat Support request
22010140	Warning	Error in system configuration	System continues to run	Reload system configuration
220101F5	Warning	Error in system configuration	Config required	Reload system configuration
220101F6	Warning	Error in system configuration	Config required	Reload system configuration
220101F7	Warning	Error in system configuration	Config required	Reload system configuration
220101F8	Warning	Error in system configuration	Config required	Reload system configuration
220101F9	Warning	Error in system configuration	Config required	Reload system configuration

Error No.	Error type	Logbook message	System behavior	Remedy
220101FA	Warning	Error in system configuration	Config required	Reload system configuration
220101FC	Warning	Error in system configuration	Config required	Reload system configuration
22010226	Warning	Error in system configuration	Config required	Reload system configuration
22010227	Warning	Error in system configuration	Config required	Reload system configuration
22010228	Warning	Error in system configuration	Config required	Reload system configuration
22010231	Warning	Pulse period 0 must have pulse length 0.	Configuration required	Change system configuration and reload
22010232	Warning	Pulse length must be \leq pulse period/2.	Configuration required	Change system configuration and reload
22010233	Warning	Impermissible test period (permissible: 0,40,200,400,600,800,1000).	Config required	Change system configuration and reload
22010234	Warning	Pulse length must be 4..100ms in increments of 4ms	Configuration required	Change system configuration and reload
22010240	Warning	Maximum function block count or mapping exceeded	Configuration required	Change system configuration and reload
22010241	Warning	There is not an appropriate number of I/O modules for the project	Configuration required	Change system configuration and reload
22010242	Warning	There is not an appropriate number of gateway modules for the project.	Configuration required	Change system configuration and reload
22010244	Warning	The type or major version of the I/O module is inappropriate for the project	Configuration required	Change system configuration and reload
22010245	Warning	The type or major version of the gateway module is inappropriate for the project	Configuration required	Change system configuration and reload
22010250	Warning	The press function components are not supported by this device version	Configuration required	Change system configuration and reload
22011243	Warning	Incorrect device name or safety category of the module	Configuration required	Change system configuration and reload
22012243	Warning	Incorrect module type	Configuration required	Change system configuration and reload
22013243	Warning	Incorrect number of inputs	Configuration required	Change system configuration and reload
22014243	Warning	Incorrect number of outputs	Configuration required	Change system configuration and reload

Error No.	Error type	Logbook message	System behavior	Remedy
22015243	Warning	Incorrect manufacturer	Configuration required	Change system configuration and reload
22016243	Warning	Software version not supported	Configuration required	Change system configuration and reload
22017243	Warning	Software identification 'V' not found	Configuration required	Change system configuration and reload
2201xxxx	Warning	Error in the configuration	Configuration required	Change system configuration and reload
23010001	Warning	Sequence error at I1/I2	System continues to run	-
23010003	Warning	Sequence error at I3/I4	System continues to run	-
23010005	Warning	Sequence error at I5/I6	System continues to run	-
23010007	Warning	Sequence error at I7/I8	System continues to run	-
23010009	Warning	Sequence error at I9/I10	System continues to run	-
2301000B	Warning	Sequence error at I11/I12	System continues to run	-
2301000D	Warning	Sequence error at I13/I14	System continues to run	-
2301000F	Warning	Sequence error at I15/I16	System continues to run	-
23010011	Warning	Sequence error at IQ1/IQ2	System continues to run	-
23010013	Warning	Sequence error at IQ3/IQ4	System continues to run	-
2301xxxx	Warning	Sequence error at 2-channel input	System continues to run	-
23020001	Warning	Synchronization time error I1/I2	System continues to run	-
23020003	Warning	Synchronization time error I3/I4	System continues to run	-
23020005	Warning	Synchronization time error I5/I6	System continues to run	-
23020007	Warning	Synchronization time error I7/I8	System continues to run	-
23020009	Warning	Synchronization time error I9/I10	System continues to run	-
2302000B	Warning	Synchronization time error I11/I12	System continues to run	-
2302000D	Warning	Synchronization time error I13/I14	System continues to run	-
2302000F	Warning	Synchronization time error I15/I16	System continues to run	-

Error No.	Error type	Logbook message	System behavior	Remedy
23020011	Warning	Synchronization time error IQ1/IQ2	System continues to run	-
23020013	Warning	Synchronization time error IQ3/IQ4	System continues to run	-
2302xxxx	Warning	Synchronization time error at 2-channel input	System continues to run	-
23100100	Info	Sensor error rectified	System continues to run	-
23100204	Warning	Different rotational direction	System continues to run	Check motion sensor
23100207	Warning	Error in system configuration	System continues to run	Change system configuration and reload
23100211	Warning	Frequency at I13/I15 too high	System continues to run	Check motion sensor
23100212	Warning	Frequency at I14/I16 too high	System continues to run	Check motion sensor
2310021x	Warning	Sensor frequency too high	System continues to run	Check motion sensor
23100221	Warning	Phase error, sensor signal A B at I13/I15	System continues to run	Check motion sensor
23100222	Warning	Phase error, sensor signal A B at I14/I16	System continues to run	Check motion sensor
2310022x	Warning	Phase error, sensor signals A B	System continues to run	Check motion sensor
23100231	Warning	Error of inverted sensor signal at I13/I14	System continues to run	Check motion sensor
23100232	Warning	Error of inverted sensor signal at I13/I15	System continues to run	Check motion sensor
23100234	Warning	Error of inverted sensor signal at I14/I16	System continues to run	Check motion sensor
23100238	Warning	Error of inverted sensor signal at I15/I16	System continues to run	Check motion sensor
2310023x	Warning	Error of inverted sensor signals	System continues to run	Check motion sensor
23100241	Warning	Frequency difference of individual channels at I13/I15	System continues to run	Check motion sensor
23100242	Warning	Frequency difference of individual channels at I14/I16	System continues to run	Check motion sensor
2310024x	Warning	Frequency difference of individual channels on multichannel sensor	System continues to run	Check motion sensor
2310025x	Warning	EMC malfunction	System continues to run	Check EMC environment
2310026x	Warning	Interruption at push/pull sensor output	System continues to run	Check motion sensor
23100270	Warning	Discrepancy in data flow I13 .. I16	System continues to run	Check EMC environment

Error No.	Error type	Logbook message	System behavior	Remedy
23100271	Warning	Discrepancy in counter at I13 .. I16	System continues to run	Check motion sensor, check EMC environment
2310030x	Warning	Stuck-at at I13 or I14	System continues to run	Check motion sensor
231003x0	Warning	Stuck-at at I15 or I16	System continues to run	Check motion sensor
23100401	Warning	Maximum position value exceeded	System continues to run	Check motion sensor
23100403	Warning	Maximum speed exceeded	System continues to run	Check motion sensor
23100404	Warning	No valid information on rotational direction	System continues to run	Check motion sensor
23100405	Warning	Speed comparison outside of limit	System continues to run	Check motion sensor
23100406	Warning	Position comparison outside limit	System continues to run	Check motion sensor
23100407	Warning	Error in system configuration	System continues to run	Change system configuration and reload
23100408	Warning	Maximum position exceeded	System continues to run	Check motion sensor
23100409	Warning	Minimum position undershot	System continues to run	Check motion sensor
23100501	Info	No sensor signal	System continues to run	Check motion sensor
240A0000	Warning	Output error at Q1	System continues to run; affected outputs switch off	Check outputs
240A0001	Warning	Output error at Q2	System continues to run; affected outputs switch off	Check outputs
240A0002	Warning	Output error at Q3	System continues to run; affected outputs switch off	Check outputs
240A0003	Warning	Output error at Q4	System continues to run; affected outputs switch off	Check outputs
240A0004	Warning	Output error at IQ1	System continues to run; affected outputs switch off	Check outputs
240A0005	Warning	Output error at IQ2	System continues to run; affected outputs switch off	Check outputs
240A0006	Warning	Output error at IQ3	System continues to run; affected outputs switch off	Check outputs
240A0007	Warning	Output error at IQ4	System continues to run; affected outputs switch off	Check outputs

Error No.	Error type	Logbook message	System behavior	Remedy
240A0008	Warning	Output error at group Q1/Q2	System continues to run; affected outputs switch off	Check outputs
240A0009	Warning	Output error at group Q3/Q4	System continues to run; affected outputs switch off	Check outputs
240A000A	Warning	Output error at group IQ1/IQ2	System continues to run; affected outputs switch off	Check outputs
240A000B	Warning	Output error at group IQ3/IQ4	System continues to run; affected outputs switch off	Check outputs
240Axxxx	Error	Output error	System stop; voltage OFF-ON required	Check outputs
240B0001	Info	Output error at Q1/Q2 rectified	System continues to run	-
240B0002	Info	Output error at Q3/Q4 rectified	System continues to run	-
240B0003	Info	Output error at IQ1/IQ2 rectified	System continues to run	-
240B0004	Info	Output error at IQ3/IQ4 rectified	System continues to run	-
240Bxxxx	Info	Output error rectified	System continues to run	-
240Dxxxx	Error	Error in system configuration	System stop; voltage OFF-ON required	Reload system configuration and restart
240Exxxx	Warning	Problem with force mode	System continues to run	Restart forcing
240Fxxxx	Warning	Problem with force mode	System continues to run	Restart forcing
2410xxxx	Warning	Problem with force mode	System continues to run	Restart forcing
2411xxxx	Warning	Problem with force mode	System continues to run	Restart forcing
2412xxxx	Warning	Problem with force mode	System continues to run	Restart forcing
2413xxxx	Warning	Problem with force mode	System continues to run	Restart forcing
2414xxxx	Warning	Problem with force mode	System continues to run	Restart forcing
2415xxxx	Warning	Problem with force mode	System continues to run	Restart forcing
2416xxxx	Warning	Connection problem	System stop	Restart
2417xxxx	Warning	Force mode time expired	System continues to run	-
2418xxxx	Error	Internal error	System stop; voltage OFF-ON required	Restart or make complaint

Error No.	Error type	Logbook message	System behavior	Remedy
2419xxxx	Warning	Error in system configuration.	System continues to run	Reload system configuration
241Axxxx	Warning	Output error	System continues to run	Check outputs
241B0001	Warning	Stuck-at-high at Q1	System continues to run	Check outputs
241B0002	Warning	Stuck-at-high at Q2	System continues to run	Check outputs
241B0003	Warning	Stuck-at-high at Q3	System continues to run	Check outputs
241B0004	Warning	Stuck-at-high at Q4	System continues to run	Check outputs
241B0005	Warning	Stuck-at-high at IQ1	System continues to run	Check outputs
241B0006	Warning	Stuck-at-high at IQ2	System continues to run	Check outputs
241B0007	Warning	Stuck-at-high at IQ3	System continues to run	Check outputs
241B0008	Warning	Stuck-at-high at IQ4	System continues to run	Check outputs
241Bxxxx	Warning	Output error	System continues to run	Check outputs
241D0001	Warning	Test pulse error at I1	System continues to run	Check cabling
241D0002	Warning	Test pulse error at I2	System continues to run	Check cabling
241D0003	Warning	Test pulse error at I3	System continues to run	Check cabling
241D0004	Warning	Test pulse error at I4	System continues to run	Check cabling
241D0005	Warning	Test pulse error at I5	System continues to run	Check cabling
241D0006	Warning	Test pulse error at I6	System continues to run	Check cabling
241D0007	Warning	Test pulse error at I7	System continues to run	Check cabling
241D0008	Warning	Test pulse error at I8	System continues to run	Check cabling
241D0009	Warning	Test pulse error at I9	System continues to run	Check cabling
241D000A	Warning	Test pulse error at I10	System continues to run	Check cabling
241D000B	Warning	Test pulse error at I11	System continues to run	Check cabling
241D000C	Warning	Test pulse error at I12	System continues to run	Check cabling
241D000D	Warning	Test pulse error at I13	System continues to run	Check cabling

Error No.	Error type	Logbook message	System behavior	Remedy
241D000E	Warning	Test pulse error at I14	System continues to run	Check cabling
241D000F	Warning	Test pulse error at I15	System continues to run	Check cabling
241D0010	Warning	Test pulse error at I16	System continues to run	Check cabling
241D0011	Warning	Test pulse error at IQ1	System continues to run	Check cabling
241D0012	Warning	Test pulse error at IQ2	System continues to run	Check cabling
241D0013	Warning	Test pulse error at IQ3	System continues to run	Check cabling
241D0014	Warning	Test pulse error at IQ4	System continues to run	Check cabling
241Dxxxx	Warning	Check of test pulses returned an error	System continues to run	Check cabling
241Exxxx	Warning	Verification of project failed	System continues to run	Re-verification
241Fxxxx	Warning	Verification of project failed	System continues to run	Re-verification
2420xxxx	Warning	Verification of project failed	System continues to run	Re-verification
2421xxxx	Warning	Verification of project failed	System continues to run	Re-verification
2422xxxx	Warning	Verification of project failed	System continues to run	Re-verification
2423xxxx	Info	The verified project on the SD card has changed	System continues to run	-
2433xxxx	Warning	Problem during fast shut-off	System continues to run	-
2435Fx00	Warning	Safety mat cable break	System continues to run	Check cabling
2435Fx02	Warning	Safety mat cable break	System continues to run	Check cabling
2435Fx04	Warning	Safety mat cable break	System continues to run	Check cabling
2435Fx06	Warning	Safety mat cable break	System continues to run	Check cabling
2435Fx08	Warning	Safety mat cable break	System continues to run	Check cabling
2435Fx0A	Warning	Safety mat cable break	System continues to run	Check cabling
2435Fx0C	Warning	Safety mat cable break	System continues to run	Check cabling
2435Fx0E	Warning	Safety mat cable break	System continues to run	Check cabling
2435Fx10	Warning	Safety mat cable break	System continues to run	Check cabling

Error No.	Error type	Logbook message	System behavior	Remedy
2435Fx12	Warning	Safety mat cable break	System continues to run	Check cabling
2435Fxxx	Warning	Safety mat cable break	System continues to run	Check cabling
2435xxxx	Warning	Safety mat cable break	System continues to run	Check cabling
2436xxxx	Warning	Check of a safety feature	System continues to run	Unverification of project
2437xxxx	Warning	Check of a safety feature	System continues to run	Reduce the number of forced inputs to less than or equal to 10
2438xxxx	Warning	Configuration data faulty	System continues to run	Modify project data or make complaint
2439xxxx	Error	The configuration changed during execution of the application	System stop; voltage OFF-ON required	Restart or make complaint
243Bxxxx	Warning	Configuration data faulty	System continues to run	Modify project data or make complaint
243CFx00	Warning	Stuck-at-high safety mat at I1	System continues to run	Check cabling
243CFx01	Warning	Stuck-at-high safety mat at I2	System continues to run	Check cabling
243CFx02	Warning	Stuck-at-high safety mat at I3	System continues to run	Check cabling
243CFx03	Warning	Stuck-at-high safety mat at I4	System continues to run	Check cabling
243CFx04	Warning	Stuck-at-high safety mat at I5	System continues to run	Check cabling
243CFx05	Warning	Stuck-at-high safety mat at I6	System continues to run	Check cabling
243CFx06	Warning	Stuck-at-high safety mat at I7	System continues to run	Check cabling
243CFx07	Warning	Stuck-at-high safety mat at I8	System continues to run	Check cabling
243CFx08	Warning	Stuck-at-high safety mat at I9	System continues to run	Check cabling
243CFx09	Warning	Stuck-at-high safety mat at I10	System continues to run	Check cabling
243CFx0A	Warning	Stuck-at-high safety mat at I11	System continues to run	Check cabling
243CFx0B	Warning	Stuck-at-high safety mat at I12	System continues to run	Check cabling
243CFx0C	Warning	Stuck-at-high safety mat at I13	System continues to run	Check cabling
243CFx0D	Warning	Stuck-at-high safety mat at I14	System continues to run	Check cabling
243CFx0E	Warning	Stuck-at-high safety mat at I15	System continues to run	Check cabling

Error No.	Error type	Logbook message	System behavior	Remedy
243CFx0F	Warning	Stuck-at-high safety mat at I16	System continues to run	Check cabling
243CFx10	Warning	Stuck-at-high safety mat at IQ1	System continues to run	Check cabling
243CFx11	Warning	Stuck-at-high safety mat at IQ2	System continues to run	Check cabling
243CFx12	Warning	Stuck-at-high safety mat at IQ3	System continues to run	Check cabling
243CFx13	Warning	Stuck-at-high safety mat at IQ4	System continues to run	Check cabling
243CFxxx	Warning	Stuck-at-high safety mat	System continues to run	Check cabling
243D0012	Warning	Error in system configuration	Config required	Reload system configuration
243D0034	Warning	Error in system configuration	Config required	Reload system configuration
250100x1	Warning	Power supply A1 too low	System continues to run	Supply voltage must be set correctly
250100x2	Warning	Power supply B1 too low	System continues to run	Supply voltage must be set correctly
250100x3	Warning	Power supply B2 too low	System continues to run	Supply voltage must be set correctly
2501xxxx	Warning	Power supply too low	System continues to run	Supply voltage must be set correctly
250200x1	Warning	Power supply A1 too high	System continues to run	Supply voltage must be set correctly
250200x2	Warning	Power supply B1 too high	System continues to run	Supply voltage must be set correctly
250200x3	Warning	Power supply B2 too high	System continues to run	Supply voltage must be set correctly
2502xxxx	Warning	Power supply too high	System continues to run	Supply voltage must be set correctly
2503xxx1	Error	Power supply A1 too low	System stop; voltage OFF-ON required	Supply voltage must be set correctly
2504xxx1	Error	Power supply A1 too high	System stop; voltage OFF-ON required	Supply voltage must be set correctly
2504xxx2	Error	Power supply B1 too high	System stop; voltage OFF-ON required	Supply voltage must be set correctly

Error No.	Error type	Logbook message	System behavior	Remedy
2504xxx3	Error	Power supply B2 too high	System stop; voltage OFF-ON re- quired	Supply voltage must be set cor- rectly
2504xxxx	Error	Power supply too high	System stop; voltage OFF-ON re- quired	Supply voltage must be set cor- rectly
250500x1	Info	Supply voltage A1 within normal range	System continues to run	-
250500x2	Info	Supply voltage B1 within normal range	System continues to run	-
250500x3	Info	Supply voltage B2 within normal range	System continues to run	-
2505xxxx	Info	Supply voltage within normal range	System continues to run	-
250900x1	Warning	Overcurrent at output group Q1/ Q2	System continues to run	Check load current
250900x2	Warning	Overcurrent at output group Q3/ Q4	System continues to run	Check load current
250900x3	Warning	Overcurrent at output group IQ1/ IQ2	System continues to run	Check load current
250900x4	Warning	Overcurrent at output group IQ3/ IQ4	System continues to run	Check load current
2509xxxx	Warning	Overcurrent at output	System continues to run	Check load current
2604xxxx	Warning	Internal/external S-bus error	System continues to run	Reduce the number of expansion mod- ules
2609xxxx	Warning	Error in system configuration.	System continues to run	Reload system con- figuration
260Axxxx	Warning	Error in system configuration.	System continues to run	Reload system con- figuration
260Bxxxx	Error	Too many expansion modules plugged in	System stop; voltage OFF-ON re- quired	Check connection of modules
2733xxxx	Warning	Input discrepancy rectified	System continues to run	-
28020000	Info	Values were changed	System continues to run	-
2805xxxx	Warning	Communication interrupted	System continues to run	Restart or make complaint
2808xxxx	Warning	No SD card	Configuration re- quired	Insert SD card
2809xxxx	Warning	Action not permitted	System continues to run	Execute correct ac- tion
280Axxxx	Warning	Ethernet connection too slow	System continues to run	-
2B0Exxxx	Warning	Time for logic processing ex- ceeded	System continues to run	-
2Bxxxxxx	Warning	Internal error	System continues to run	-

Error No.	Error type	Logbook message	System behavior	Remedy
3409xxxx	Warning	Invalid force request	System continues to run	-
340Axxxx	Warning	Invalid trace request	System continues to run	-
34290003	Warning	Synchronization time error I1/I2	System continues to run	-
3429000C	Warning	Synchronization time error I3/I4	System continues to run	-
34290030	Warning	Synchronization time error I5/I6	System continues to run	-
342900C0	Warning	Synchronization time error I7/I8	System continues to run	-
3429xxxx	Warning	Dual-channel synchronization time error	System continues to run	-
342A0003	Warning	Sequence error at I1/I2	System continues to run	-
342A000C	Warning	Sequence error at I3/I4	System continues to run	-
342A0030	Warning	Sequence error at I5/I6	System continues to run	-
342A00C0	Warning	Sequence error at I7/I8	System continues to run	-
342Axxxx	Warning	Sequence error at 2-channel input	System continues to run	-
36010001	Warning	External test pulse error at I1	System continues to run	-
36010002	Warning	External test pulse error at I2	System continues to run	-
36010004	Warning	External test pulse error at I3	System continues to run	-
36010008	Warning	External test pulse error at I4	System continues to run	-
36010010	Warning	External test pulse error at I5	System continues to run	-
36010020	Warning	External test pulse error at I6	System continues to run	-
36010040	Warning	External test pulse error at I7	System continues to run	-
36010080	Warning	External test pulse error at I8	System continues to run	-
3601xxxx	Warning	Error at external input test pulse	System continues to run	-
3602xxxx	Warning	Safety mat cable break	System continues to run	-
3702xxxx	Warning	Short circuit, stuck-at-low, VCC or GND break	System continues to run	-
37040003	Warning	Cross-point fault at Q1/Q2	System continues to run	-

Error No.	Error type	Logbook message	System behavior	Remedy
3704000C	Warning	Cross-point fault at Q3/Q4	System continues to run	-
3704xxxx	Warning	Cross-point fault at the output	System continues to run	-
37050001	Warning	Stuck-at-high at Q1	System continues to run	-
37050002	Warning	Stuck-at-high at Q2	System continues to run	-
37050004	Warning	Stuck-at-high at Q3	System continues to run	-
37050008	Warning	Stuck-at-high at Q4	System continues to run	-
3705xxxx	Warning	Stuck-at-high at the output	System continues to run	-
3801xxxx	Error	Power supply error (logic voltage)	System stop; voltage OFF-ON required	-
3802xxxx	Error	Power pack monitoring	System stop; voltage OFF-ON required	-
3803xxxx	Error	Output voltage error	System stop; voltage OFF-ON required	-
3806xxxx	Warning	GND break at A1 and A2	System continues to run	-
3807xxxx	Warning	Power supply A1 too low	System continues to run	-
3902xxxx	Warning	Error in system configuration	System continues to run	-
3903xxxx	Warning	Error in system configuration	System continues to run	-
3904xxxx	Warning	Error in system configuration	System continues to run	-
3905xxxx	Warning	Invalid value for synchronous time	System continues to run	Configure synchronous time with value 0 or a whole-number multiple of 4 ms
3906xxxx	Warning	Error in system configuration	System continues to run	-
3907xxxx	Warning	Error in system configuration	System continues to run	-
3908xxxx	Warning	Error in system configuration	System continues to run	-
3909xxxx	Warning	Error in system configuration	System continues to run	-
390Axxxx	Warning	Error in system configuration	System continues to run	-
390Bxxxx	Warning	Error in system configuration	System continues to run	-

Error No.	Error type	Logbook message	System behavior	Remedy
390Cxxxx	Warning	Error in system configuration	System continues to run	-
390Dxxxx	Warning	Error in system configuration	System continues to run	-
390Exxxx	Warning	Error in system configuration	System continues to run	-
390Fxxxx	Warning	Error in system configuration	System continues to run	-
3910xxxx	Warning	Error in system configuration	System continues to run	-
3911xxxx	Warning	Error in system configuration	System continues to run	-
3945xxxx	Warning	Fast shut-off control signal faulty	System continues to run	-
4102xxxx	Warning	CRC error in the configuration	System continues to run	-
4103xxxx	Warning	Module type deviates	System continues to run	-
4104xxxx	Warning	Module version deviates	System continues to run	-
4106xxxx	Warning	Service data object not processed	System continues to run	-
4302xxxx	Info	Service data object not processed	System continues to run	-
4303xxxx	Info	Service data object not processed	System continues to run	-
4304xxxx	Info	Service data object not processed	System continues to run	-
4305xxxx	Info	Service data object not processed	System continues to run	-
4306xxxx	Info	Service data object not processed	System continues to run	-
4307xxxx	Info	Service data object not processed	System continues to run	-
4309xxxx	Info	Service data object not processed	System continues to run	-
430Bxxxx	Error	Gateway address is outside of the permissible range	System stop; voltage OFF-ON required	-
4501xxxx	Warning	Data loss in the reception memory due to very high bus load	System continues to run	-
4502xxxx	Warning	CAN controller TEC or REC ≥ 96	System continues to run	-
4503xxxx	Warning	CAN controller TEC or REC > 127	System continues to run	-
4504xxxx	Warning	CAN controller TEC > 255	System continues to run	-
4505xxxx	Warning	Transmission of a message was faulty	System continues to run	-

Error No.	Error type	Logbook message	System behavior	Remedy
4506xxxx	Warning	Data loss in transmit buffer due to overload	System continues to run	-
4507xxxx	Error	Initializing was faulty	System stop; voltage OFF-ON required	-
4508xxxx	Warning	Lifeguarding faulty	System continues to run	-
4601xxxx	Error	Faulty stack initializing	System stop; voltage OFF-ON required	-
4602xxxx	Error	A stack error occurred during runtime	System stop; voltage OFF-ON required	-
4603xxxx	Error	An AS protocol error occurred during runtime	System stop; voltage OFF-ON required	Read out the error log in the PLC and eliminate the corresponding protocol error
4604xxxx	Warning	An AS protocol error occurred during runtime	System continues to run	Read out the error log in the PLC and eliminate the corresponding protocol error
4605xxxx	Warning	Incorrect description file, a timeout occurred, or the PLC is not running.	System continues to run	Read out the error log in the PLC, check the cabling and the device description file, note the product code and revision in particular
50xxxxxx	Warning	Modbus/TCP error	System continues to run	-
51xxxxxx	Warning	PROFINET IO error	System continues to run	-
5201xxxx	Error	Too many Ethernet/IP connections	System continues to run	-
5202xxxx	Warning	Incorrect Ethernet/IP data format	System continues to run	-
5203xxxx	Warning	Incorrect Ethernet/IP data format	System continues to run	-
5204xxxx	Warning	Incorrect Ethernet/IP data size	System continues to run	-
5205xxxx	Warning	Incorrect Ethernet/IP command	System continues to run	-
5206xxxx	Warning	Ethernet/IP read error	System continues to run	-
5209xxxx	Warning	Incorrect Ethernet/IP data index	System continues to run	-
520C00xx	Error	Incorrect Ethernet/IP connection configuration	System continues to run	-

Error No.	Error type	Logbook message	System behavior	Remedy
520Fxxxx	Warning	Ethernet/IP timeout	System continues to run	-
52xxxxxx	Warning	Ethernet/IP error	System continues to run	-
60000000	Info	Log file deleted	System continues to run	-
60000005	Info	Device is linked to a project file	-	-
60000010	Info	Time was reset	System continues to run	-
60000020	Info	IPv4 address and gateway	System continues to run	-
63xxxxxx	Warning	USB error	System continues to run	-
640A0001	Warning	SD card cannot be read	Configuration required	-
64xxxxxx	Warning	File system error on SD card	Configuration required	-
65xxxxxx	Warning	Ethernet error	System continues to run	-
68080003	Warning	Device is linked to another project file	-	-
68080005	Error	Incorrect activation code	-	-
680A0001	Warning	Power supply A1 too low	Configuration required	-
680B0010	Error	Project file is not activated for this device	-	-
690Fxxxx	Warning	Communication interrupted	System continues to run	-
6A020001	Warning	Communication (Ethernet/USB) disrupted	System continues to run	-
6A04xxxx	Warning	Communication (Ethernet/USB) disrupted	System continues to run	-
6A06xxxx	Warning	TCP socket error	System continues to run	-
6A0Cxxxx	Warning	TCP connection failed	System continues to run	-
6Axxxxxx	Warning	Communication error (Ethernet/USB)	System continues to run	-
6B010001	Error	Cannot read project file project.xml	-	-
6B010002	Error	Cannot write project.xml	-	-
6B010010	Error	Cannot read metadata.xml	-	-
6B03000x	Error	Project file faulty	Configuration required	-
6B04xxxx	Warning	Project file faulty	Configuration required	-
6B0x001x	Error	metadata.xml faulty	-	-
6Bxxxxxx	Warning	File error	Configuration required	-