


LSR 46B... Ex n

Throughbeam photoelectric sensor with alignment indicator

2026/02/04 50112942-06



60 m


- Throughbeam photoelectric sensor with visible red light
- Fast alignment through *brightVision*[®]
- Indicator for fast, precise alignment
- Push-pull outputs
- Sensitivity adjustment (optional)
- Warning output for increased availability
- Further options for adapting to the respective application
- ATEX certification:
 - Ex II 3G Ex ec IIB T4 Gc X
 - Ex II 3D Ex tc IIIC T70°C Dc X
- IECEx BVS 21.0077X
 - Ex ec IIB T4 Gc
 - Ex tc IIIC T70°C Dc
- UL approval  is available for the sensor used without an enclosure

Accessories:

(available separately)


- Mounting systems (BT 46, BT 46.1, BT 46.1.5, BT 46.2)
- M12 connectors (KD ...)
- Ready-made cables (KD ...)
- Alignment aid (SAT 5)
- Interlocking guard K-VM12-Ex (Part no. 501 09217)

Dimensioned drawing

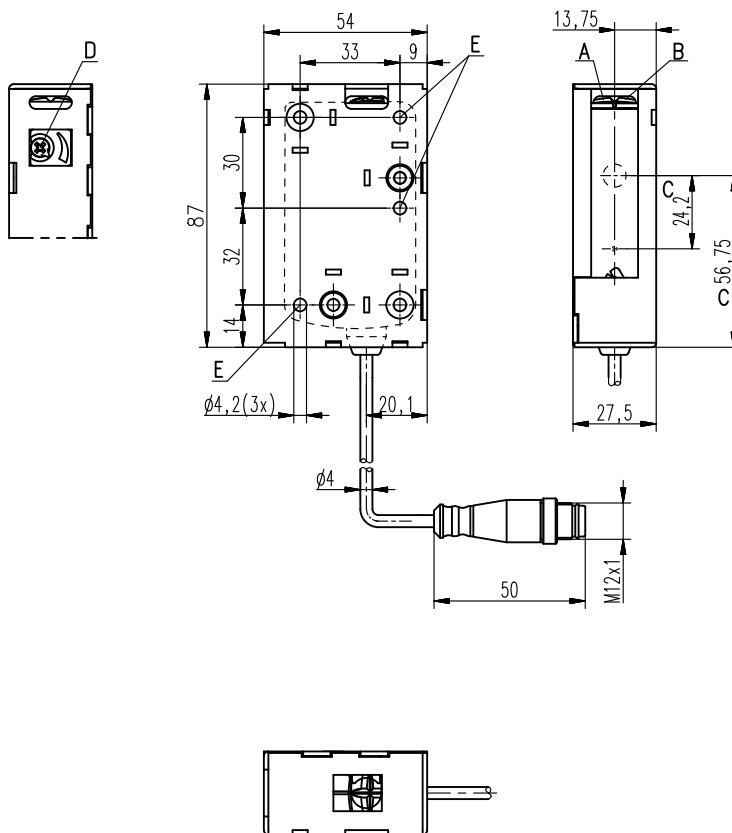

- A Green indicator diode
- B Yellow indicator diode
- C Optical axis
- D Optional sensitivity adjustment
- E Fastening hole

Electrical connection

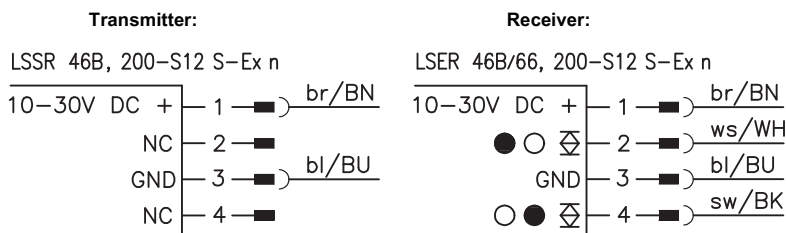

We reserve the right to make changes

Technical data

Optical data

Typ. operating range limit ¹⁾	60m
Operating range ²⁾	50m
Light source ³⁾	LED (modulated light)
Wavelength	620nm (visible red light, polarized)

Time behavior

Switching frequency	500Hz
Response time	1ms
Readiness delay	≤ 300ms

Electrical data

With transistor switching outputs

Operating voltage U_B	10 ... 30VDC (incl. residual ripple)
Residual ripple	≤ 15% of U_B
Open-circuit current	≤ 20mA
Switching output ⁴⁾	2 push-pull switching outputs
	Pin 2: PNP dark switching, NPN light switching
	Pin 4: PNP light switching, NPN dark switching
	≥ ($U_B - 2V$) / ≤ 2V
	Max. 50mA

Signal voltage high/low	
Output current	

Indicators

Green LED	Ready
Yellow LED	Light path free
Yellow LED, flashing	Light path free, no function reserve

Mechanical data

Housing	Plastic
Optics cover	Plastic
Weight (with cable and conn.)	65g
Connection type	Cable with M12 connector, cable length: 200mm

Environmental data

Ambient temp. (operation/storage)	-20 °C ... +50 °C / -30 °C ... +70 °C
Protective circuit ⁵⁾	2, 3
VDE protection class ⁶⁾	II, all-insulated
Degree of protection	IP 67, IP 69K
Light source	Exempt group (in acc. with EN 62471)
Standards applied	IEC 60947-5-2

Explosion protection

Certification ATEX:	Ex II 3G Ex ec IIB T4 Gc X
Certification IECEx:	Ex II 3D Ex tc IIIC T70 °C Dc X Ex ec IIB T4 Gc Ex tc IIIC T70 °C Dc

- 1) Typ. operating range limit: max. attainable range without function reserve
- 2) Operating range: recommended range with function reserve
- 3) Average life expectancy 100,000 h at an ambient temperature of 25 °C
- 4) The push-pull switching outputs must not be connected in parallel
- 5) 2=polarity reversal protection, 3=short circuit protection for all transistor outputs
- 6) Rating voltage 50VAC

Order guide



Cable with M12 connector, length: 200 mm

Antivalent push-pull switching output



	Designation	Part no.
Transmitter, housing model S (standard)	LSSR 46B, 200-S12 S-Ex n	50111519
Receiver, housing model S (standard)	LSER 46B/66, 200-S12 S-Ex n	50111520

Tables

0	50	60
---	----	----

	Operating range [m]
	Typ. operating range limit [m]

Diagrams

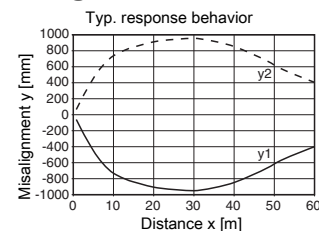

Notes

Observe intended use!

- ⚠ This product is not a safety sensor and is not intended as personnel protection.
- ⚠ The product may only be put into operation by competent persons.
- ⚠ Only use the product in accordance with its intended use.

A light axis consists of a transmitter and a receiver with the following designations:

LSR	= complete light axis
LSSR	= transmitter
LSER	= receiver


- **Alignment indicator:** ('E' see dimensioned drawing)
Yellow LED = light path free - with reserve
Yellow LED, flashing = light path free - no function reserve

LSR 46B... Ex n Throughbeam photoelectric sensor with alignment indicator

Notices for the safe use of sensors in potentially explosive areas

This document is valid for devices with the following classifications:

Device group	Device category	Equipment protection level	Zone
II	3G	Gc	Zone 2
II	3D	Dc	Zone 22

⚠ ATTENTION!	
	<ul style="list-style-type: none"> ● Check whether the equipment classification corresponds to the requirements of the application. ● The devices are not suited for the protection of persons and may not be used for emergency shutdown purposes. ● A safe operation is only possible if the equipment is used properly and for its intended purpose. ● Electrical equipment may endanger humans and (where applicable) animal health, and may threaten the safety of goods if used incorrectly or under unfavorable conditions in potentially explosive areas. ● The applicable national regulations (e.g. EN 60079-14) for the configuration and installation of explosion-proof systems must be observed without fail.

Installation and Commissioning (see also Special conditions)

- The devices must only be installed and commissioned by trained electricians. They must be aware of the regulations and operation of explosion-proof equipment.
- The connector of series 46B sensors must be equipped with a safeguard or a mechanical interlocking guard (e.g. K-VM 12-Ex, part no. 50109217) to prevent unintentional separation under voltage. An additional warning sign "WARNING – DO NOT SEPARATE WHEN ENERGIZED" that is supplied with the device must be attached to the sensor or its mounting bracket so that it is clearly visible. This notice must be attached to the device before it is taken into operation.
- Connection cables and connectors must be protected from excessive or unintended pulling or pushing strain.
- Prevent dust deposits from forming on the devices.

Maintenance

- No changes may be made to explosion-proof devices.
- Repairs may only be performed by a person trained for such work or by the manufacturer.
- Defective devices must be replaced immediately.
- Cyclical maintenance is generally not necessary.
- Depending on the environmental conditions, it may occasionally be necessary to clean the optical surfaces of the sensors. This cleaning must only be performed by persons trained for performing this task. We recommend the use of a soft and damp cloth. Cleaning agents containing solvents must not be used.

Chemical resistance

- The sensors demonstrate good resistance against diluted (weak) acids and bases.
- Exposure to organic solvents is possible only under certain circumstances and only for short periods of time.
- Resistance to chemicals must be examined on a case by case basis.

Special conditions

- The devices must be installed in such a way that they are protected from direct exposure to UV rays (sunlight).
- The metallic cage has to be integrated into the potential equalization before usage to prevent electrostatic charge.
- The light barriers must not be installed in areas where processes with high static charges occur.
- The light barriers may only be used if high or repeated electrostatic processes are surely excluded by installation.
- The metallic cage is screwed together with two torx-screws.
- The connector of series 46B sensors must be equipped with a safeguard or a mechanical interlocking guard to prevent unintentional separation under voltage.
- The connector provided by the user in the final application shall be in accordance with all applicable clauses of IEC 60079-0, IEC 60079-7 and IEC 60079-31. A minimum of IP54 according to IEC 60529 shall be ensured.